

DeltaChill Air Cooled & Free Cool

Chiller
100 kW - 510 kW
R410A



Installation, Commissioning and Maintenance Manual



About Airedale Products & Customer Services

Warranty

All AIAC products or parts (non consumable) supplied for installation within the UK mainland and commissioned by an AIAC engineer, carry a full Parts & Labour warranty for a period of 12 months from the date of commissioning or 18 months from the date of despatch, whichever is the sooner.

Parts or Equipment supplied by AIAC for installation within the UK or for Export that are properly commissioned in accordance with AIAC standards and specification, not commissioned by an AIAC engineer; carry a 12 month warranty on non consumable Parts only from the date of commissioning or 18 months from the date of despatch, whichever is the sooner.

Parts or equipment installed or commissioned not to acceptable AIAC standards or specification invalidate all warranty.

Warranty is only valid in the event that

In the period between delivery and commissioning the equipment: is properly protected & serviced as per the AIAC installation & maintenance manual provided where applicable the glycol content is maintained to the correct level.

In the event of a problem being reported and once warranty is confirmed as valid under the given installation and operating conditions, the Company will provide the appropriate warranty coverage (as detailed above) attributable to the rectification of any affected Airedale equipment supplied (excluding costs for any specialist access or lifting equipment that must be ordered by the customer).

Any spare part supplied by Airedale under warranty shall be warranted for the unexpired period of the warranty or 3 months from delivery, whichever period is the longer.

To be read in conjunction with the Airedale Conditions of Sale - Warranty and Warranty Procedure, available upon request.

CAUTION



Warranty cover is not a substitute for maintenance. Warranty cover is conditional to maintenance being carried out in accordance with the recommendations provided during the warranty period. Failure to have the maintenance procedures carried out will invalidate the warranty and any liabilities by Airedale International Air Conditioning Ltd.

Spares

A spares list for 1, 3 and 5 years will be supplied with every unit and is also available from our Spares department on request.

Training

As well as our comprehensive range of products, Airedale offers a modular range of Refrigeration and Air Conditioning Training courses, for further information please contact Airedale.

Customer Services

For further assistance, please e-mail: enquiries@airedale.com or telephone:

UK Sales Enquiries	+ 44 (0) 113 239 1000	enquiries@airedale.com
International Enquiries	+ 44 (0) 113 239 1000	enquiries@airedale.com
Spares Hot Line	+ 44 (0) 113 238 7878	spares@airedale.com
Airedale Service	+ 44 (0) 113 239 1000	service@airedale.com
Technical Support	+ 44 (0) 113 239 1000	tech.support@airedale.com
Training Enquiries	+ 44 (0) 113 239 1000	marketing@airedale.com

For information, visit us at our Web Site: wwwairedale.com

AIAC Ltd endeavours to ensure that the information in this document is correct and fairly stated, but none of the statements are to be relied upon as a statement or representation of fact. AIAC Ltd does not accept liability for any error or omission, or for any reliance placed on the information contained in this document.

The development of Airedale products and services is continuous and the information in this document may not be up to date. It is important to check the current position with AIAC Ltd at the address stated. This document is not part of a contract or licence unless expressly agreed.

No part of this document may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or information storage and retrieval systems, for any purpose other than the purchaser's personal use, without the express written permission of AIAC Ltd.

Cover image for illustration only.

© 2016 Airedale International Air Conditioning Limited. All rights reserved. Printed in the UK.

ABOUT AIREDALE PRODUCTS & CUSTOMER SERVICES	2
Warranty	2
Spares.....	2
Training.....	2
HEALTH AND SAFETY	5
ENVIRONMENTAL CONSIDERATIONS	6
Freeze Protection.....	6
Environmental Policy	6
GENERAL DESCRIPTION.....	7
Introduction	7
Optimized Efficiency.....	7
Minimum System Water Volume Calculations	8
Temperature Control	9
Operating Limits	10
ESEER Calculations	10
Freeze Prevention	11
DELTACHILL	12
Cooling Performance AC Fans	12
Cooling Performance AC Fans Extra Quiet	16
Cooling Performance EC Fans	20
Cooling Performance EC Fans Extra Quiet	24
Mechanical Data Regular Quiet	28
Mechanical Data Extra Quiet.....	39
Electrical Data Regular Quiet	50
Electrical Data Extra Quiet	61
DELTACHILL FREE COOL	72
Cooling Performance Free Cool	72
Mechanical Cooling EC Fans Regular Quiet.....	81
Mechanical Cooling EC Fan high air flow	87
Mechanical Data Free Cool Chillers Regular Quiet.....	90
Mechanical Data Free Cool Chillers Extra Quiet	96
Electrical Data Free Cool Chiller Regular Quiet	102
Electrical Data Free Cool Chiller Extra Quiet.....	108
HYDRONIC DATA	114
Waterside Pressure Drop - DCC	115
Waterside Pressure Drop - DCF.....	116
Evaporator Pressure Drops	117
Pump Packages	120
Inverter Driven Pumps.....	123
INSTALLATION DATA	124
Dimensions.....	124
Masses, Point Loadings & Centre of Gravity (C of G).....	125

Unit Lifting	128
Positioning	129
Anti Vibration Mounting (Optional)	130
Anti Vibration Mount Allocations No pumps	131
Anti Vibration Mount Allocations Single Pump	133
Anti Vibration Mount Allocations Run / Standby Pump.....	135
Freecool Anti Vibration Mount Allocations No pumps	137
Freecool Anti Vibration Mount Allocations Single Pump.....	138
Freecool Anti Vibration Mount Allocations Run / Standby Pump.....	139
Standard Recommended Installation.....	140
Water Systems and Recommended Flow Schemes	141
Electrical.....	143
Interconnecting Wiring	144
CONTROLS	145
Use of Display Keypad Buttons	145
Enabling the Unit	146
Unit Alarm Interrogation.....	147
Pump Control Panel.....	148
Start-Up Guide.....	148
COMMISSIONING PROCEDURE.....	149
Pre Commissioning Checklist	149
Electrical.....	150
Waterside.....	151
Controls	151
Refrigeration.....	152
OPERATIONAL MAINTENANCE CHECKS.....	154
Owners Responsibility	154
Unit Inspection	154
Refrigeration.....	155
Waterside.....	156
Controls	157
PLAN TERMINATION.....	158
MAINTENANCE ADVICE.....	159
Microchannel Condenser Coil Cleaning	159
TROUBLESHOOTING	160
General.....	160
Refrigeration.....	160
Waterside.....	162
Unit Alarms	163
Pump Warning and Alarm List.....	166

Health and Safety

IMPORTANT

The information contained in this manual is critical to the correct operation and maintenance of the unit and should be read by all persons responsible for the installation, commissioning and maintenance of this Airedale unit.

Safety

The equipment has been designed and manufactured to meet international safety standards but, like any mechanical/electrical equipment, care must be taken if you are to obtain the best results.

CAUTION

- ▼ 1 Installation, service and maintenance of Airedale equipment should only be carried out by technically trained competent personnel.

CAUTION

- ▼ 2 When working with any air conditioning units ensure that the electrical isolator is switched off prior to servicing or repair work and that there is no power to any part of the equipment.

- 3 Also ensure that there are no other power feeds to the unit such as fire alarm circuits, BMS circuits etc.
- 4 Electrical installation commissioning and maintenance work on this equipment should be undertaken by competent and trained personnel in accordance with local relevant standards and codes of practice.
- 5 The refrigerant used in this range of products is classified under the COSHH regulations as an irritant, with set Workplace Exposure Levels (WEL) for consideration if this plant is installed in confined or poorly ventilated areas.
- 6 A full hazard data sheet in accordance with COSHH regulations is available should this be required.

Protective Personal Equipment

Airedale recommends that personal protective equipment is used whilst installing, maintaining and commissioning equipment.

Refrigerant Warning

The Airedale DeltaChill Freecool uses R410A refrigerant which is a high pressure refrigerant. It requires careful attention to proper storage and handling procedures.

Use on manifold gauge sets designed for use with R410A refrigerant. Use only refrigerant recovery units and cylinders designed for high pressure refrigerants.

R410A must only be charged in the liquid state to ensure correct blend makeup.

The refrigerant must be stored in a clean, dry area away from sunlight. The refrigerant must never be stored above 50°C.

Manual Handling

Some operations when servicing or maintaining the unit may require additional assistance with regard to manual handling. This requirement is down to the discretion of the engineer. Remember do not perform a lift that exceeds your ability.

Environmental Considerations

Freeze Protection

Airedale recommends the following actions to help protect the unit during low temperature operation. This also includes the units subject to low ambient temperatures.

Units with supply water temperatures below +5°C

- Glycol is recommended when a supply water temperature of +5°C or below is required or when static water can be exposed to freezing temperatures.

Units subject to ambient temperatures lower than 0°C

- Glycol of an appropriate concentration ⁽¹⁾ is used within the system to ensure adequate protection. Please ensure that the concentration is capable of protection at least 3°C lower than ambient.
- Water / glycol solution is constantly circulated through all waterside pipework and coils to avoid static water from freezing.
- Ensure that pumps are started and running even during shut down periods, when the ambient is within 3°C of the solution freeze point ⁽¹⁾ (i.e. if the solution freezes at 0°C, the pump must be operating at 3°C ambient).
- Additional trace heating is provided for interconnecting pipework.

⁽¹⁾ Referrer to your glycol supplier for details

Environmental Policy

It is our policy to:

- Take a proactive approach to resolve environmental issues and ensure compliance with regulatory requirements.
- Train personnel in sound environmental practices.
- Pursue opportunities to conserve resources, prevent pollution and eliminate waste.
- Manufacture products in a responsible manner with minimum impact on the environment.
- Reduce our use of chemicals and minimise their release to the environment.
- Measure, control and verify environmental performance through internal and external audits.
- Continually improve our environmental performance.

CE Directive



Airedale certify that the equipment detailed in this manual conforms with the following EC Directives:

Electromagnetic Compatibility Directive (EMC)

2014/30/EU

Low Voltage Directive (LVD)

2014/35/EU

Machinery Directive (MD)

89/392/EEC version 2006/42/EC

Pressure Equipment Directive (PED)

97/23/EC

Article 13 of 2014/68/EU

To comply with these directives appropriate national & harmonised standards have been applied. These are listed on the Declaration of Conformity, supplied with each product.

Maximum and Minimum Operation Temperature (TS) and Pressure (PS)


Operating Temperature (TS), TS = Min -20°C to Max 120°C *

Maximum Operating Pressure (PS)

PS = High Side 26 Barg

*Based upon the maximum machine running temperatures.

General Description

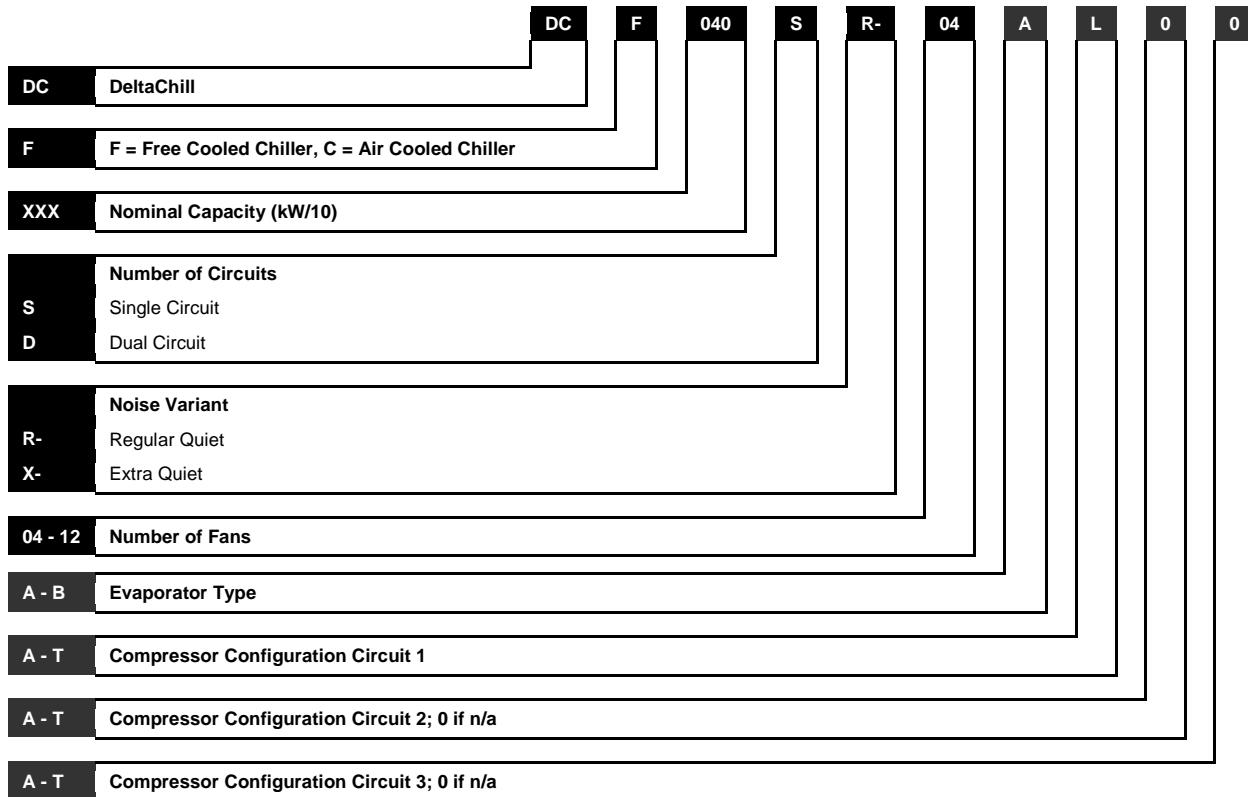

Introduction

The Airedale range of DeltaChill Compact air cooled and Free Cooling liquid chillers covers the nominal capacity range 100 kW to 450 kW. The range is available with many optional variations including Quiet (**R**) and Extra Quiet (**X**) sound level variants.

Attention has been placed on maximising the unit's performance while keeping footprint to an absolute minimum.

DeltaChill is a compact, high efficiency, air cooled chiller designed to bring you an energy optimised, low sound cooling solution. Expertly engineered and managed using the best available technology and components to optimise performance and minimise environmental impact, DeltaChill is ideal for cooling a wide range of applications involving medium and diverse cooling loads. Configuration flexibility enables selection of the optimum model in terms of capacity, number of fans, energy efficiency and sound.

Optimized Efficiency

Excellent part load efficiencies increase the DeltaChill's seasonal efficiency (ESEER and SEER values), significantly enhanced by:

- Intelligent, interactive control logic
- Integration of optional EC fan technology and interactive head pressure setpoint management (included within the EC fan option).
- Compressor sequencing
- Distinctive, modular 'V' frame coil-fan arrangement which also facilitates easy maintenance access

Design Features & Information

Specific Heat Capacity (SHC)

% Ethylene Glycol Concentration	0%	10%	20%	30%	40%
Specific Heat Capacity (kJ/kgK) (1)	4.190	4.115	3.901	3.686	3.474
% Propylene Glycol Concentration	0%	10%	20%	30%	40%
Specific Heat Capacity (kJ/kgK) (1)	4.190	4.139	4.033	3.903	3.749

(1) Data quoted for water/glycol solutions at a nominal temperature of 10°C.

CAUTION

 Only use the SHC data when calculating fluid VOLUME. Use figure for 0% concentration (100% water) when applying Glycol Correction Factors.

Minimum System Water Volume Calculations

METHOD 1 (Preferred Method)	Where the system permanent heat load is known, the minimum water volume in litres V_{min} is:
	$V_{min} = \frac{\text{Water Flow Rate (litres/minute)} \times \text{Minimum Compressor Run Time (mins)} \times \text{Chiller Loading Factor}}{12}$
	Where V_{min} is the minimum water volume in litres Minimum Compressor Run Time is 2 minutes
	Chiller Loading Factor = $\frac{\text{Minimum Turndown (kW)} \times 1.2}{\text{Permanent Heat Load}}$

Example: Chiller at 35°C Ambient, 7/12°C Water, Model DCC033DR-08BMM0 with a permanent load of 129.6kW

Unit capacity at design conditions	= 326 kW
Permanent Heat Load	= 129.6kW
Minimum Turndown	= 27%

$$V_{min} = \frac{326 \times 60}{4.19 \times 5} \times 2 \times \frac{(326 \times 0.27)}{129.6} \times 1.2 = 1522 \text{ Litres}$$

METHOD 2

Where the system permanent heat load is unknown:

V_{min}	=	Water Flow Rate (litres/hour) x Minimum Turndown Ratio x 1.2 ÷ Maximum number of compressor starts (per hour)
-----------	---	---

Example: Chiller at 35°C Ambient, 7/12°C Water, Model DCC033DR-08BMM0

Unit capacity at design conditions	= 326 kW
Minimum Turndown	= 27% (0.27)

$$V_{min} = \frac{326 \times 3600}{4.19 \times 5} \times 0.27 \times 1.2 = 1512.5 \text{ Litres}$$

Temperature Control

Airedale recognises that all chiller applications are different but fall mainly into 2 application categories; Variable Supply Temperature and Constant Supply Temperature.

The onboard microprocessor has the capability of satisfying either control requirement as illustrated below. Using the Airedale Variable Supply Temperature control scheme, energy savings are available when compared with previous schemes and that of the Constant Supply Temperature application.

Variable Supply Temperature control schemes offer energy savings where the supply water temperature is not critical to its operation.


Selection of the best application control scheme can be made via a soft switch in the microprocessor during initial commissioning.

The microprocessor maintains the set supply Chilled Water temperature by sensing the return and supply water temperatures and ambient air temperature and adjusting the compressor loading as required.


Examples based on Model DCC033DR-08BMH0 having 6 Stages of Cooling

- Key:**
- 1 Return Water Temperature
 - 2 Mean Value
 - 3 Supply Water Temperature
 - 4 Compressor Off

Variable Supply Temperature Control

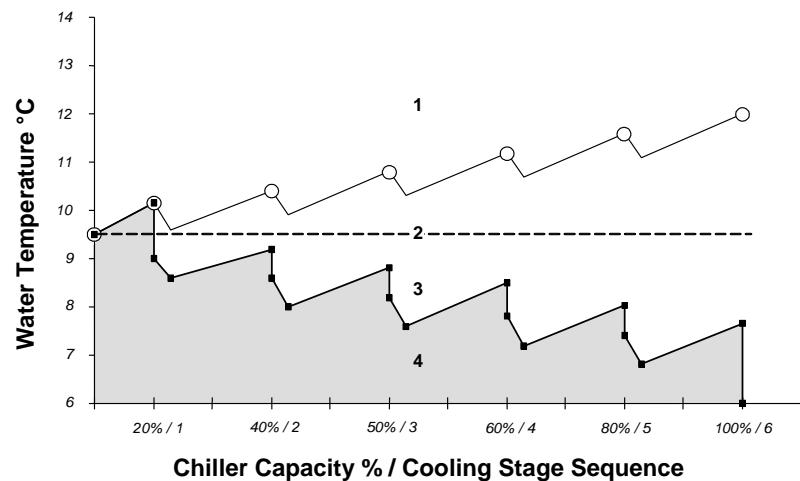

Constant Supply Temperature Control

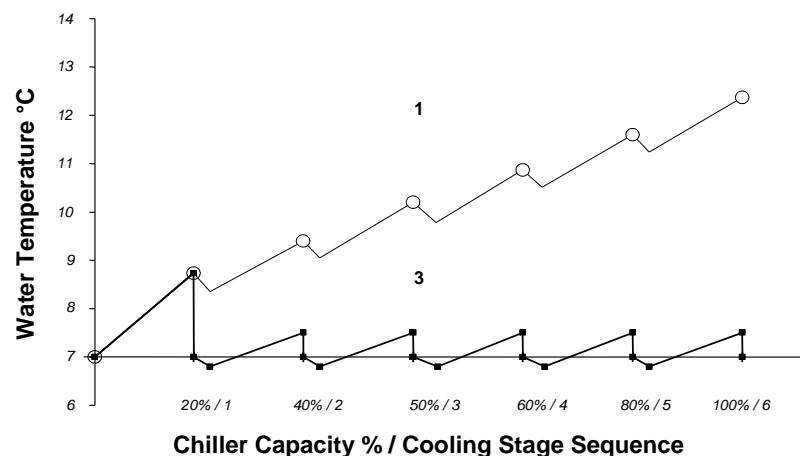

CAUTION

⚠ Factory set to Variable Supply Temperature Control unless otherwise stated at order.

Only when the mode selection has been set can the unit be enabled.

Operating Limits (For 100% Water)

Unit with Electronic Fan Speed HP Control (-20°C)	
Minimum Ambient Air DB °C	-20°C
Maximum Ambient Air DB °C	Refer to Performance Data – Capacity Data
Minimum Leaving Water Temperature °C	+5°C and +6°C (DCC and DCF respectively)
Maximum Return Water Temperature °C	+18°C and +20°C (DCC and DCF respectively)

- 1 Temperatures lower than those stated can be obtained with the addition of glycol.
 2 For conditions outside those quoted, please refer to Airedale.

ESEER Calculations

The quoted EER figures cover the performance of the unit ONLY at the standard rating conditions of 7/12°C water, 35°C ambient. The ESEER calculation method has been developed by Eurovent to give a single value that is a realistic indication of the efficiency of the Chiller across the year round range of operation.

The ESEER value is calculated from the unit's performance at 20, 25, 30 and 35°C ambient temperatures for all loading stages, and with a fixed 7°C supply temperature. All calculations assume the system operates with 100% water.

$$\text{ESEER} = 0.03.\text{EER}_{100\%} + 0.33.\text{EER}_{75\%} + 0.41.\text{EER}_{50\%} + 0.23.\text{EER}_{25\%}$$

Where 0.03, 0.33, 0.41 and 0.23 are specified weighting factors for use on calculating ESEER.

Temperature	35°C	30°C	25°C	20°C
Capacity Requirement	100%	75%	50%	25%
Percentage of Total Hours	0.03	0.33	0.41	0.23

Freeze Prevention

Glycol is recommended when a supply water temperature of +5°C or below is required or when static water can be exposed to freezing temperatures.

Glycol of an appropriate concentration ⁽¹⁾ is used within the system to ensure adequate protection. Please ensure that the concentration is capable of protection at least 3°C lower than ambient.

Water / glycol solution is constantly circulated through all waterside pipework and coils to avoid static water from freezing.

Ensure that pumps are started and running even during shut down periods, when the ambient is within 3°C of the solution freeze point ⁽¹⁾ (i.e. if the solution freezes at 0°C, the pump must be operating at 3°C ambient).

Additional trace heating is provided for interconnecting pipework.

⁽¹⁾ Referrer to your glycol supplier for details

For a given percentage of glycol in the system there are correction factors that need to be applied, the following tables can be used as a guide.

Ethylene Glycol Nominal Correction Factors

Glycol in System / Freezing Point °C ⁽¹⁾	10% / -4°C	20% / -9°C	30% / -15°C	40% / -23°C
Cooling Duty	0.98	0.97	0.95	0.93
Input Power	0.99	0.98	0.96	0.95
Water Flow	0.99	1.02	1.04	1.07
Pressure Drop	1.05	1.20	1.38	1.57

Propylene Glycol Nominal Correction Factors

Glycol in System / Freezing Point °C	10% / -2°C	20% / -6°C	30% / -12°C	40% / -20°C
Cooling Duty	0.97	0.95	0.91	0.88
Input Power	0.99	0.98	0.96	0.95
Water Flow	0.98	0.97	0.95	0.95
Pressure Drop	1.08	1.17	1.31	1.45

Example

DCC033DR-08BMH0 operating at 7/12, 35°C Ambient, 20% Ethylene Glycol, with AC condenser fans.

	Catalogue Figure	Multiplier		Corrected Figure
Cooling kW (refer to Performance Data – Capacity Data)	326	x 0.97	20% Ethylene Glycol =	316.2 kW
Input kW (refer to Performance Data – Capacity Data)	105.6	x 0.98		103.5 kW
Flow l/s (calculated $\frac{(DX \text{ (Mechanical Cooling kW)}}{\Delta T \times 4.19}$)	15.56 l/s	x 1.02		15.87 l/s
Pressure Drop kPa (refer to Performance Data – Capacity Data)	TBA kPa	x 1.20		TBA kPa

DeltaChill

Cooling Performance AC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25	Input kW	30	Input kW	35	Input kW	40	Input kW
DCC011SR-04AK00	5	117.1	28.9	111.6	31.7	106.0	34.8	100.0	38.2
	6	120.9	29.0	115.3	31.8	109.5	34.9	103.3	38.3
	7	124.7	29.2	119.1	32.0	113.1	35.0	106.8	38.4
	8	128.7	29.3	122.9	32.1	116.8	35.1	110.3	38.5
	9	132.7	29.5	126.8	32.2	120.5	35.3	113.8	38.7
	10	136.8	29.7	130.7	32.4	124.3	35.4	117.5	38.8
DCC014SR-04AL00	5	148.7	38.7	142.2	42.1	134.5	45.6	126.1	49.5
	6	153.5	38.9	146.7	42.2	138.8	45.7	130.2	49.6
	7	158.5	39.1	151.3	42.3	143.2	45.9	134.4	49.8
	8	163.5	39.2	156.1	42.5	147.7	46.0	138.7	49.9
	9	168.6	39.4	160.9	42.6	152.3	46.2	143.0	50.1
	10	173.8	39.6	165.7	42.8	157.0	46.3	147.4	50.2
DCC017SR-04AM00	5	174.1	45.1	165.5	48.9	156.3	53.1	146.3	57.6
	6	179.6	45.3	170.7	49.2	161.2	53.3	151.0	57.9
	7	185.1	45.6	176.0	49.4	166.2	53.6	155.7	58.1
	8	190.8	45.8	181.4	49.7	171.3	53.8	160.5	58.4
	9	196.5	46.0	186.9	49.9	176.5	54.1	165.4	58.7
	10	202.3	46.3	192.4	50.2	181.8	54.4	170.4	58.9
DCC021SR-04BS00	5	215.6	58.9	204.5	63.9	192.4	69.5	179.4	75.6
	6	222.2	59.2	210.8	64.3	198.4	69.8	185.0	76.0
	7	229.0	59.5	217.2	64.6	204.5	70.2	190.8	76.3
	8	235.8	59.8	223.7	64.9	210.7	70.5	196.6	76.7
	9	242.8	60.1	230.4	65.2	217.0	70.9	202.5	77.0
	10	249.8	60.5	237.1	65.6	223.3	71.2	208.5	77.4
DCC023SR-04BT00	5	248.6	70.6	234.9	76.7	220.2	83.3	204.5	90.7
	6	256.1	71.1	241.9	77.2	226.8	83.9	210.7	91.2
	7	263.7	71.6	249.1	77.7	233.6	84.4	217.0	91.8
	8	271.3	72.1	256.4	78.3	240.4	85.0	223.4	92.3
	9	279.1	72.7	263.7	78.8	247.3	85.5	229.8	92.9
	10	287.0	73.2	271.2	79.4	254.4	86.1	236.4	93.5
DCC024SR-06BT00	5	260.7	68.6	247.4	74.4	233.2	80.7	217.9	87.6
	6	268.8	68.9	255.1	74.8	240.5	81.1	224.8	88.0
	7	277.0	69.3	263.0	75.2	248.0	81.5	231.9	88.4
	8	285.4	69.6	271.0	75.5	255.6	81.9	239.0	88.8
	9	294.0	70.0	279.2	75.9	263.3	82.3	246.3	89.2
	10	302.6	70.4	287.4	76.3	271.1	82.7	253.6	89.7

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011DR-04ACCO	5	118.1	28.8	112.7	31.6	106.9	34.7	100.9	38.1
	6	122.0	29.0	116.4	31.8	110.5	34.8	104.3	38.2
	7	125.9	29.1	120.2	31.9	114.1	34.9	107.8	38.3
	8	129.9	29.3	124.0	32.0	117.8	35.1	111.3	38.4
	9	133.9	29.5	127.9	32.2	121.6	35.2	114.9	38.6
	10	138.1	29.6	131.9	32.3	125.4	35.3	118.6	38.7
DCC013DR-04ACDO	5	134.9	33.7	128.8	36.8	122.0	40.1	114.7	43.7
	6	139.3	33.9	133.0	36.9	126.0	40.2	118.5	43.8
	7	143.7	34.1	137.2	37.1	130.1	40.3	122.4	43.9
	8	148.3	34.2	141.6	37.2	134.2	40.5	126.4	44.1
	9	152.9	34.4	146.0	37.4	138.5	40.6	130.4	44.2
	10	157.6	34.6	150.5	37.5	142.8	40.8	134.5	44.4
DCC014DR-04ADDO	5	149.4	38.5	142.9	41.9	135.2	45.4	126.9	49.2
	6	154.2	38.7	147.4	42.0	139.6	45.5	131.0	49.4
	7	159.1	38.9	152.1	42.1	144.0	45.7	135.2	49.5
	8	164.2	39.0	156.8	42.3	148.5	45.8	139.5	49.7
	9	169.3	39.2	161.7	42.4	153.1	46.0	143.9	49.8
	10	174.5	39.4	166.6	42.6	157.8	46.1	148.3	50.0
DCC015DR-04ADF0	5	162.7	41.9	155.1	45.5	146.5	49.3	137.2	53.5
	6	167.9	42.1	160.0	45.7	151.2	49.5	141.7	53.7
	7	173.2	42.3	165.0	45.9	155.9	49.7	146.2	53.9
	8	178.6	42.5	170.1	46.1	160.8	49.9	150.8	54.1
	9	184.1	42.7	175.3	46.3	165.7	50.1	155.4	54.3
	10	189.6	42.9	180.5	46.5	170.7	50.3	160.1	54.6
DCC016DR-04AJJ0	5	169.3	43.6	160.6	47.4	151.5	51.6	141.9	56.3
	6	174.7	43.8	165.9	47.6	156.5	51.8	146.6	56.5
	7	180.2	44.0	171.2	47.8	161.6	52.0	151.4	56.6
	8	185.9	44.1	176.6	48.0	166.8	52.2	156.3	56.8
	9	191.6	44.3	182.1	48.2	172.0	52.4	161.3	57.0
	10	197.5	44.5	187.7	48.4	177.3	52.6	166.3	57.3
DCC018DR-04BJK0	5	195.7	51.4	185.5	56.1	174.7	61.4	163.3	67.2
	6	201.8	51.6	191.4	56.4	180.3	61.7	168.6	67.5
	7	208.1	51.9	197.3	56.7	186.0	61.9	173.9	67.8
	8	214.4	52.2	203.4	57.0	191.7	62.2	179.4	68.1
	9	220.8	52.5	209.5	57.3	197.5	62.5	184.9	68.4
	10	227.3	52.8	215.7	57.6	203.5	62.8	190.5	68.7
DCC019DR-04AFK0	5	202.2	52.4	191.6	57.1	180.3	62.4	168.4	68.1
	6	208.5	52.7	197.6	57.4	186.0	62.7	173.7	68.5
	7	214.8	53.0	203.7	57.8	191.8	63.0	179.2	68.8
	8	221.3	53.3	209.9	58.1	197.7	63.3	184.7	69.1
	9	227.9	53.6	216.2	58.4	203.6	63.7	190.3	69.5
	10	234.6	54.0	222.5	58.8	209.7	64.0	196.0	69.8
DCC020DR-06AFK0	5	208.4	51.7	198.3	56.4	187.6	61.5	176.2	67.1
	6	215.1	52.0	204.8	56.6	193.7	61.7	182.1	67.4
	7	222.0	52.2	211.3	56.9	200.0	62.0	188.0	67.6
	8	228.9	52.5	218.0	57.1	206.4	62.2	194.1	67.9
	9	236.0	52.8	224.8	57.4	212.9	62.5	200.2	68.1
	10	243.2	53.0	231.7	57.7	219.5	62.8	206.5	68.4
DCC021DR-04AKK0	5	226.1	59.4	214.0	65.1	201.2	71.4	187.7	78.4
	6	233.1	59.7	220.7	65.4	207.5	71.7	193.6	78.8
	7	240.2	60.1	227.4	65.8	213.9	72.1	199.7	79.1
	8	247.4	60.5	234.3	66.2	220.4	72.5	205.8	79.5
	9	254.7	60.9	241.2	66.6	227.0	72.9	212.0	79.9
	10	262.1	61.4	248.3	67.0	233.7	73.3	218.3	80.4

1 Output kW refers to the chilled water duty.
2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25	Input kW	30	Input kW	35	Input kW	40	Input kW
DCC022DR-06AKK0	5	235.7	58.3	223.9	63.7	211.3	69.6	198.1	76.2
	6	243.2	58.6	231.0	63.9	218.2	69.9	204.6	76.5
	7	250.9	58.9	238.3	64.2	225.1	70.1	211.2	76.7
	8	258.6	59.2	245.8	64.5	232.2	70.4	217.9	77.0
	9	266.5	59.5	253.3	64.8	239.4	70.7	224.7	77.3
	10	274.5	59.8	261.0	65.1	246.7	71.0	231.7	77.5
DCC024DR-04BKL0	5	252.5	70.4	238.6	76.7	223.8	83.8	208.0	91.5
	6	260.1	70.8	245.8	77.2	230.6	84.3	214.5	92.0
	7	267.8	71.3	253.2	77.7	237.6	84.8	221.0	92.5
	8	275.7	71.8	260.3	78.3	244.6	85.3	227.6	93.0
	9	283.6	72.3	268.2	78.7	251.8	85.8	234.3	93.6
	10	291.7	72.8	275.9	79.2	259.0	86.3	241.1	94.1
DCC025DR-06BKL0	5	264.9	68.1	251.5	74.1	237.2	80.7	221.9	88.0
	6	273.2	68.4	259.4	74.4	244.7	81.0	229.0	88.3
	7	281.6	68.7	267.5	74.7	252.4	81.3	236.3	88.6
	8	290.2	69.1	275.7	75.0	260.2	81.7	243.7	89.0
	9	298.9	69.4	284.0	75.4	268.1	82.0	251.2	89.3
	10	307.7	69.8	292.5	75.7	276.2	82.4	258.8	89.7
DCC027DR-04BLL0	5	276.3	81.2	261.0	88.3	244.5	96.1	226.7	104.6
	6	284.6	81.8	268.8	88.9	251.8	96.7	233.6	105.2
	7	292.9	82.3	276.7	89.5	259.3	97.3	240.5	105.8
	8	301.4	82.9	284.0	90.2	266.8	97.9	247.6	106.4
	9	310.0	83.5	292.9	90.7	274.5	98.5	254.7	107.1
	10	318.7	84.1	301.1	91.3	282.2	99.1	262.0	107.7
DCC028DR-06BLL0	5	291.2	77.7	276.6	84.4	260.8	91.6	243.8	99.7
	6	300.2	78.1	285.3	84.7	269.0	92.0	251.5	100.1
	7	309.4	78.5	294.1	85.1	277.4	92.4	259.4	100.5
	8	318.8	78.8	303.0	85.5	285.9	92.8	267.4	100.9
	9	328.3	79.2	312.1	85.9	294.5	93.2	275.5	101.3
	10	337.9	79.6	321.3	86.3	303.2	93.7	283.7	101.7
DCC030DR-06BLM0	5	315.7	84.7	299.4	91.9	281.9	99.9	263.2	108.6
	6	325.4	85.2	308.7	92.4	290.7	100.4	271.4	109.1
	7	335.2	85.6	318.1	92.9	299.6	100.9	279.7	109.6
	8	345.2	86.1	327.6	93.4	308.6	101.4	288.2	110.2
	9	355.4	86.6	337.3	94.0	317.8	102.0	296.8	110.7
	10	365.7	87.1	347.1	94.5	327.1	102.5	305.6	111.3
DCC031DR-08BLM0	5	324.1	83.9	308.8	91.0	291.7	98.7	273.3	107.1
	6	334.4	84.3	318.5	91.4	301.0	99.1	282.1	107.5
	7	344.8	84.6	328.4	91.8	310.4	99.5	291.0	107.9
	8	355.5	85.0	338.5	92.2	320.0	99.9	300.0	108.3
	9	366.3	85.4	348.8	92.6	329.8	100.3	309.3	108.8
	10	377.2	85.8	359.2	93.0	339.7	100.7	318.6	109.2
DCC032DR-06BMM0	5	336.7	91.5	319.1	99.4	300.2	107.9	280.1	117.3
	6	346.9	92.1	328.8	100.0	309.4	108.6	288.6	118.0
	7	357.2	92.7	338.6	100.6	318.7	109.2	297.4	118.6
	8	367.8	93.3	348.6	101.2	328.2	109.8	306.3	119.3
	9	378.5	93.9	358.8	101.9	337.7	110.5	315.3	120.0
	10	389.3	94.5	369.1	102.5	347.5	111.2	324.4	120.7
DCC033DR-08BMM0	5	347.0	90.1	329.8	97.8	311.4	106.1	291.6	115.2
	6	357.7	90.6	340.1	98.3	321.2	106.6	300.9	115.7
	7	368.7	91.0	350.6	98.8	331.1	107.1	310.2	116.2
	8	379.8	91.5	361.2	99.2	341.2	107.6	319.8	116.7
	9	391.2	92.0	372.1	99.7	351.5	108.1	329.4	117.2
	10	402.7	92.4	383.0	100.2	361.9	108.6	339.3	117.8

- 1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).
 3 Duties applicable for chilled water ΔT between 4 and 8°C.
 4 Interpolate for water temperatures between those quoted, do not extrapolate.
 5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)
 6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC036DR-06BMS0	5	379.1	107.0	358.3	116.3	335.5	126.6	312.3	137.5
	6	390.5	107.7	369.2	117.0	346.3	127.1	321.8	138.3
	7	402.1	108.5	380.2	117.8	356.7	127.9	331.5	139.1
	8	413.8	109.2	391.3	118.5	367.2	128.7	341.3	139.9
	9	425.7	109.9	402.6	119.3	377.8	129.5	351.3	140.7
	10	437.8	110.7	414.0	120.1	388.6	130.3	361.4	141.5
DCC038DR-10BMS0	5	400.2	103.4	381.1	112.3	360.3	121.9	337.4	132.3
	6	412.9	103.9	393.3	112.8	371.8	122.3	348.3	132.8
	7	425.9	104.4	405.7	113.3	383.5	122.8	359.4	133.2
	8	439.0	104.8	418.4	113.8	395.4	123.3	370.6	133.8
	9	452.4	105.3	431.1	114.3	407.5	123.8	382.0	134.3
	10	466.1	105.8	444.0	114.7	419.8	124.3	393.6	134.8
DCC039DR-06BSS0	5	414.7	122.2	391.6	132.8	365.5	144.8	339.9	157.3
	6	427.1	123.0	403.3	133.7	377.7	145.4	350.2	158.2
	7	439.7	123.8	415.2	134.5	388.8	146.3	360.6	159.1
	8	452.4	124.7	427.2	135.4	400.2	147.2	371.2	160.0
	9	465.3	125.6	439.4	136.3	411.7	148.1	381.9	161.0
	10	478.3	126.4	451.8	137.2	423.3	149.1	392.8	162.0
DCC042DR-10BSS0	5	441.6	116.5	419.9	126.4	396.3	137.2	370.7	149.1
	6	455.4	117.0	433.1	126.9	408.9	137.7	382.6	149.6
	7	469.4	117.5	446.6	127.4	421.7	138.2	394.7	150.2
	8	483.7	118.0	460.2	127.9	434.7	138.8	407.0	150.7
	9	498.3	118.5	474.1	128.4	447.9	139.3	419.5	151.3
	10	513.0	119.0	488.3	129.0	461.3	139.9	432.2	151.9
DCC043DR-08BST0	5	466.4	129.6	441.2	140.7	414.1	152.9	385.1	166.3
	6	480.2	130.3	454.4	141.5	426.7	153.8	397.0	167.2
	7	494.3	131.1	467.8	142.4	439.4	154.6	409.0	168.1
	8	508.6	132.0	481.4	143.2	452.3	155.5	421.1	169.0
	9	523.1	132.8	495.3	144.1	465.4	156.4	433.4	169.9
	10	537.9	133.6	509.3	145.0	478.7	157.3	445.9	170.9
DCC045DR-10BST0	5	477.6	127.3	453.2	138.2	426.9	150.0	398.6	163.0
	6	492.4	128.0	467.3	138.8	440.3	150.7	411.2	163.8
	7	507.5	128.6	481.7	139.5	453.9	151.4	424.0	164.5
	8	522.8	129.3	496.3	140.2	467.7	152.2	437.0	165.2
	9	538.3	130.0	511.1	140.9	481.7	152.9	450.2	166.0
	10	554.1	130.7	526.1	141.7	496.0	153.6	463.7	166.8
DCC046DR-08BTT0	5	495.3	141.1	467.9	153.3	438.6	166.5	407.3	181.2
	6	509.7	142.1	481.6	154.3	451.6	167.6	419.5	182.2
	7	524.4	143.0	495.6	155.3	464.8	168.6	431.9	183.3
	8	539.3	144.0	509.7	156.3	478.1	169.7	444.5	184.4
	9	554.4	145.1	524.1	157.4	491.7	170.8	457.2	185.5
	10	569.9	146.1	538.7	158.5	505.5	171.9	470.2	186.7
DCC048DR-10BTT0	5	508.3	138.0	481.7	149.8	453.2	162.7	422.6	176.8
	6	523.9	138.8	496.5	150.6	467.2	163.6	435.8	177.7
	7	539.7	139.6	511.6	151.5	481.4	164.4	449.1	178.6
	8	555.8	140.4	526.9	152.4	495.9	165.3	462.7	179.6
	9	572.2	141.3	542.4	153.3	510.6	166.3	476.5	180.5
	10	588.7	142.1	558.2	154.2	525.5	167.2	490.5	181.5
DCC051DR-08BVVO	5	545.9	160.2	513.1	177.2	481.4	195.3	446.3	216.3
	6	561.7	161.3	529.4	178.0	495.5	196.6	459.4	217.6
	7	577.8	162.5	544.7	179.2	509.8	197.9	472.8	218.9
	8	594.1	163.7	560.1	180.5	524.3	199.2	486.4	220.3
	9	610.6	165.0	575.8	181.8	539.1	200.6	500.2	221.7
	10	627.4	166.2	591.7	183.1	554.1	202.0	514.2	223.2

1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011SX-04AK00	5	117.3	28.3	111.4	31.0	105.3	33.9	98.8	37.2
	6	121.0	28.4	115.0	31.1	108.7	34.0	102.0	37.3
	7	124.8	28.5	118.7	31.2	112.2	34.1	105.3	37.4
	8	128.7	28.7	122.4	31.3	115.7	34.3	108.7	37.5
	9	132.7	28.8	126.2	31.4	119.3	34.4	112.1	37.7
	10	136.7	29.0	130.0	31.6	123.0	34.5	115.6	37.8
DCC014SX-04AL00	5	147.0	37.8	139.7	41.1	131.9	44.7	123.4	48.7
	6	151.6	38.0	144.2	41.3	136.1	44.9	127.4	48.9
	7	156.3	38.1	148.7	41.4	140.4	45.1	131.4	49.0
	8	161.1	38.3	153.3	41.6	144.7	45.2	135.5	49.2
	9	166.0	38.5	157.9	41.8	149.2	45.4	139.7	49.4
	10	170.9	38.6	162.7	42.0	153.7	45.6	144.0	49.6
DCC017SX-04AM00	5	171.0	44.4	162.2	48.4	152.7	52.6	142.6	57.3
	6	176.3	44.7	167.2	48.6	157.5	52.9	147.1	57.6
	7	181.6	45.0	172.3	48.9	162.3	53.2	151.6	57.9
	8	187.1	45.2	177.5	49.2	167.2	53.5	156.2	58.2
	9	192.6	45.5	182.8	49.5	172.2	53.8	160.9	58.5
	10	198.2	45.8	188.1	49.8	177.3	54.1	165.7	58.8
DCC021SX-06BS00	5	220.4	56.8	209.5	61.8	197.7	67.2	184.9	73.2
	6	227.3	57.1	216.1	62.0	204.0	67.5	190.8	73.5
	7	234.4	57.3	222.9	62.3	210.4	67.7	196.9	73.7
	8	241.5	57.6	229.7	62.5	216.9	68.0	203.0	74.0
	9	248.8	57.8	236.7	62.8	223.5	68.3	209.2	74.3
	10	256.2	58.1	243.7	63.1	230.2	68.5	215.6	74.6
DCC023SX-04BT00	5	241.4	71.7	227.3	78.0	212.3	84.9	196.4	92.5
	6	248.5	72.3	234.0	78.6	218.6	85.5	202.2	93.1
	7	255.7	72.9	240.8	79.2	224.9	86.1	208.0	93.8
	8	262.9	73.5	247.6	79.8	231.3	86.8	214.0	94.4
	9	270.3	74.1	254.5	80.5	237.8	87.4	220.1	95.1
	10	277.7	74.7	261.5	81.1	244.4	88.1	226.2	95.7
DCC024SX-06BT00	5	255.8	67.6	242.2	73.6	227.7	80.1	212.3	87.2
	6	263.7	68.0	249.7	74.0	234.8	80.5	218.9	87.6
	7	271.6	68.4	257.3	74.4	242.0	80.9	225.6	88.1
	8	279.8	68.9	265.0	74.9	249.3	81.4	232.5	88.5
	9	288.0	69.3	272.9	75.3	256.7	81.8	239.4	89.0
	10	296.3	69.7	280.8	75.8	264.2	82.3	246.5	89.5

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011DX-04ACCO	5	118.4	28.2	112.5	30.9	106.2	33.8	99.7	37.1
	6	122.2	28.4	116.1	31.0	109.7	33.9	102.9	37.2
	7	126.0	28.5	119.8	31.1	113.2	34.1	106.3	37.3
	8	129.9	28.6	123.5	31.3	116.8	34.2	109.7	37.4
	9	133.9	28.8	127.3	31.4	120.4	34.3	113.1	37.5
DCC013DX-04ACDO	10	137.9	28.9	131.2	31.5	124.1	34.4	116.7	37.7
	5	134.1	33.0	127.4	35.9	120.3	39.2	112.7	42.8
	6	138.4	33.1	131.5	36.1	124.2	39.3	116.4	42.9
	7	142.7	33.3	135.7	36.2	128.1	39.5	120.1	43.1
	8	147.1	33.4	139.9	36.4	132.2	39.6	123.9	43.2
DCC014DX-04ADDO	9	151.6	33.6	144.2	36.5	136.2	39.8	127.8	43.4
	10	156.1	33.7	148.5	36.7	140.4	39.9	131.7	43.5
	5	147.6	37.6	140.4	40.9	132.6	44.5	124.1	48.4
	6	152.3	37.8	144.9	41.1	136.8	44.7	128.1	48.6
	7	157.0	37.9	149.4	41.2	141.2	44.8	132.2	48.8
DCC015DX-04ADF0	8	161.8	38.1	154.0	41.4	145.5	45.0	136.3	49.0
	9	166.7	38.3	158.7	41.6	150.0	45.2	140.6	49.2
	10	171.7	38.4	163.5	41.7	154.5	45.4	144.8	49.3
	5	160.2	41.1	152.1	44.7	143.4	48.6	134.0	52.9
	6	165.2	41.3	156.9	44.9	147.9	48.9	138.2	53.2
DCC016DX-04AJJ0	7	170.3	41.6	161.7	45.2	152.5	49.1	142.6	53.4
	8	175.5	41.8	166.7	45.4	157.2	49.3	147.0	53.7
	9	180.7	42.0	171.7	45.6	161.9	49.6	151.5	53.9
	10	186.1	42.2	176.8	45.9	166.7	49.8	156.0	54.2
	5	166.2	42.9	157.4	46.8	148.1	51.1	138.4	55.9
DCC016DX-04AJJ0	6	171.4	43.1	162.5	47.0	153.0	51.4	142.9	56.2
	7	176.8	43.3	167.6	47.3	157.9	51.6	147.6	56.4
	8	182.3	43.5	172.9	47.5	162.9	51.8	152.3	56.6
	9	187.9	43.8	178.2	47.7	167.9	52.1	157.0	56.9
	10	193.5	44.0	183.6	48.0	173.1	52.3	161.9	57.1
DCC018DX-04BJK0	5	191.4	51.3	181.0	56.2	170.1	61.7	158.5	67.7
	6	197.3	51.6	186.7	56.5	175.4	62.0	163.5	68.0
	7	203.3	51.9	192.4	56.9	180.9	62.3	168.6	68.4
	8	209.4	52.3	198.2	57.2	186.4	62.7	173.8	68.7
	9	215.6	52.6	204.1	57.6	191.9	63.0	179.1	69.1
DCC019DX-04AFK0	10	221.8	53.0	210.0	57.9	197.6	63.4	184.4	69.4
	5	197.6	52.3	186.8	57.3	175.4	62.7	163.2	68.6
	6	203.7	52.7	192.6	57.6	180.8	63.1	168.3	69.0
	7	209.8	53.1	198.4	58.0	186.3	63.4	173.5	69.4
	8	216.0	53.4	204.3	58.4	191.9	63.8	178.8	69.8
DCC020DX-06AFK0	9	222.3	53.8	210.4	58.8	197.6	64.2	184.1	70.2
	10	228.8	54.2	216.4	59.2	203.4	64.6	189.5	70.6
	5	206.6	50.6	196.1	55.2	184.9	60.4	173.1	66.0
	6	213.1	50.8	202.3	55.5	190.9	60.6	178.7	66.2
	7	219.8	51.1	208.7	55.7	196.9	60.9	184.4	66.5
DCC021DX-04AKK0	8	226.5	51.3	215.2	56.0	203.1	61.1	190.2	66.8
	9	233.4	51.6	221.7	56.3	209.3	61.4	196.1	67.0
	10	240.4	51.9	228.4	56.6	215.7	61.7	202.1	67.3
	5	220.4	59.9	208.1	65.9	195.1	72.4	181.3	79.7
	6	227.1	60.4	214.4	66.3	201.1	72.9	186.9	80.2
DCC021DX-04AKK0	7	233.8	60.8	220.9	66.8	207.2	73.3	192.7	80.6
	8	240.7	61.3	227.4	67.2	213.3	73.8	198.4	81.1
	9	247.7	61.8	234.0	67.7	219.6	74.3	204.3	81.6
	10	254.7	62.3	240.7	68.2	225.9	74.8	210.3	82.1

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC022DX-06AKK0	5	231.8	57.0	219.7	62.5	207.0	68.6	193.6	75.4
	6	239.1	57.3	226.7	62.8	213.7	68.9	199.9	75.7
	7	246.5	57.6	233.8	63.1	220.4	69.2	206.3	76.0
	8	254.0	57.9	241.0	63.4	227.3	69.5	212.8	76.3
	9	261.7	58.3	248.3	63.8	234.2	69.9	219.3	76.6
	10	269.4	58.6	255.7	64.1	241.3	70.2	226.0	77.0
DCC024DX-06BKLO	5	259.8	67.2	246.2	73.4	231.6	80.2	216.1	87.7
	6	267.9	67.6	253.9	73.8	238.9	80.6	222.9	88.1
	7	276.0	68.0	261.6	74.1	246.3	81.0	229.9	88.5
	8	284.3	68.4	269.5	74.5	253.8	81.4	236.9	88.9
	9	292.8	68.8	277.6	74.9	261.4	81.8	244.1	89.3
	10	301.3	69.2	285.7	75.4	269.1	82.2	251.4	89.7
DCC025DX-08BKLO	5	267.2	66.2	253.8	72.1	239.5	78.7	224.3	86.0
	6	275.6	66.5	261.9	72.4	247.2	79.0	231.5	86.2
	7	284.2	66.8	270.1	72.7	255.0	79.3	239.0	86.5
	8	292.9	67.1	278.5	73.0	263.0	79.6	246.5	86.8
	9	301.7	67.4	286.9	73.3	271.1	79.9	254.2	87.1
	10	310.8	67.7	295.6	73.6	279.3	80.2	261.9	87.5
DCC027DX-06BLL0	5	285.2	77.3	270.3	84.2	254.1	91.7	236.7	99.9
	6	294.0	77.8	278.6	84.6	262.0	92.2	244.1	100.4
	7	302.9	78.2	287.1	85.1	270.0	92.6	251.6	100.9
	8	311.9	78.6	295.6	85.5	278.1	93.1	259.2	101.4
	9	321.0	79.1	304.3	86.0	286.3	93.6	266.9	101.9
	10	330.3	79.6	313.2	86.5	294.7	94.1	274.8	102.4
DCC028DX-08BLL0	5	293.9	75.6	279.5	82.2	263.8	89.4	246.8	97.4
	6	303.2	75.9	288.3	82.5	272.2	89.8	254.7	97.7
	7	312.5	76.3	297.3	82.9	280.7	90.1	262.7	98.1
	8	322.0	76.6	306.4	83.2	289.3	90.5	270.9	98.5
	9	331.7	76.9	315.6	83.5	298.2	90.8	279.3	98.8
	10	341.6	77.3	325.1	83.9	307.1	91.2	287.7	99.2
DCC030DX-06BLM0	5	308.5	84.8	291.8	92.3	273.9	100.4	254.8	109.4
	6	317.8	85.3	300.6	92.8	282.3	101.0	262.6	110.0
	7	327.2	85.9	309.6	93.4	290.7	101.7	270.5	110.7
	8	336.8	86.5	318.7	94.0	299.3	102.3	278.5	111.3
	9	346.5	87.1	328.0	94.7	308.0	102.9	286.7	112.0
	10	356.4	87.7	337.3	95.3	316.8	103.6	295.0	112.6
DCC031DX-08BLM0	5	319.1	82.3	303.0	89.5	285.5	97.3	266.8	106.0
	6	329.0	82.7	312.4	89.9	294.5	97.8	275.3	106.4
	7	339.1	83.1	322.0	90.4	303.6	98.3	283.8	106.9
	8	349.3	83.6	331.8	90.8	312.9	98.7	292.6	107.4
	9	359.7	84.0	341.7	91.3	322.3	99.2	301.4	107.9
	10	370.2	84.5	351.7	91.8	331.8	99.7	310.4	108.4
DCC032DX-06BMM0	5	328.4	92.1	310.3	100.2	291.1	109.0	270.6	118.8
	6	338.1	92.8	319.6	100.9	299.8	109.8	278.7	119.5
	7	348.1	93.5	329.0	101.6	308.6	110.5	286.9	120.3
	8	358.1	94.2	338.5	102.4	317.6	111.3	295.3	121.0
	9	368.3	94.9	348.1	103.1	326.6	112.0	303.8	121.8
	10	378.6	95.6	357.9	103.9	335.8	112.8	312.4	122.6
DCC033DX-08BMM0	5	340.7	88.8	323.2	96.6	304.4	105.1	284.3	114.5
	6	351.1	89.3	333.1	97.2	313.8	105.7	293.2	115.0
	7	361.7	89.9	343.2	97.8	323.4	106.3	302.1	115.6
	8	372.5	90.4	353.5	98.3	333.1	106.9	311.3	116.2
	9	383.5	91.0	363.9	98.9	343.0	107.5	320.6	116.9
	10	394.6	91.5	374.5	99.5	353.0	108.1	330.0	117.5

1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance AC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC036DX-08BMS0	5	384.6	103.7	364.0	112.8	341.9	122.8	318.2	133.8
	6	396.3	104.3	375.2	113.5	352.4	123.5	328.1	134.5
	7	408.2	105.0	386.5	114.2	363.1	124.2	338.1	135.2
	8	420.3	105.6	398.0	114.9	374.0	124.9	348.3	135.9
	9	432.6	106.3	409.6	115.6	385.0	125.7	358.6	136.7
	10	445.0	107.0	421.4	116.3	396.2	126.4	369.1	137.4
DCC038DX-10BMS0	5	394.5	101.4	374.5	110.3	352.9	120.0	329.7	130.6
	6	406.8	101.9	386.2	110.8	364.0	120.5	340.1	131.2
	7	419.2	102.4	398.1	111.4	375.3	121.1	350.8	131.7
	8	431.9	103.0	410.2	111.9	386.8	121.6	361.6	132.3
	9	444.8	103.5	422.5	112.5	398.4	122.2	372.6	132.9
	10	457.8	104.0	435.0	113.0	410.3	122.8	383.8	133.5
DCC039DX-08BSS0	5	421.5	118.2	398.6	128.7	373.9	140.2	347.3	152.8
	6	434.3	118.9	410.7	129.4	385.3	141.0	358.0	153.6
	7	447.2	119.7	423.0	130.2	396.9	141.8	368.8	154.5
	8	460.4	120.4	435.5	131.0	408.6	142.6	379.8	155.3
	9	473.7	121.2	448.1	131.8	420.6	143.4	391.0	156.1
	10	487.2	122.0	460.9	132.6	432.7	144.3	402.4	157.0
DCC042DX-12BSS0	5	441.4	113.7	419.5	123.6	395.8	134.4	370.2	146.4
	6	455.2	114.2	432.8	124.1	408.4	135.0	382.0	146.9
	7	469.2	114.6	446.2	124.6	421.2	135.5	394.1	147.5
	8	483.5	115.1	459.9	125.1	434.2	136.0	406.4	148.0
	9	498.1	115.6	473.8	125.6	447.4	136.6	418.9	148.6
	10	512.8	116.2	487.9	126.1	460.9	137.1	431.6	149.2
DCC043DX-08BST0	5	454.0	130.9	428.1	142.4	400.5	155.1	370.9	169.0
	6	467.2	131.8	440.7	143.4	412.4	156.1	382.1	170.0
	7	480.6	132.8	453.5	144.4	424.4	157.1	393.4	171.0
	8	494.2	133.7	466.4	145.4	436.6	158.1	404.8	172.1
	9	508.1	134.7	479.5	146.4	449.0	159.2	416.4	173.2
	10	522.1	135.7	492.8	147.4	461.5	160.2	428.2	174.3
DCC045DX-12BST0	5	477.4	124.5	452.8	135.4	426.4	147.3	398.0	160.4
	6	492.2	125.1	467.0	136.0	439.8	148.0	410.6	161.1
	7	507.3	125.8	481.4	136.7	453.4	148.7	423.4	161.8
	8	522.6	126.4	495.9	137.4	467.2	149.4	436.4	162.5
	9	538.1	127.1	510.8	138.1	481.3	150.1	449.6	163.3
	10	553.9	127.8	525.8	138.8	495.6	150.9	463.1	164.1
DCC046DX-10BTT0	5	498.2	137.9	470.7	150.1	441.4	163.4	410.1	178.0
	6	512.7	138.9	484.6	151.1	454.5	164.4	422.5	179.0
	7	527.5	139.8	498.7	152.0	467.9	165.4	435.0	180.0
	8	542.6	140.7	513.0	153.0	481.4	166.4	447.8	181.1
	9	558.0	141.7	527.6	154.0	495.2	167.4	460.7	182.1
	10	573.6	142.7	542.4	155.1	509.2	168.5	473.8	183.2
DCC048DX-12BTT0	5	508.2	135.1	481.4	147.0	452.7	160.0	422.0	174.2
	6	523.8	135.9	496.2	147.8	466.7	160.8	435.2	175.1
	7	539.6	136.7	511.3	148.7	481.0	161.7	448.6	175.9
	8	555.7	137.5	526.6	149.5	495.4	162.6	462.1	176.9
	9	572.0	138.4	542.1	150.4	510.1	163.5	475.9	177.8
	10	588.6	139.2	557.9	151.3	525.0	164.4	490.0	178.7
DCC051DX-10BVV0	5	549.6	156.4	518.1	172.8	485.0	191.3	450.0	212.1
	6	565.7	157.4	533.3	174.0	499.3	192.5	463.3	213.4
	7	582.0	158.6	548.8	175.2	513.9	193.8	476.9	214.6
	8	598.5	159.7	564.5	176.4	528.7	195.0	490.8	215.9
	9	615.3	160.9	580.4	177.6	543.7	196.3	504.8	217.3
	10	632.3	162.1	596.5	178.8	558.9	197.6	519.1	218.6

1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011SR-04AK00	5	116.0	26.7	110.5	29.5	104.5	32.6	98.3	36.0
	6	119.7	26.8	114.0	29.6	108.0	32.7	101.5	36.1
	7	123.6	27.0	117.7	29.8	111.4	32.8	104.9	36.2
	8	127.4	27.1	121.4	29.9	115.0	33.0	108.3	36.4
	9	131.3	27.3	125.2	30.1	118.6	33.1	111.7	36.5
	10	135.4	27.5	129.0	30.2	122.3	33.3	115.2	36.7
DCC014SR-04AL00	5	146.5	36.7	139.6	40.1	132.1	43.8	124.1	47.9
	6	151.2	36.9	144.1	40.3	136.4	44.0	128.2	48.1
	7	155.9	37.0	148.7	40.4	140.8	44.2	132.3	48.3
	8	160.8	37.2	153.4	40.6	145.3	44.4	136.5	48.5
	9	165.7	37.4	158.1	40.8	149.8	44.6	140.9	48.7
	10	170.7	37.6	162.9	41.0	154.4	44.8	145.2	48.9
DCC017SR-04AM00	5	171.6	43.6	163.2	47.6	154.3	51.9	144.8	56.7
	6	177.0	43.9	168.4	47.9	159.2	52.2	149.4	57.0
	7	182.5	44.1	173.7	48.2	164.2	52.5	154.2	57.3
	8	188.1	44.4	179.0	48.5	169.3	52.8	159.0	57.6
	9	193.8	44.7	184.5	48.8	174.5	53.2	163.9	58.0
	10	199.6	45.0	190.0	49.1	179.8	53.5	168.9	58.3
DCC021SR-04BS00	5	214.2	58.4	203.6	63.7	192.2	69.5	179.9	75.9
	6	220.9	58.7	210.0	64.0	198.3	69.8	185.7	76.2
	7	227.7	59.1	216.6	64.4	204.6	70.2	191.6	76.6
	8	234.6	59.4	223.2	64.8	210.9	70.6	197.6	77.0
	9	241.7	59.8	230.0	65.2	217.3	71.0	203.7	77.4
	10	248.9	60.2	236.8	65.5	223.9	71.4	209.9	77.8
DCC023SR-04BT00	5	249.1	70.8	236.2	77.1	222.4	83.9	207.0	91.3
	6	256.8	71.3	243.5	77.6	229.3	84.5	213.4	91.8
	7	264.6	71.9	250.9	78.2	236.3	85.1	219.8	92.3
	8	272.6	72.4	258.5	78.8	243.2	85.6	226.3	92.9
	9	280.6	73.0	266.2	79.4	250.3	86.1	232.9	93.4
	10	288.8	73.6	274.0	79.9	257.5	86.7	239.6	94.0
DCC024SR-06BT00	5	256.8	66.4	244.0	72.5	230.3	79.1	215.7	86.4
	6	264.9	66.8	251.7	72.9	237.6	79.5	222.6	86.8
	7	273.1	67.2	259.6	73.4	245.1	80.0	229.7	87.3
	8	281.5	67.7	267.5	73.8	252.7	80.5	236.9	87.8
	9	290.0	68.1	275.7	74.3	260.4	80.9	244.2	88.3
	10	298.6	68.5	283.9	74.7	268.3	81.4	251.6	88.7

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011DR-04ACCO	5	117.1	26.7	111.5	29.4	105.5	32.5	99.2	35.9
	6	120.8	26.8	115.1	29.6	108.9	32.6	102.5	36.0
	7	124.8	27.0	118.8	29.7	112.5	32.8	105.8	36.1
	8	128.5	27.1	122.5	29.9	116.1	32.9	109.3	36.3
	9	132.5	27.3	126.3	30.0	119.7	33.0	112.7	36.4
	10	136.6	27.5	130.2	30.2	123.4	33.2	116.3	36.6
DCC013DR-04ACDO	5	133.2	31.6	126.9	34.7	120.1	38.1	112.8	41.8
	6	137.5	31.8	131.0	34.8	124.0	38.2	116.5	42.0
	7	141.8	31.9	135.1	35.0	128.0	38.4	120.3	42.1
	8	146.2	32.1	139.4	35.2	132.1	38.6	124.2	42.3
	9	150.8	32.3	143.7	35.4	136.2	38.7	128.2	42.5
	10	155.3	32.5	148.1	35.5	140.4	38.9	132.2	42.6
DCC014DR-04ADD0	5	147.1	36.5	140.3	39.9	132.8	43.6	124.8	47.6
	6	151.8	36.7	144.8	40.0	137.2	43.8	128.9	47.8
	7	156.6	36.9	149.4	40.2	141.6	44.0	133.1	48.0
	8	161.5	37.0	154.1	40.4	146.0	44.1	137.3	48.2
	9	166.4	37.2	158.9	40.6	150.6	44.3	141.7	48.4
	10	171.5	37.4	163.7	40.8	155.2	44.5	146.1	48.6
DCC015DR-04ADF0	5	160.3	40.1	152.6	43.8	144.3	47.9	135.4	52.3
	6	165.4	40.4	157.5	44.1	149.0	48.1	139.8	52.5
	7	170.6	40.6	162.4	44.3	153.7	48.3	144.3	52.8
	8	175.9	40.8	167.5	44.6	158.5	48.6	148.9	53.0
	9	181.2	41.1	172.7	44.8	163.5	48.9	153.6	53.3
	10	186.7	41.3	177.9	45.1	168.4	49.1	158.3	53.6
DCC016DR-04AJJ0	5	166.6	42.0	158.3	46.0	149.5	50.4	140.3	55.3
	6	172.0	42.2	163.5	46.3	154.5	50.7	145.0	55.6
	7	177.5	42.5	168.8	46.5	159.6	50.9	149.9	55.8
	8	183.1	42.7	174.2	46.7	164.8	51.2	154.7	56.0
	9	188.8	42.9	179.7	47.0	170.0	51.4	159.8	56.3
	10	194.6	43.2	185.3	47.2	175.4	51.7	164.8	56.6
DCC018DR-04BJK0	5	193.9	50.4	184.2	55.4	173.9	60.9	163.1	67.0
	6	200.1	50.7	190.1	55.7	179.6	61.2	168.4	67.3
	7	206.3	51.1	196.1	56.0	185.3	61.5	173.9	67.6
	8	212.7	51.4	202.2	56.4	191.1	61.9	179.4	67.9
	9	219.1	51.7	208.4	56.7	197.1	62.2	185.1	68.3
	10	225.7	52.1	214.7	57.1	203.1	62.5	190.8	68.6
DCC019DR-04AFK0	5	200.4	51.5	190.3	56.5	179.6	61.9	168.2	67.9
	6	206.7	51.9	196.4	56.8	185.4	62.3	173.7	68.3
	7	213.2	52.2	202.5	57.2	191.2	62.6	179.3	68.7
	8	219.7	52.6	208.8	57.6	197.2	63.0	184.9	69.0
	9	226.3	53.0	215.2	58.0	203.3	63.4	190.7	69.4
	10	233.1	53.4	221.6	58.3	209.5	63.8	196.5	69.8
DCC020DR-06AFK0	5	205.6	48.6	195.5	53.4	184.8	58.7	173.5	64.5
	6	212.2	48.9	201.8	53.7	190.8	59.0	179.2	64.8
	7	218.9	49.2	208.2	54.0	197.0	59.3	185.1	65.1
	8	225.7	49.5	214.8	54.3	203.3	59.6	191.0	65.4
	9	232.6	49.8	221.5	54.6	209.6	59.9	197.1	65.7
	10	239.7	50.1	228.2	54.9	216.1	60.2	203.2	66.0
DCC021DR-04AKK0	5	225.3	59.1	213.8	65.0	201.7	71.6	188.9	78.8
	6	232.3	59.5	220.6	65.4	208.2	72.0	195.1	79.2
	7	239.5	60.0	227.5	65.9	214.8	72.4	201.3	79.7
	8	246.8	60.4	234.5	66.3	221.5	72.8	207.7	80.1
	9	254.3	60.9	241.6	66.8	228.3	73.3	214.1	80.5
	10	261.8	61.3	248.9	67.2	235.2	73.7	220.7	81.0

1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25	30	35	40	Output kW	Input kW	Output kW	Input kW
DCC022DR-06AKK0	5	231.6	55.4	220.1	61.1	208.1	67.4	195.4	74.4
	6	239.0	55.8	227.2	61.4	214.9	67.7	201.8	74.7
	7	246.5	56.1	234.5	61.8	221.8	68.0	208.4	75.0
	8	254.1	56.5	241.8	62.1	228.8	68.4	215.1	75.3
	9	261.9	56.9	249.3	62.5	236.0	68.7	221.9	75.7
	10	269.8	57.2	256.9	62.8	243.2	69.1	228.8	76.0
DCC024DR-04BKL0	5	253.3	70.5	240.0	77.0	225.6	84.1	210.3	91.9
	6	261.2	71.0	247.4	77.5	232.6	84.6	216.9	92.4
	7	269.1	71.5	254.9	77.9	239.7	85.0	223.6	92.9
	8	277.0	72.0	262.5	78.4	247.0	85.6	230.4	93.4
	9	285.1	72.5	270.2	78.9	254.3	86.1	237.3	93.9
	10	293.4	73.0	278.1	79.5	261.7	86.6	244.3	94.5
DCC025DR-06BKLO	5	261.2	65.9	248.3	72.2	234.6	79.2	220.0	86.8
	6	269.4	66.3	256.2	72.6	242.2	79.6	227.2	87.2
	7	277.8	66.7	264.3	73.0	249.9	79.9	234.5	87.6
	8	286.3	67.1	272.5	73.4	257.7	80.4	241.9	88.0
	9	295.0	67.5	280.8	73.8	265.6	80.8	249.5	88.5
	10	303.8	67.9	289.3	74.2	273.7	81.2	257.2	88.9
DCC027DR-04BLL0	5	278.9	81.7	263.9	88.8	247.5	96.4	229.9	104.9
	6	287.5	82.3	271.9	89.3	255.0	97.0	236.9	105.4
	7	296.0	82.8	280.0	89.9	262.6	97.6	244.0	106.0
	8	304.6	83.4	288.1	90.4	270.4	98.1	251.3	106.6
	9	313.4	83.9	296.4	91.0	278.2	98.7	258.6	107.2
	10	322.2	84.5	304.8	91.5	286.1	99.3	266.0	107.8
DCC028DR-06BLL0	5	288.0	76.2	274.1	83.2	259.0	90.8	242.7	99.2
	6	297.0	76.7	282.7	83.6	267.3	91.3	250.6	99.7
	7	306.3	77.1	291.6	84.1	275.7	91.7	258.6	100.2
	8	315.6	77.6	300.6	84.5	284.3	92.2	266.7	100.7
	9	325.1	78.0	309.7	85.0	293.0	92.7	275.0	101.2
	10	334.8	78.5	319.0	85.5	301.9	93.2	283.4	101.7
DCC030DR-06BLMO	5	313.2	83.7	297.8	91.2	281.2	99.5	263.3	108.6
	6	323.0	84.2	307.1	91.8	290.1	100.1	271.7	109.2
	7	333.0	84.8	316.7	92.4	299.1	100.7	280.3	109.8
	8	343.1	85.4	326.3	93.0	308.3	101.3	289.0	110.4
	9	353.4	85.9	336.2	93.6	317.7	101.9	297.9	111.1
	10	363.8	86.5	346.2	94.2	327.2	102.5	306.9	111.7
DCC031DR-08BLMO	5	319.2	80.3	303.9	87.7	287.4	95.8	269.7	104.6
	6	329.3	80.7	313.5	88.2	296.6	96.3	278.4	105.1
	7	339.6	81.2	323.4	88.7	306.0	96.8	287.3	105.6
	8	350.0	81.7	333.4	89.1	315.5	97.3	296.4	106.2
	9	360.6	82.2	343.6	89.6	325.3	97.8	305.6	106.7
	10	371.4	82.6	353.9	90.1	335.1	98.3	315.0	107.2
DCC032DR-06BMM0	5	335.0	91.0	318.3	99.1	300.5	108.1	281.4	117.9
	6	345.4	91.6	328.2	99.8	309.8	108.8	290.2	118.6
	7	355.9	92.3	338.3	100.5	319.4	109.5	299.3	119.3
	8	366.7	93.0	348.5	101.2	329.1	110.2	308.5	120.0
	9	377.6	93.7	358.9	101.9	339.0	110.9	317.8	120.8
	10	388.6	94.4	369.5	102.7	349.1	111.7	327.3	121.5
DCC033DR-08BMM0	5	341.8	87.1	325.2	95.1	307.4	103.8	288.5	113.3
	6	352.5	87.6	335.4	95.7	317.2	104.4	297.7	113.9
	7	363.4	88.2	345.9	96.3	327.2	105.0	307.1	114.5
	8	374.5	88.8	356.5	96.9	337.3	105.6	316.7	115.2
	9	385.8	89.3	367.3	97.5	347.5	106.2	326.5	115.8
	10	397.3	89.9	378.3	98.1	358.0	106.8	336.4	116.5

1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC036DR-06BMS0	5	380.3	107.2	360.2	116.5	338.6	126.7	315.5	138.0
	6	392.0	107.9	371.3	117.3	349.1	127.5	325.3	138.8
	7	403.8	108.7	382.5	118.1	359.7	128.3	335.3	139.6
	8	415.8	109.4	393.9	118.8	370.5	129.1	345.4	140.4
	9	427.9	110.2	405.5	119.6	381.4	129.9	355.7	141.2
	10	440.2	110.9	417.2	120.4	392.5	130.8	366.1	142.1
DCC038DR-10BMS0	5	394.5	99.0	375.4	108.1	354.9	118.1	332.9	129.0
	6	407.0	99.5	387.4	108.7	366.3	118.7	343.7	129.6
	7	419.7	100.1	399.6	109.3	378.0	119.3	354.8	130.3
	8	432.6	100.6	412.0	109.9	389.8	119.9	366.0	130.9
	9	445.8	101.2	424.6	110.4	401.8	120.5	377.4	131.5
	10	459.2	101.8	437.5	111.1	414.1	121.1	389.1	132.1
DCC039DR-06BSS0	5	418.7	122.9	396.0	133.5	371.3	145.0	344.7	157.7
	6	431.5	123.8	407.9	134.3	382.5	145.9	355.2	158.5
	7	444.3	124.6	420.1	135.1	393.9	146.7	365.9	159.4
	8	457.2	125.4	432.3	136.0	405.5	147.6	376.7	160.3
	9	470.4	126.2	444.8	136.8	417.3	148.4	387.7	161.2
	10	483.7	127.0	457.4	137.7	429.2	149.3	398.9	162.1
DCC042DR-10BSS0	5	435.4	112.9	414.4	123.3	391.8	134.7	367.3	147.2
	6	449.1	113.5	427.6	123.9	404.4	135.3	379.2	147.8
	7	463.1	114.1	441.1	124.5	417.2	136.0	391.4	148.5
	8	477.3	114.8	454.7	125.2	430.2	136.6	403.8	149.2
	9	491.8	115.4	468.6	125.8	443.5	137.3	416.3	149.9
	10	506.5	116.1	482.7	126.5	457.0	138.0	429.2	150.6
DCC043DR-08BST0	5	464.4	129.2	440.8	140.7	415.5	153.4	387.8	167.2
	6	478.8	130.1	454.6	141.7	428.6	154.4	399.9	168.1
	7	493.5	131.0	468.6	142.6	441.8	155.3	412.3	169.0
	8	508.4	131.9	482.9	143.6	455.2	156.2	424.8	169.9
	9	523.5	132.8	497.4	144.5	468.8	157.2	437.6	170.9
	10	539.0	133.8	512.0	145.5	482.5	158.1	450.6	171.8
DCC045DR-10BST0	5	472.2	124.6	448.8	136.0	423.6	148.4	396.6	162.1
	6	487.0	125.4	463.0	136.8	437.1	149.2	409.4	162.9
	7	502.1	126.2	477.4	137.6	450.9	150.1	422.4	163.8
	8	517.4	127.0	492.1	138.4	464.8	150.9	435.6	164.6
	9	533.1	127.8	507.0	139.3	479.0	151.8	449.1	165.5
	10	548.9	128.6	522.2	140.1	493.5	152.7	462.7	166.4
DCC046DR-08BTT0	5	495.0	141.3	469.3	153.9	442.0	167.6	411.7	182.4
	6	510.2	142.4	483.9	155.0	455.8	168.8	424.3	183.4
	7	525.7	143.5	498.6	156.1	469.7	169.9	437.1	184.4
	8	541.4	144.6	513.7	157.3	483.6	170.9	450.0	185.5
	9	557.4	145.7	528.9	158.4	497.6	172.0	463.2	186.6
	10	573.7	146.8	544.4	159.6	511.8	173.1	476.5	187.7
DCC048DR-10BTT0	5	503.8	136.1	478.4	148.5	451.1	161.9	422.1	176.7
	6	519.5	137.1	493.3	149.4	465.4	162.9	435.6	177.7
	7	535.4	138.0	508.6	150.4	479.9	163.9	449.2	178.8
	8	551.7	139.0	524.1	151.4	494.6	164.9	463.1	179.8
	9	568.2	140.0	539.8	152.4	509.5	166.0	477.3	180.9
	10	584.9	140.9	555.8	153.5	524.8	167.1	491.6	181.9
DCC051DR-08BVV0	5	551.6	160.9	520.3	177.2	487.4	195.5	452.6	216.1
	6	567.7	162.0	535.6	178.3	501.8	196.7	466.0	217.3
	7	584.1	163.1	551.1	179.5	516.5	197.9	479.7	218.6
	8	600.7	164.3	566.9	180.7	531.3	199.1	493.6	219.9
	9	617.6	165.4	582.9	181.9	546.4	200.4	507.8	221.2
	10	634.7	166.6	599.1	183.1	561.7	201.7	522.1	222.5

1 Output kW refers to the chilled water duty.
 2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011SX-04AK00	5	116.1	26.7	110.2	29.4	104.0	32.5	97.4	35.8
	6	119.8	26.9	113.7	29.6	107.3	32.6	100.6	35.9
	7	123.5	27.0	117.3	29.7	110.8	32.7	103.8	36.1
	8	127.3	27.1	120.9	29.8	114.2	32.8	107.1	36.2
	9	131.2	27.3	124.7	30.0	117.8	33.0	110.5	36.3
DCC014SX-04AL00	10	135.1	27.5	128.4	30.1	121.4	33.1	113.9	36.4
	5	145.2	36.5	137.8	39.9	129.8	43.6	121.2	47.6
	6	149.7	36.7	142.1	40.1	133.9	43.8	125.1	47.8
	7	154.3	36.9	146.5	40.3	138.1	44.0	129.0	48.0
	8	159.0	37.1	151.0	40.5	142.4	44.2	133.0	48.2
DCC017SX-04AM00	9	163.8	37.3	155.6	40.7	146.7	44.4	137.1	48.5
	10	168.6	37.5	160.2	40.9	151.0	44.6	141.2	48.7
	5	168.4	43.5	159.5	47.5	149.9	51.8	139.7	56.5
	6	173.6	43.8	164.4	47.8	154.5	52.1	144.0	56.9
	7	178.8	44.1	169.3	48.1	159.2	52.4	148.4	57.2
DCC021SX-06BS00	8	184.1	44.4	174.4	48.4	163.9	52.8	152.8	57.5
	9	189.5	44.7	179.5	48.7	168.8	53.1	157.4	57.9
	10	194.9	45.0	184.7	49.1	173.7	53.4	161.9	58.2
	5	217.7	54.9	206.6	60.0	194.6	65.5	181.6	71.6
	6	224.5	55.2	213.1	60.2	200.7	65.8	187.4	71.9
DCC023SX-04BT00	7	231.4	55.5	219.7	60.5	206.9	66.1	193.2	72.2
	8	238.4	55.7	226.3	60.8	213.3	66.4	199.2	72.5
	9	245.5	56.0	233.1	61.1	219.7	66.7	205.3	72.8
	10	252.7	56.3	240.0	61.4	226.2	67.0	211.4	73.2
	5	235.6	72.2	221.3	78.7	206.1	85.7	189.9	93.6
DCC024SX-06BT00	6	242.4	72.8	227.7	79.3	212.0	86.4	195.4	94.2
	7	249.3	73.5	234.1	80.0	218.0	87.1	200.9	94.9
	8	256.2	74.2	240.6	80.7	224.1	87.8	206.6	95.7
	9	263.2	74.9	247.2	81.4	230.2	88.6	212.3	96.4
	10	270.3	75.6	253.9	82.1	236.5	89.3	218.1	97.1
DCC024SX-06BT00	5	251.9	66.2	238.1	72.3	223.4	78.9	207.8	86.1
	6	259.5	66.7	245.4	72.7	230.3	79.4	214.2	86.6
	7	267.3	67.1	252.8	73.2	237.2	79.8	220.7	87.1
	8	275.2	67.6	260.2	73.7	244.3	80.3	227.3	87.6
	9	283.2	68.0	267.8	74.2	251.4	80.9	234.0	88.2
	10	291.3	68.5	275.5	74.7	258.7	81.4	240.8	88.7

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC011DX-04ACCO	5	117.2	26.7	111.2	29.4	104.9	32.4	98.3	35.7
	6	120.9	26.8	114.8	29.5	108.3	32.5	101.5	35.8
	7	124.7	27.0	118.4	29.6	111.8	32.6	104.8	35.9
	8	128.5	27.1	122.1	29.8	115.3	32.8	108.1	36.1
	9	132.4	27.3	125.8	29.9	118.8	32.9	111.5	36.2
	10	136.4	27.4	129.6	30.1	122.5	33.0	114.9	36.3
DCC013DX-04ACDO	5	132.6	31.5	125.8	34.6	118.6	37.9	110.9	41.6
	6	136.7	31.7	129.8	34.7	122.4	38.0	114.5	41.7
	7	141.0	31.9	133.9	34.9	126.3	38.2	118.1	41.9
	8	145.3	32.0	138.0	35.1	130.2	38.4	121.8	42.1
	9	149.7	32.2	142.2	35.2	134.2	38.6	125.6	42.2
	10	154.1	32.4	146.4	35.4	138.2	38.7	129.4	42.4
DCC014DX-04ADDO	5	145.8	36.3	138.5	39.7	130.5	43.3	122.0	47.4
	6	150.4	36.5	142.9	39.9	134.7	43.5	125.8	47.6
	7	155.0	36.7	147.3	40.1	138.9	43.7	129.8	47.8
	8	159.7	36.9	151.8	40.2	143.1	43.9	133.8	48.0
	9	164.5	37.1	156.4	40.4	147.5	44.1	137.9	48.2
	10	169.4	37.3	161.0	40.6	151.9	44.3	142.1	48.4
DCC015DX-04ADF0	5	158.0	40.0	149.8	43.7	140.9	47.7	131.4	52.1
	6	162.9	40.2	154.4	43.9	145.3	47.9	135.5	52.3
	7	167.9	40.5	159.2	44.2	149.8	48.2	139.7	52.6
	8	172.9	40.7	164.0	44.4	154.3	48.5	144.0	52.9
	9	178.0	41.0	168.8	44.7	158.9	48.7	148.3	53.2
	10	183.2	41.2	173.8	45.0	163.6	49.0	152.7	53.4
DCC016DX-04AJJ0	5	163.7	41.9	154.8	45.9	145.5	50.3	135.6	55.2
	6	168.8	42.1	159.8	46.2	150.2	50.6	140.0	55.5
	7	174.1	42.4	164.8	46.4	154.9	50.8	144.5	55.7
	8	179.4	42.6	169.9	46.7	159.8	51.1	149.1	56.0
	9	184.9	42.9	175.1	46.9	164.7	51.4	153.7	56.3
	10	190.4	43.1	180.3	47.2	169.7	51.7	158.3	56.6
DCC018DX-04BJK0	5	188.0	50.8	177.5	55.9	166.4	61.5	154.7	67.7
	6	193.7	51.2	182.9	56.2	171.6	61.8	159.5	68.0
	7	199.5	51.5	188.5	56.6	176.8	62.2	164.4	68.4
	8	205.4	51.9	194.1	57.0	182.1	62.6	169.4	68.8
	9	211.4	52.3	199.8	57.4	187.5	63.0	174.5	69.2
	10	217.5	52.7	205.5	57.8	192.9	63.4	179.6	69.6
DCC019DX-04AFK0	5	193.9	51.9	183.0	57.0	171.4	62.5	159.2	68.6
	6	199.8	52.3	188.6	57.4	176.7	62.9	164.1	69.1
	7	205.8	52.7	194.2	57.8	182.0	63.4	169.0	69.5
	8	211.8	53.1	199.9	58.2	187.4	63.8	174.1	69.9
	9	217.9	53.6	205.7	58.7	192.8	64.2	179.2	70.4
	10	224.1	54.0	211.6	59.1	198.4	64.7	184.4	70.8
DCC020DX-06AFK0	5	204.1	48.5	193.5	53.3	182.2	58.5	170.2	64.2
	6	210.5	48.8	199.6	53.6	188.0	58.8	175.7	64.5
	7	217.0	49.1	205.8	53.9	193.9	59.1	181.3	64.8
	8	223.6	49.4	212.1	54.1	199.9	59.4	186.9	65.1
	9	230.3	49.7	218.5	54.4	206.0	59.7	192.7	65.4
	10	237.2	50.0	225.1	54.8	212.2	60.0	198.5	65.7
DCC021DX-04AKK0	5	215.8	60.0	203.3	66.1	190.2	72.9	176.3	80.4
	6	222.3	60.5	209.4	66.6	195.9	73.4	181.6	80.9
	7	228.8	61.0	215.6	67.1	201.8	73.9	187.1	81.4
	8	235.4	61.5	221.9	67.7	207.7	74.5	192.6	81.9
	9	242.1	62.1	228.3	68.2	213.7	75.0	198.2	82.5
	10	248.9	62.6	234.7	68.8	219.7	75.6	203.9	83.1

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC022DX-06AKKO	5	228.6	55.2	216.5	60.9	203.6	67.2	190.1	74.1
	6	235.8	55.6	223.3	61.2	210.1	67.5	196.2	74.5
	7	243.0	55.9	230.2	61.6	216.7	67.8	202.4	74.8
	8	250.4	56.3	237.2	61.9	223.3	68.2	208.7	75.1
	9	257.8	56.7	244.3	62.3	230.1	68.6	215.1	75.5
	10	265.4	57.1	251.6	62.7	237.0	68.9	221.6	75.9
DCC024DX-06BKL0	5	255.8	65.9	241.9	72.2	227.2	79.2	211.4	86.9
	6	263.6	66.3	249.4	72.6	234.2	79.6	218.1	87.3
	7	271.6	66.7	257.0	73.1	241.4	80.0	224.8	87.7
	8	279.7	67.1	264.6	73.5	248.6	80.5	231.6	88.2
	9	287.8	67.6	272.4	73.9	256.0	80.9	238.5	88.7
	10	296.1	68.1	280.3	74.4	263.5	81.4	245.6	89.1
DCC025DX-08BKL0	5	264.1	63.4	250.6	69.4	236.1	76.1	220.7	83.5
	6	272.4	63.7	258.5	69.7	243.6	76.4	227.8	83.8
	7	280.8	64.0	266.5	70.1	251.3	76.8	235.0	84.2
	8	289.3	64.3	274.7	70.4	259.1	77.1	242.3	84.5
	9	298.0	64.7	283.0	70.7	266.9	77.4	249.8	84.9
	10	306.8	65.0	291.4	71.1	275.0	77.8	257.4	85.2
DCC027DX-06BLL0	5	280.5	76.4	265.2	83.4	248.7	91.1	231.0	99.5
	6	288.9	76.9	273.2	83.9	256.3	91.6	238.1	100.1
	7	297.6	77.4	281.4	84.4	264.0	92.1	245.4	100.6
	8	306.3	77.9	289.7	84.9	271.8	92.7	252.7	101.2
	9	315.2	78.4	298.1	85.5	279.8	93.2	260.1	101.7
	10	324.1	78.9	306.6	86.0	287.8	93.8	267.7	102.3
DCC028DX-08BLL0	5	290.3	73.1	275.6	79.8	259.6	87.1	242.4	95.2
	6	299.4	73.4	284.2	80.1	267.8	87.5	250.1	95.6
	7	308.5	73.8	293.0	80.5	276.1	87.9	257.9	96.1
	8	317.9	74.2	301.9	80.9	284.6	88.3	265.9	96.5
	9	327.3	74.5	310.9	81.3	293.2	88.7	274.0	96.9
	10	337.0	74.9	320.1	81.7	301.9	89.1	282.2	97.3
DCC030DX-06BLMO	5	302.7	84.2	285.7	91.9	267.5	100.3	248.1	109.5
	6	311.7	84.9	294.2	92.6	275.5	101.0	255.6	110.2
	7	320.8	85.5	302.9	93.2	283.7	101.6	263.2	110.9
	8	330.1	86.2	311.6	93.9	291.9	102.3	270.9	111.6
	9	339.4	86.8	320.5	94.6	300.2	103.0	278.7	112.3
	10	348.9	87.5	329.5	95.3	308.7	103.8	286.6	113.0
DCC031DX-08BLMO	5	314.7	80.0	298.3	87.4	280.6	95.4	261.7	104.2
	6	324.4	80.5	307.5	87.9	289.3	95.9	269.9	104.7
	7	334.2	81.0	316.9	88.4	298.2	96.4	278.2	105.3
	8	344.2	81.5	326.4	88.9	307.2	97.0	286.6	105.8
	9	354.3	82.0	336.0	89.4	316.3	97.5	295.2	106.4
	10	364.6	82.5	345.8	89.9	325.6	98.0	303.9	106.9
DCC032DX-06BMM0	5	321.7	91.9	303.4	100.2	283.8	109.3	263.0	119.3
	6	331.1	92.7	312.2	101.0	292.1	110.1	270.7	120.1
	7	340.7	93.5	321.3	101.8	300.6	110.9	278.6	121.0
	8	350.3	94.3	330.4	102.6	309.2	111.8	286.6	121.8
	9	360.1	95.1	339.6	103.5	317.8	112.6	294.7	122.7
	10	370.0	95.9	349.0	104.3	326.6	113.5	302.8	123.6
DCC033DX-08BMM0	5	335.6	86.9	317.8	94.8	298.8	103.5	278.5	113.0
	6	345.8	87.5	327.5	95.5	307.9	104.1	287.0	113.7
	7	356.2	88.1	337.3	96.1	317.2	104.8	295.7	114.3
	8	366.7	88.7	347.3	96.7	326.6	105.4	304.5	115.0
	9	377.3	89.3	357.4	97.4	336.2	106.1	313.5	115.7
	10	388.1	89.9	367.7	98.0	345.9	106.8	322.6	116.4

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Cooling Performance EC Fans Extra Quiet

Model	Vorlauftemperatur °C	Ambient (°C)							
		25		30		35		40	
Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCC036DX-08BMS0	5	377.8	102.5	356.9	111.9	334.4	122.1	310.4	133.3
	6	389.2	103.2	367.7	112.6	344.6	122.9	319.9	134.1
	7	400.8	103.9	378.6	113.4	354.9	123.6	329.6	134.9
	8	412.5	104.7	389.7	114.1	365.3	124.4	339.3	135.7
	9	424.3	105.4	400.9	114.9	375.9	125.2	349.2	136.5
	10	436.3	106.2	412.3	115.7	386.7	126.1	359.3	137.4
DCC038DX-10BMS0	5	389.1	98.6	368.7	107.6	346.8	117.5	323.3	128.3
	6	401.1	99.1	380.2	108.2	357.6	118.1	333.5	128.9
	7	413.3	99.7	391.8	108.8	368.6	118.7	343.8	129.6
	8	425.6	100.3	403.6	109.4	379.8	119.3	354.3	130.2
	9	438.2	100.9	415.5	110.0	391.1	120.0	364.9	130.9
	10	450.9	101.5	427.6	110.7	402.6	120.6	375.7	131.6
DCC039DX-08BSS0	5	413.4	117.7	389.9	128.5	364.8	140.3	337.8	153.2
	6	425.7	118.6	401.6	129.4	375.7	141.2	348.0	154.1
	7	438.2	119.4	413.4	130.2	386.9	142.1	358.4	155.1
	8	450.9	120.3	425.4	131.1	398.1	143.0	368.9	156.0
	9	463.7	121.1	437.6	132.0	409.6	143.9	379.6	156.9
	10	476.7	122.0	449.9	133.0	421.1	144.9	390.4	157.9
DCC042DX-12BSS0	5	435.9	109.8	413.7	119.9	389.6	131.0	363.6	143.2
	6	449.5	110.4	426.6	120.5	401.8	131.6	375.1	143.8
	7	463.2	110.9	439.8	121.1	414.3	132.2	386.9	144.4
	8	477.2	111.5	453.1	121.7	427.0	132.8	398.8	145.1
	9	491.4	112.1	466.7	122.3	439.9	133.4	411.0	145.7
	10	505.9	112.7	480.5	122.9	453.0	134.1	423.3	146.3
DCC043DX-08BST0	5	443.1	131.1	417.0	142.9	389.1	155.9	359.3	170.2
	6	456.1	132.1	429.2	144.0	400.5	157.0	369.9	171.3
	7	469.3	133.2	441.6	145.1	412.1	158.2	380.7	172.5
	8	482.6	134.3	454.2	146.3	423.9	159.4	391.7	173.7
	9	496.0	135.5	466.9	147.4	435.8	160.5	402.7	174.9
	10	509.6	136.6	479.7	148.6	447.8	161.8	413.9	176.1
DCC045DX-12BST0	5	470.8	121.1	445.8	132.3	418.9	144.4	390.1	157.8
	6	485.2	121.9	459.5	133.0	431.9	145.2	402.4	158.5
	7	499.9	122.6	473.5	133.8	445.2	146.0	414.8	159.4
	8	514.8	123.3	487.7	134.5	458.6	146.8	427.4	160.2
	9	530.0	124.1	502.1	135.3	472.2	147.6	440.2	161.0
	10	545.4	124.9	516.8	136.1	486.1	148.4	453.2	161.9
DCC046DX-10BTTO	5	487.7	136.7	460.0	149.1	430.5	162.7	399.0	177.7
	6	502.2	137.8	473.7	150.2	443.4	163.8	411.0	178.8
	7	516.9	138.8	487.6	151.3	456.4	165.0	423.2	180.0
	8	531.8	139.9	501.7	152.5	469.6	166.1	435.5	181.2
	9	546.9	141.0	516.0	153.6	483.0	167.3	448.0	182.4
	10	562.2	142.1	530.4	154.8	496.6	168.5	460.7	183.6
DCC048DX-12BTTO	5	500.5	132.2	473.3	144.4	444.2	157.6	413.2	172.1
	6	515.6	133.1	487.7	145.3	457.8	158.5	425.9	173.1
	7	531.1	134.0	502.3	146.2	471.6	159.5	438.8	174.1
	8	546.7	134.9	517.2	147.2	485.6	160.5	451.9	175.1
	9	562.6	135.9	532.2	148.2	499.8	161.5	465.2	176.1
	10	578.7	136.8	547.5	149.1	514.2	162.5	478.7	177.1
DCC051DX-10BVV0	5	537.8	157.2	505.9	174.3	472.4	193.4	436.8	214.9
	6	553.3	158.4	520.5	175.6	486.1	194.8	449.6	216.4
	7	568.9	159.7	535.4	176.9	500.0	196.2	462.5	217.8
	8	584.9	161.0	550.4	178.3	514.1	197.7	475.7	219.3
	9	601.0	162.4	565.7	179.7	528.5	199.1	489.0	220.8
	10	617.3	163.7	581.1	181.1	543.0	200.6	502.6	222.4

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Data Regular Quiet

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC011SR-04AK00 1 No Yes	DCC014SR-04AL00 1 No Yes	DCC017SR-04AM00 1 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	111.4 32.8 3.39 4.52 4.40 N/A N/A	140.8 44.2 3.19 4.24 4.13 N/A N/A	164.2 52.5 3.13 4.19 4.08 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	113.1 35.0 3.2 4.03 3.95 N/A N/A	143.2 45.9 3.1 3.87 3.80 N/A N/A	166.2 53.6 3.1 3.88 3.80 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	55-100 0.53	55-100 0.53	55-100 0.54
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3)	kg kg	1530 1555	1640 1670	1675 1705
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	8.6 7.3	11.0 9.2	13.2 10.7
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m ² m ³ /s m ³ /s m ³ /s	8.40 N/A 23.8 22.2	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	4 800 N/A 1032 908	Sickle Bladed Fan 4 800 N/A 1032 908	4 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Tandem 2 2 x 6.7	Tandem 2 2 x 6.7 Polyol Ester	Tandem 2 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	45	Electronic Expansion Valve (EEV) R410A 46	47
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1015 10	1298 10	1525 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC021SR-04BS00 1 No Yes	DCC023SR-04BT00 1 No Yes	DCC024SR-06BT00 1 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	204.6 70.2 2.91 4.26 4.11 N/A N/A	236.3 85.1 2.78 4.16 4.01 N/A N/A	245.1 80.0 3.06 4.40 4.25 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	204.5 70.2 2.9 3.97 3.86 N/A N/A	233.6 84.4 2.8 4.08 3.81 N/A N/A	248.0 81.5 3.0 4.01 3.91 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	40-70-100 0.38	40-75-100 0.39	35-70-100 0.37
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2415 x 2200 x 3690
Mass Machine Operating	3)	kg kg	1860 1900	1925 1965	2405 2455
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	20.3 13.1	Brazed Plate Class 1 25.7 14.2	25.7 15.9
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	8.40 N/A 23.8 22.2	Copper Tube & Aluminium Fin 8.40 N/A 23.8 22.2	12.60 N/A 35.7 33.3
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	4 800 N/A 1032 908	Sickle Bladed Fan 4 800 N/A 1032 908	6 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Trio 3 3 x 6.7	Trio 3 3 x 7.2 Polyol Ester	Trio 3 3 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	47	47 58	71
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1319 10	1557 10	1550 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC011DR-04ACC0 2 No Yes	DCC013DR-04ACD0 2 No Yes	DCC014DR-04ADD0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	112.5 32.8 3.43 4.38 4.28 N/A N/A	128.0 38.4 3.33 4.44 4.32 N/A N/A	141.6 44.0 3.22 4.03 3.94 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	114.1 34.9 3.3 4.10 4.01 N/A N/A	130.1 40.3 3.2 4.17 4.07 N/A N/A	144.0 45.7 3.2 3.89 3.81 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	50-100 0.50	45-100 0.45	50-100 0.50
Dimensions (H x W x L)		Mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3)	Kg Kg	1555 1580	1610 1635	1655 1685
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		L l/s	9.2 7.4	Brazed Plate Class 1 11.2 8.4	11.2 9.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s M³/s M³/s	8.40 N/A 23.8 22.2	Copper Tube & Aluminium Fin 8.40 N/A 23.8 22.2	8.40 N/A 23.8 22.2
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	4 800 N/A 1032 908	Sickle Bladed Fan 4 800 N/A 1032 908	4 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Single + Single 2 1 x 6.7 + 1 x 6.7	Single + Single 2 1 x 6.7 + 1 x 6.7 Polyol Ester	Single + Single 2 1 x 6.7 + 1 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	25 + 25	Electronic Expansion Valve (EEV) R410A 25 + 25	25 + 25
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	971 10	989 10	1225 10

- (1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.
All performance data is supplied in accordance with BS EN 14511-1:2013
- (2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),
- (3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.
- (4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**
- (5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC015DR-04ADF0 2 No Yes	DCC016DR-04AJJ0 2 No Yes	DCC018DR-04BJK0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	153.7 48.3 3.18 4.08 3.99 N/A N/A	159.6 50.9 3.14 4.40 4.26 N/A N/A	185.3 61.5 3.01 4.38 4.23 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	155.9 49.7 3.1 3.95 3.86 N/A N/A	161.6 52.0 3.1 4.05 3.95 N/A N/A	186.0 61.9 3.0 4.08 3.97 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	45-100 0.47	25-55-75-100 0.27	25-55-75-100 0.23
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3)	kg kg	1675 1710	1820 1850	1850 1885
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	13.2 10.0	Brazed Plate Class 1 13.2 10.4	18.0 11.9
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	8.40 N/A 23.8 22.2	Copper Tube & Aluminium Fin 8.40 N/A 23.8 22.2	8.40 N/A 23.8 22.2
Sickle Bladed Fan Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	4 800 N/A 1032 908	Sickle Bladed Fan 4 800 N/A 1032 908	4 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Single + Single 2 1 x 6.7 + 1 x 7.2	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	25 + 26	Electronic Expansion Valve (EEV) R410A 25 + 26	27 + 27
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1242 10	741 10	742 10

- (1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.
All performance data is supplied in accordance with BS EN 14511-1:2013
- (2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),
- (3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.
- (4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**
- (5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits			DCC019DR-04AFK0	DCC020DR-06AFK0	DCC021DR-04AKK0
Free Cool Enabled			2 No Yes	2 No Yes	2 No Yes
Enhance Capital Allowance listed					
Cooling Duty - High Airflow EC Fans	1)	kW	N/A	N/A	N/A
Nominal Output - Mechanical	2)	kW	N/A	N/A	N/A
Nominal Input - Mechanical			N/A	N/A	N/A
EER			N/A	N/A	N/A
ESEER			N/A	N/A	N/A
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - EC Fans	1)	kW	191.2	197.0	214.8
Nominal Output - Mechanical	2)	kW	62.6	59.3	72.4
Nominal Input - Mechanical			3.05	3.32	2.97
EER			4.07	4.37	4.29
ESEER			3.96	4.27	4.15
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - AC Fans		kW	191.8	200.0	213.9
Nominal Output - Mechanical		kW	63.0	62.0	72.1
Nominal Input - Mechanical			3.0	3.2	3.0
EER			3.98	4.08	4.08
ESEER			3.88	3.99	3.96
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling		kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Capacity Steps		%	45-75-100	45-75-100	30-55-80-100
Minimum Turndown Ratio			0.44	0.44	0.28
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2415 x 2200 x 3690	2405 x 2200 x 2554
Mass					
Machine	3)	kg	1790	2275	1860
Operating		kg	1825	2315	1895
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator			Brazed Plate Class 1		
Insulation					
Water Volume (Total Internal)		l	18.8	18.8	18.8
Total Maximum Water flow		l/s	11.6	12.9	13.0
Condenser		m²	Copper Tube & Aluminium Fin		
Face Area (Total)			8.40	12.60	8.40
Nominal Airflow - High Airflow EC Fans		m³/s	N/A	N/A	N/A
Nominal Airflow - EC Fans		m³/s	23.8	35.7	23.8
Nominal Airflow - AC Fans		m³/s	22.2	33.3	22.2
Sickle Bladed Fan			Sickle Bladed Fan		
Quantity			4	6	4
Diameter		mm	800	800	800
Maximum Speed - High Airflow EC Fans			N/A	N/A	N/A
Maximum Speed - EC Fans		rpm	1032	1032	1032
Maximum Speed - AC Fans		rpm	908	908	908
Compressor			Single + Tandem 3 1 x 7.2 + 2 x 6.7		
Quantity of Compressors		l		Single + Tandem 3 1 x 7.2 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Oil Charge Volume (Total)					
Oil Type				Polyol Ester	
Refrigeration			Electronic Expansion Valve (EEV) R410A		
Refrigerant Control				38 + 38	26 + 27
Refrigerant Precharged					
Charge (Total)		kg	26 + 27		
Connections			Grooved Terminations		
Water Inlet / Outlet - Unit			DN80	DN80	DN80
Water Drain / Bleed - Evap		inch	1/2	1/2	1/2
Water System					
Minimum System Water Volume	4)	l	1453	1488	1024
Maximum System Operating Pressure		Bar	10	10	10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC022DR-06AKK0 2 No Yes	DCC024DR-04BKL0 2 No Yes	DCC025DR-06BKL0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	221.8 68.0 3.26 4.57 4.43 N/A N/A	239.7 85.0 2.82 4.21 4.06 N/A N/A	249.9 79.9 3.13 4.50 4.35 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	225.1 70.1 3.2 4.17 4.07 N/A N/A	237.6 84.8 2.8 4.04 3.91 N/A N/A	252.4 81.3 3.1 4.14 4.03 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	25-55-75-100 0.27	25-55-75-100 0.25	25-55-75-100 0.24
Dimensions (H x W x L)		mm	2415 x 2200 x 3690	2405 x 2200 x 2554	2415 x 2200 x 3690
Mass Machine Operating	3)	kg kg	2345 2390	2005 2060	2490 2555
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	18.8 14.4	26.1 14.4	26.1 16.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	12.60 N/A 35.7 33.3	Copper Tube & Aluminium Fin	
Sickle Bladed Fan Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	6 800 N/A 1032 908	4 800 N/A 1032 908	6 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	38 + 38	Electronic Expansion Valve (EEV) R410A	
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	28 + 30 DN100 1/2	40 + 42 DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1021 10	1029 10	1027 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC027DR-04BLL0 2 No Yes	DCC028DR-06BLL0 2 No Yes	DCC030DR-06BLM0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	262.6 97.6 2.69 3.94 3.80 N/A N/A	275.7 91.7 3.00 4.23 4.10 N/A N/A	299.1 100.7 2.97 4.23 4.10 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	259.3 97.3 2.7 3.83 3.71 N/A N/A	277.4 92.4 3.0 3.96 3.86 N/A N/A	299.6 100.9 3.0 3.98 3.88 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	30-60-80-100 0.29	25-55-75-100 0.27	25-55-75-100 0.26
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2415 x 2200 x 3690	2415 x 2200 x 3690
Mass Machine Operating	3)	kg kg	2105 2160	2600 2665	2645 2715
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow			26.1 15.7	26.1 17.8	30.6 18.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	8.40 N/A 23.8 22.2	Copper Tube & Aluminium Fin	
Sickle Bladed Fan Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	4 800 N/A 1032 908	6 800 N/A 1032 908	6 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	29 + 30	40 + 42	41 + 43
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1284 10	1295 10	1312 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

			DCC031DR-08BLM0	DCC032DR-06BMM0	DCC033DR-08BMM0
Number of Refrigeration Circuits			2	2	2
Free Cool Enabled			No	No	No
Enhance Capital Allowance listed			Yes	Yes	Yes
Cooling Duty - High Airflow EC Fans	1)	kW	N/A	N/A	N/A
Nominal Output - Mechanical		kW	N/A	N/A	N/A
Nominal Input - Mechanical	2)		N/A	N/A	N/A
EER			N/A	N/A	N/A
ESEER			N/A	N/A	N/A
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - EC Fans	1)	kW	306.0	319.4	327.2
Nominal Output - Mechanical		kW	96.8	109.5	105.0
Nominal Input - Mechanical	2)		3.16	2.92	3.12
EER			4.40	4.14	4.33
ESEER			4.27	4.01	4.20
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - AC Fans		kW	310.4	318.7	331.1
Nominal Output - Mechanical		kW	99.5	109.2	107.1
Nominal Input - Mechanical			3.1	2.9	3.1
EER			4.04	3.94	4.01
ESEER			3.94	3.83	3.91
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling		kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Capacity Steps		%	25-55-75-100	30-55-80-100	25-55-75-100
Minimum Turndown Ratio			0.25	0.28	0.27
Dimensions (H x W x L)		mm	2415 x 2200 x 4820	2415 x 2200 x 3690	2415 x 2200 x 4820
Mass					
Machine	3)	kg	3070	2670	3100
Operating		kg	3160	2740	3175
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator			Brazed Plate		
Insulation			Class 1		
Water Volume (Total Internal)		l	30.6	30.6	30.6
Total Maximum Water flow		l/s	19.9	19.3	21.2
Condenser			Copper Tube & Aluminium Fin		
Face Area (Total)		m²	16.80	12.60	16.80
Nominal Airflow - High Airflow EC Fans			N/A	N/A	N/A
Nominal Airflow - EC Fans		m³/s	47.6	35.7	47.6
Nominal Airflow - AC Fans		m³/s	44.3	33.3	44.3
Condenser Fan & Motor			Sickle Bladed Fan		
Quantity			8	6	8
Diameter		mm	800	800	800
Maximum Speed - High Airflow EC Fans		rpm	N/A	N/A	N/A
Maximum Speed - EC Fans		rpm	1032	1032	1032
Maximum Speed - AC Fans		rpm	908	908	908
Compressor			Tandem + Tandem		
Quantity of Compressors		l	4	4	4
Oil Charge Volume (Total)			2 x 6.7 + 2 x 7.2	2 x 7.2 + 2 x 7.2	2 x 7.2 + 2 x 7.2
Oil Type			Polyol Ester		
Refrigeration			Electronic Expansion Valve (EEV)		
Refrigerant Control			R410A		
Refrigerant Precharged			42 + 43		
Charge (Total)		kg	52 + 54		52 + 54
Connections			Grooved Terminations		
Water Inlet / Outlet - Unit			DN100		
Water Drain / Bleed - Evap		inch	1/2	DN100	DN100
Water System				1/2	1/2
Minimum System Water Volume	4)	l	1306	1527	1522
Maximum System Operating Pressure		Bar	10	10	10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC036DR-06BMS0 2 No Yes	DCC038DR-10BMS0 2 No Yes	DCC039DR-06BSS0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	359.7 128.3 2.80 4.18 4.03 N/A N/A	378.0 119.3 3.17 4.50 4.35 N/A N/A	393.9 146.7 2.69 4.15 3.99 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	356.7 127.9 2.8 3.97 3.85 N/A N/A	383.5 122.8 3.1 4.09 3.99 N/A N/A	388.8 146.3 2.7 3.97 3.83 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	25-45-65-85-100 0.25	25-45-65-85-100 0.24	20-40-55-75-85-100 0.20
Dimensions (H x W x L)		mm	2415 x 2200 x 3690	2415 x 2200 x 5956	2415 x 2200 x 3690
Mass Machine Operating	3)	kg kg	2875 2960	3765 3880	3030 3115
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	43.2 21.6	43.2 24.6	43.2 23.6
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	12.60 N/A 35.7 33.3	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	6 800 N/A 1032 908	Sickle Bladed Fan 10 800 N/A 1032 908	6 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Tandem + Trio 5 2 x 7.2 + 3 x 6.7	Tandem + Trio 5 2 x 7.2 + 3 x 6.7 Polyol Ester	Trio + Trio 6 3 x 6.7 + 3 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	44 + 45	67 + 69	44 + 45
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1543 10	1540 10	1326 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

			DCC042DR-10BSS0	DCC043DR-08BST0	DCC045DR-10BST0
Number of Refrigeration Circuits			2	2	2
Free Cool Enabled			No	No	No
Enhance Capital Allowance listed			Yes	Yes	Yes
Cooling Duty - High Airflow EC Fans	1)	kW	N/A	N/A	N/A
Nominal Output - Mechanical		kW	N/A	N/A	N/A
Nominal Input - Mechanical	2)		N/A	N/A	N/A
EER			N/A	N/A	N/A
ESEER			N/A	N/A	N/A
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - EC Fans	1)	kW	417.2	441.8	450.9
Nominal Output - Mechanical		kW	136.0	155.3	150.1
Nominal Input - Mechanical	2)		3.07	2.84	3.00
EER			4.46	4.30	4.43
ESEER			4.31	4.14	4.28
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - AC Fans		kW	421.7	439.4	453.9
Nominal Output - Mechanical		kW	138.2	154.6	151.4
Nominal Input - Mechanical			3.1	2.8	3.0
EER			4.07	4.04	4.07
ESEER			3.96	3.91	3.96
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling		kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Capacity Steps		%	20-35-55-70-85-100	20-40-55-70-85-100	15-35-55-70-85-100
Minimum Turndown Ratio			0.18	0.18	0.17
Dimensions (H x W x L)		mm	2415 x 2200 x 5956	2415 x 2200 x 4820	2415 x 2200 x 5956
Mass					
Machine	3)	kg	3920	3565	4015
Operating		kg	4025	3675	4140
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator			Brazed Plate Class 1		
Insulation					
Water Volume (Total Internal)		l	43.2	57.6	57.6
Total Maximum Water flow		l/s	27.0	26.6	29.1
Condenser			Copper Tube & Aluminium Fin		
Face Area (Total)		m²	21.00	16.80	21.00
Nominal Airflow - High Airflow EC Fans		m³/s	N/A	N/A	N/A
Nominal Airflow - EC Fans		m³/s	59.5	47.6	59.5
Nominal Airflow - AC Fans		m³/s	55.4	44.3	55.4
Condenser Fan & Motor			Sickle Bladed Fan		
Quantity					
Diameter		mm	10	8	10
Maximum Speed - High Airflow EC Fans		rpm	800	800	800
Maximum Speed - EC Fans		rpm	N/A	N/A	N/A
Maximum Speed - AC Fans		rpm	1032	1032	1032
			908	908	908
Compressor			Trio + Trio		
Quantity of Compressors					
Oil Charge Volume (Total)		l	6	6	6
Oil Type			3 x 6.7 + 3 x 6.7		
Refrigeration			Trio + Trio		
Refrigerant Control					
Refrigerant Precharged			Electronic Expansion Valve (EEV)		
Charge (Total)		kg	67 + 69	58 + 62	70 + 742
Connections			R410A		
Water Inlet / Outlet - Unit					
Water Drain / Bleed - Evap		inch	DN100	DN100	DN100
Water System					
Minimum System Water Volume	4)	l	1/2	1/2	1/2
Maximum System Operating Pressure		Bar	1321	1335	1326
			10	10	10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC046DR-08BTT0 2 No Yes	DCC048DR-10BTT0 2 No Yes	DCC051DR-08BVV0 2 No No
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	469.7 169.9 2.76 4.22 4.06 N/A N/A	479.9 163.9 2.93 4.36 4.21 N/A N/A	516.5 197.9 2.61 4.24 4.06 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	464.8 168.6 2.8 4.09 3.87 N/A N/A	481.4 164.4 2.9 4.04 3.92 N/A N/A	509.8 197.9 2.6 4.11 3.89 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	20-40-55-75-85-100 0.20	20-40-55-70-85-100 0.19	20-40-55-75-85-100 0.20
Dimensions (H x W x L)		mm	2415 x 2200 x 4820	2415 x 2200 x 5956	2415 x 2200 x 4820
Mass Machine Operating	3)	kg kg	3605 3715	4065 4195	3605 3715
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow				Brazed Plate Class 1 57.6 57.6 30.9	57.6 30.1
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	16.80 N/A 47.6 44.3	Copper Tube & Aluminium Fin 21.00 N/A 59.5 55.4	16.80 N/A 47.6 44.3
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	8 800 N/A 1032 908	Sickle Bladed Fan 10 800 N/A 1032 908	8 800 N/A 1032 908
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Trio + Trio 6 3 x 7.2 + 3 x 7.2	Trio + Trio 6 3 x 7.2 + 3 x 7.2 Polyol Ester	Trio + Trio 6 3 x 5.3 + 3 x 5.3 Polyvinyl Ether
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	59 + 62	Electronic Expansion Valve (EEV) R410A 71 + 74	60 + 63
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1553 10	1543 10	1741 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC011SX-04AK00 1 No Yes	DCC014SX-04AL00 1 No Yes	DCC017SX-04AM00 1 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	110.8 32.7 3.39 4.52 4.40 N/A N/A	138.1 44.0 3.14 4.22 4.11 N/A N/A	159.2 52.4 3.04 4.16 4.05 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	112.2 34.1 3.3 4.12 4.03 N/A N/A	140.4 45.1 3.1 3.94 3.86 N/A N/A	162.3 53.2 3.1 3.94 3.85 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	55-100 0.53	55-100 0.55	55-100 0.55
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3)	kg kg	1615 1640	1725 1750	1760 1790
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	8.6 7.2	11.0 9.2	13.2 10.4
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	8.40 N/A 14.8 17.4	Copper Tube & Aluminium Fin 8.40 N/A 14.8 17.4	8.40 N/A 14.8 17.4
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm	4 800 N/A 657 726	Sickle Bladed Fan 4 800 N/A 657 726	4 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total)		l	Tandem 2 2 x 6.7	Tandem 2 2 x 6.7 Polyol Ester	Tandem 2 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	45	46	47
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1019 10	1303 10	1533 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC021SX-06BS00 1 No Yes	DCC023SX-04BT00 1 No Yes	DCC024SX-06BT00 1 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	206.9 66.1 3.13 4.47 4.33 N/A N/A	218.0 87.1 2.50 4.13 3.96 N/A N/A	237.2 79.8 2.97 4.40 4.25 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	210.4 67.7 3.1 4.11 4.00 N/A N/A	224.9 86.1 2.6 4.08 3.82 N/A N/A	242.0 80.9 3.0 4.09 3.98 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	35-70-100 0.37	40-75-100 0.41	40-70-100 0.38
Dimensions (H x W x L)		mm	2415 x 2200 x 3690	2405 x 2200 x 2554	2415 x 2200 x 3690
Mass Machine Operating	3)	kg kg	2455 2505	2035 2080	2520 2570
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	20.3 13.5	25.7 14.2	25.7 15.5
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	12.60 N/A 22.2 26.1	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	6 800 N/A 657 726	Sickle Bladed Fan 4 800 N/A 657 726	6 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Trio 3 3 x 6.7	Trio 3 3 x 7.2 Polyol Ester	Trio 3 3 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	69	Electronic Expansion Valve (EEV) R410A 58	71
Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1327 10	1565 10	1557 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC011DX-04ACC0 2 No Yes	DCC013DX-04ACD0 2 No Yes	DCC014DX-04ADD0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	111.8 32.6 3.43 4.38 4.27 N/A N/A	126.3 38.2 3.30 4.43 4.31 N/A N/A	138.9 43.7 3.18 4.00 3.91 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	113.2 34.1 3.3 4.19 4.09 N/A N/A	128.1 39.5 3.2 4.25 4.14 N/A N/A	141.2 44.8 3.1 3.92 3.84 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	50-100 0.50	45-100 0.45	50-100 0.50
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3)	kg kg	1680 1700	1735 1765	1785 1815
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	9.2 7.3	Class 1 11.2 8.5	11.2 9.1
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	8.40 N/A 14.8 17.4	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	4 800 N/A 657 726	Sickle Bladed Fan 4 800 N/A 657 726	4 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total)		l	Single + Single 2 1 x 6.7 + 1 x 6.7	Single + Single 2 1 x 6.7 + 1 x 6.7 Polyol Ester	Single + Single 2 1 x 6.7 + 1 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	25 + 25	Electronic Expansion Valve (EEV) R410A 25 + 25	25 + 25
Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	963 10	980 10	1201 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits			DCC015DX-04ADF0	DCC016DX-04AJJ0	DCC018DX-04BJK0
Free Cool Enabled			2 No Yes	2 No Yes	2 No Yes
Enhance Capital Allowance listed					
Cooling Duty - High Airflow EC Fans	1)	kW kW	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A
Nominal Output - Mechanical	2)				
Nominal Input - Mechanical					
EER					
ESEER					
SEER					
Nominal Output - Free Cooling	5)	kW °C	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
Ambient temperature for 100% Free Cooling					
Cooling Duty - EC Fans	1)	kW kW	149.8 48.2 3.11 4.04 3.94 N/A N/A	154.9 50.8 3.05 4.38 4.24 N/A N/A	176.8 62.2 2.84 4.36 4.20 N/A N/A
Nominal Output - Mechanical	2)				
Nominal Input - Mechanical					
EER					
ESEER					
SEER					
Nominal Output - Free Cooling	5)	kW °C			
Ambient temperature for 100% Free Cooling					
Cooling Duty - AC Fans		kW kW	152.5 49.1 3.1 3.97 3.88 N/A N/A	157.9 51.6 3.1 4.12 4.01 N/A N/A	180.9 62.3 2.9 4.15 4.02 N/A N/A
Nominal Output - Mechanical					
Nominal Input - Mechanical					
EER					
ESEER					
SEER					
Nominal Output - Free Cooling		kW °C			
Ambient temperature for 100% Free Cooling					
Capacity Steps		%	45-100	30-55-80-100	25-55-75-100
Minimum Turndown Ratio			0.47	0.28	0.24
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass					
Machine	3)	kg kg	1805 1830	1945 1975	1975 2010
Operating					
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator			Brazed Plate Class 1		
Insulation					
Water Volume (Total Internal)		l l/s	13.2 9.8	13.2 10.1	18.0 11.6
Total Maximum Water flow					
Condenser			Copper Tube & Aluminium Fin		
Face Area (Total)		m²	8.40	8.40	8.40
Nominal Airflow - High Airflow EC Fans		m³/s	N/A	N/A	N/A
Nominal Airflow - EC Fans		m³/s	14.8	14.8	14.8
Nominal Airflow - AC Fans		m³/s	17.4	17.4	17.4
Condenser Fan & Motor			Sickle Bladed Fan		
Quantity					
Diameter		mm	4	4	4
Maximum Speed - High Airflow EC Fans		rpm	800	800	800
Maximum Speed - EC Fans		rpm	N/A	N/A	N/A
Maximum Speed - AC Fans		rpm	657	657	657
			726	726	726
Compressor			Tandem + Tandem		
Quantity of Compressors					
Oil Charge Volume (Total)		l	Single + Single 2 1 x 6.7 + 1 x 7.2	4 2 x 6.7 + 2 x 6.7	4 2 x 6.7 + 2 x 6.7
Oil Type					
Refrigeration			Polyol Ester		
Refrigerant Control					
Refrigerant Precharged			Electronic Expansion Valve (EEV) R410A		
Charge (Total)		kg	25 + 26	25 + 26	27 + 27
Connections			Grooved Terminations		
Water Inlet / Outlet - Unit					
Water Drain / Bleed - Evap		inch	DN80 1/2	DN80 1/2	DN80 1/2
Water System					
Minimum System Water Volume	4)	l	1217	744	746
Maximum System Operating Pressure		Bar	10	10	10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC019DX-04AFK0 2 No Yes	DCC020DX-06AFK0 2 No Yes	DCC021DX-04AKK0 2 No Yes	
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	182.0 63.4 2.87 3.98 3.87 N/A N/A	193.9 59.1 3.28 4.37 4.26 N/A N/A	201.8 73.9 2.73 4.25 4.08 N/A N/A	
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	186.3 63.4 2.9 3.98 3.85 N/A N/A	196.9 60.9 3.2 4.17 4.07 N/A N/A	207.2 73.3 2.8 4.08 3.98 N/A N/A	
Capacity Steps Minimum Turndown Ratio		%	45-75-100 0.44	45-75-100 0.44	30-55-80-100 0.29	
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2415 x 2200 x 3690	2405 x 2200 x 2554	
Mass Machine Operating	3)	kg kg	1915 1950	2435 2480	1985 2020	
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)			
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow			Brazed Plate Class 1 18.8 18.8 12.6 18.8 13.0			
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	8.40 N/A 14.8 17.4	Copper Tube & Aluminium Fin 12.60 N/A 22.2 26.1		8.40 N/A 14.8 17.4
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	4 800 N/A 657 726	Sickle Bladed Fan 6 800 N/A 657 726		4 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Single + Tandem 3 1 x 7.2 + 2 x 6.7	Single + Tandem 3 1 x 7.2 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	26 + 27	38 + 38	26 + 27	
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2	
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1418 10	1476 10	1014 10	

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC022DX-06AKK0 2 No Yes	DCC024DX-06BKL0 2 No Yes	DCC025DX-08BKL0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	216.7 67.8 3.19 4.56 4.41 N/A N/A	241.4 80.0 3.02 4.49 4.33 N/A N/A	251.3 76.8 3.27 4.65 4.50 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	220.4 69.2 3.2 4.25 4.14 N/A N/A	246.3 81.0 3.0 4.04 4.09 N/A N/A	255.0 79.3 3.2 4.26 4.15 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	25-55-75-100 0.27	25-55-75-100 0.25	25-55-75-100 0.24
Dimensions (H x W x L)		mm	2415 x 2200 x 3690	2415 x 2200 x 3690	2415 x 2200 x 4820
Mass Machine Operating	3)	kg kg	2510 2550	2660 2725	3120 3200
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	18.8 14.1	26.1 15.3	26.1 16.3
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	12.60 N/A 22.2 26.1	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	6 800 N/A 657 726	Sickle Bladed Fan 6 800 N/A 657 726	8 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	38 + 38	40 + 42	50 + 53
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1026 10	1038 10	1033 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC027DX-06BLLO 2 No Yes	DCC028DX-08BLLO 2 No Yes	DCC030DX-06BLMO 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	264.0 92.1 2.87 4.20 4.06 N/A N/A	276.1 87.9 3.14 4.38 4.25 N/A N/A	283.7 101.6 2.79 4.21 4.06 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	270.0 92.6 2.9 3.83 3.90 N/A N/A	280.7 90.1 3.1 4.08 3.98 N/A N/A	290.7 101.7 2.9 3.98 3.91 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	30-55-80-100 0.28	25-55-75-100 0.27	25-55-75-100 0.26
Dimensions (H x W x L)		mm	2415 x 2200 x 3690	2415 x 2200 x 4820	2415 x 2200 x 3690
Mass Machine Operating	3)	kg kg	2760 2825	3230 3305	2805 2875
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	26.1 16.8	26.1 18.0	30.6 18.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	12.60 N/A 22.2 26.1	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	6 800 N/A 657 726	Sickle Bladed Fan 8 800 N/A 657 726	6 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	40 + 42	51 + 53	41 + 43
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1307 10	1303 10	1316 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC031DX-08BLM0 2 No Yes	DCC032DX-06BMM0 2 No Yes	DCC033DX-08BMM0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	298.2 96.4 3.09 4.40 4.26 N/A N/A	300.6 110.9 2.71 4.10 3.96 N/A N/A	317.2 104.8 3.03 4.32 4.18 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	303.6 98.3 3.1 4.11 4.00 N/A N/A	308.6 110.5 2.8 3.94 3.86 N/A N/A	323.4 106.3 3.0 4.08 3.97 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	25-55-75-100 0.25	30-55-80-100 0.29	30-55-80-100 0.28
Dimensions (H x W x L)		mm	2415 x 2200 x 4820	2415 x 2200 x 3690	2415 x 2200 x 4820
Mass Machine Operating	3)	kg kg	3270 3350	2830 2900	3300 3380
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	30.6 19.5	30.6 19.3	30.6 20.7
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	16.80 N/A 29.6 34.8	Copper Tube & Aluminium Fin 12.60 N/A 22.2 26.1	16.80 N/A 29.6 34.8
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	8 800 N/A 657 726	Sickle Bladed Fan 6 800 N/A 657 726	8 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Tandem + Tandem 4 2 x 6.7 + 2 x 7.2	Tandem + Tandem 4 2 x 7.2 + 2 x 7.2 Polyol Ester	Tandem + Tandem 4 2 x 7.2 + 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	52 + 54	42 + 43	52 + 54
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1311 10	1513 10	1529 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC036DX-08BMS0 2 No Yes	DCC038DX-10BMS0 2 No Yes	DCC039DX-08BSS0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW °C	354.9 123.6 2.87 4.35 4.19 N/A N/A	368.6 118.7 3.11 4.41 4.26 N/A N/A	386.9 142.1 2.72 4.34 4.17 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW °C	363.1 124.2 2.9 3.97 3.99 N/A N/A	375.3 121.1 3.1 4.13 4.02 N/A N/A	396.9 141.8 2.8 3.97 3.97 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	25-45-65-85-100 0.25	25-45-65-85-100 0.24	20-40-55-75-85-100 0.20
Dimensions (H x W x L)		mm	2415 x 2200 x 4820	2415 x 2200 x 5956	2415 x 2200 x 4820
Mass Machine Operating	3)	kg kg	3505 3600	3995 4100	3660 3755
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		I l/s	43.2 22.6	43.2 24.1	43.2 24.8
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	16.80 N/A 29.6 34.8	Copper Tube & Aluminium Fin Brazed Plate Class 1 43.2 24.1	16.80 N/A 29.6 34.8
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	8 800 N/A 657 726	Sickle Bladed Fan 10 800 N/A 657 726	8 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		I	Tandem + Trio 5 2 x 7.2 + 3 x 6.7	Tandem + Trio 5 2 x 7.2 + 3 x 6.7 Polyol Ester	Trio + Trio 6 3 x 6.7 + 3 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	55 + 57	Electronic Expansion Valve (EEV) R410A 56 + 80	55 + 57
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	I Bar	1556 10	1546 10	1334 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.
All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCC042DX-12BSS0 2 No Yes	DCC043DX-08BST0 2 No Yes	DCC045DX-12BST0 2 No Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1) 2) 5)	kW kW kW °C	414.3 132.2 3.13 4.55 4.40 N/A N/A	412.1 158.2 2.61 4.30 4.12 N/A N/A	445.2 146.0 3.05 4.53 4.37 N/A N/A
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling		kW kW kW °C	421.2 135.5 3.1 4.18 4.07 N/A N/A	424.4 157.1 2.7 4.09 3.94 N/A N/A	453.4 148.7 3.0 4.18 4.06 N/A N/A
Capacity Steps Minimum Turndown Ratio		%	20-35-55-70-85-100 0.19	20-40-55-75-85-100 0.18	15-35-55-70-85-100 0.17
Dimensions (H x W x L)		mm	2415 x 2200 x 7090	2415 x 2200 x 4820	2415 x 2200 x 7090
Mass Machine Operating	3)	kg kg	4575 4695	3765 3875	4670 4805
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	43.2 27.0	57.6 26.6	57.6 29.1
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s	25.20 N/A 44.4 52.2	Copper Tube & Aluminium Fin	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm mm rpm rpm	12 800 N/A 657 726	Sickle Bladed Fan 8 800 N/A 657 726	12 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Trio + Trio 6 3 x 6.7 + 3 x 6.7	Trio + Trio 6 3 x 6.7 + 3 x 7.2 Polyol Ester	Trio + Trio 6 3 x 6.7 + 3 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	79 + 81	58 + 62	81 + 87
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN100 1/2	DN100 1 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4)	l Bar	1327 10	1340 11	1332 10

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Mechanical Data Extra Quiet Continued

Number of Refrigeration Circuits			DCC046DX-10BTT0	DCC048DX-12BTT0	DCC051DX-10BVV0
Free Cool Enabled	2)	No	2	No	2
Enhance Capital Allowance listed		Yes		Yes	No
Cooling Duty - High Airflow EC Fans	1)	kW	N/A	N/A	N/A
Nominal Output - Mechanical		kW	N/A	N/A	N/A
Nominal Input - Mechanical	2)	kW	N/A	N/A	N/A
EER			N/A	N/A	N/A
ESEER			N/A	N/A	N/A
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - EC Fans	1)	kW	456.4	471.6	500.0
Nominal Output - Mechanical		kW	165.0	159.5	196.2
Nominal Input - Mechanical	2)	kW	2.77	2.96	2.55
EER			4.37	4.47	4.39
ESEER			4.20	4.31	4.19
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling	5)	kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Cooling Duty - AC Fans		kW	467.9	481.0	513.9
Nominal Output - Mechanical		kW	165.4	161.7	193.8
Nominal Input - Mechanical		kW	2.8	3.0	2.7
EER			4.11	4.15	4.17
ESEER			3.98	4.03	4.01
SEER			N/A	N/A	N/A
Nominal Output - Free Cooling		kW	N/A	N/A	N/A
Ambient temperature for 100% Free Cooling		°C	N/A	N/A	N/A
Capacity Steps		%	20-40-55-75-85-100	20-40-55-70-85-100	20-40-55-75-85-100
Minimum Turndown Ratio			0.19	0.19	0.20
Dimensions (H x W x L)		mm	2415 x 2200 x 5956	2415 x 2200 x 7090	2415 x 2200 x 5956
Mass					
Machine	3)	kg	4270	4725	4270
Operating		kg	4390	4860	4395
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator			Brazed Plate Class 1		
Insulation					
Water Volume (Total Internal)		l	57.6	57.6	57.6
Total Maximum Water flow		l/s	27.5	30.8	30.3
Condenser			Copper Tube & Aluminium Fin		
Face Area (Total)		m²	21.00	25.20	21.00
Nominal Airflow - High Airflow EC Fans		m³/s	N/A	N/A	N/A
Nominal Airflow - EC Fans		m³/s	37	44.4	37
Nominal Airflow - AC Fans		m³/s	43.5	52.2	43.5
Condenser Fan & Motor			Sickle Bladed Fan		
Quantity			10	12	10
Diameter		mm	800	800	800
Maximum Speed - High Airflow EC Fans		rpm	N/A	N/A	N/A
Maximum Speed - EC Fans		rpm	657	657	657
Maximum Speed - AC Fans		rpm	726	726	726
Compressor			Trio + Trio 6 3 x 7.2 + 3 x 7.2		
Quantity of Compressors		l	Trio + Trio 6 3 x 7.2 + 3 x 7.2		
Oil Charge Volume (Total)			Polyol Ester		
Oil Type			3 x 5.3 + 3 x 5.3 Polyvinyl Ether		
Refrigeration					
Refrigerant Control			Electronic Expansion Valve (EEV) R410A		
Refrigerant Precharged					
Charge (Total)		kg	71 + 74	83 + 87	73 + 75
Connections			Grooved Terminations		
Water Inlet / Outlet - Unit			DN100 2 1/2		
Water Drain / Bleed - Evap		inch			
Water System			DN100 1/2		
Minimum System Water Volume	4)	l	1562	1552	1753
Maximum System Operating Pressure		Bar	12	10	13

(1) Based on units performance at 12/7°C return/supply temperatures, 35°C ambient, 100% water.

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

Electrical Data Regular Quiet

ELECTRICAL DATA Unit Data			DCC011SR-04AK00	DCC014SR-04AL00	DCC017SR-04AM00
Nominal Run Amps	(1)	A	79	94	114
Maximum Start Amps	(2)	A	263	315	385
Recommended Mains Fuse Size		A	100	125	125
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			4	4	4
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			4	4	4
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.6	2.6	2.6
Compressor - Per Compressor					
Nominal Run Amps		A	31.0	38.3	48.2
Quantity			2	2	2
Motor Rating		kW	18.5	22.5	28.2
Sump Heater Rating		W	75	75	130
Start Amps (2)		A	215	260	320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	42.8
Circuit 2 Comp RLA (PFC)			N/A	N/A	N/A
Nominal Run Amps		A	73.4	85.6	102.8
Maximum Start Amps		A	260.3	311.4	380.0
Compressor Nominal Run Amps		A	28.11	34.19	42.82
Recommended Mains Fuse Size		A	100	125	125
Electronic Soft-start					
Nominal Run Amps		A	83.24	103.32	112.18
Maximum Start Amps		A	179.22	216.26	256.69
Recommended Mains Fuse		A	100	125	125
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	79.1	93.7	113.62
Maximum Start Amps		A	174.7	209.7	252.0
Compressor Nominal Run Amps		A	28.51	36.48	42.78
Recommended Mains Fuse Size		A	100	125	125
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	84	99	119
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	6.6
Unit Nominal Run Amps		A	84	99	120
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	2.2	2.2	3
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	84	98	118
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	85	100	120
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC021SR-04BS00	DCC023SR-04BT00	DCC024SR-06BT00
Nominal Run Amps	(1)	A	132	162	170
Maximum Start Amps	(2)	A	354	434	442
Recommended Mains Fuse Size		A	160	200	200
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	6
Quantity		A	4.3	4.3	4.3
Full Load Amps		A	15	15	15
Locked Rotor Amps		kW	2	2	2
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	6
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.6	2.6	2.6
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	38.3	48.2	48.2
Quantity			3	3	3
Motor Rating		kW	22.5	28.2	28.2
Sump Heater Rating		W	75	130	130
Start Amps (2)		A	260	320	320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	42.8	42.8
Circuit 2 Comp RLA (PFC)			N/A	N/A	N/A
Nominal Run Amps		A	119.8	145.6	154.2
Maximum Start Amps		A	345.6	422.8	431.4
Compressor Nominal Run Amps		A	34.2	42.8	42.8
Recommended Mains Fuse Size		A	160	200	200
Electronic Soft-start					
Nominal Run Amps		A	132.07	161.83	170.43
Maximum Start Amps		A	250	306	314
Recommended Mains Fuse		A	160	200	200
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	119.8	145.6	154.2
Maximum Start Amps		A	242	295	303
Compressor Nominal Run Amps		A	34.2	42.8	42.8
Recommended Mains Fuse Size		A	160	200	200
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	6.2	6.2
Unit Nominal Run Amps		A	137	168	177
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	2.2	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.6	8.9	8.9
Unit Nominal Run Amps		A	139	171	179
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	3	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	6.3	8.0
Unit Nominal Run Amps		A	137	168	178
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	2.2	3	4
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	8	8
Unit Nominal Run Amps		A	138	170	178
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	3	4	4

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC011DR-04ACC0	DCC013DR-04ACD0	DCC014DR-04ADD0
Nominal Run Amps	(1)	A	79	86	94
Maximum Start Amps	(2)	A	263	308	315
Recommended Mains Fuse Size		A	100	125	125
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	4
Quantity		A	4.3	4.3	4.3
Full Load Amps		A	15	15	15
Locked Rotor Amps		kW	2	2	2
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	4
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.6	2.6	2.6
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 31.0	38.3 / 31.0	38.3 / 38.3
Quantity			1 + 1	1 + 1	1 + 1
Motor Rating		kW	18.5 / 18.5	22.5 / 18.5	22.5 / 22.5
Sump Heater Rating		W	75	75	75
Start Amps (2)		A	215 / 215	260 / 260	260 / 260
Type Of Start			Direct on line	Direct on line	Direct on line
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			28.5	28.5	36.5
Nominal Run Amps		A	73.4	79.5	85.6
Maximum Start Amps		A	260.3	305.3	311.4
Compressor Nominal Run Amps		A	28.1 / 28.1	34.2 / 28.1	34.2 / 34.2
Recommended Mains Fuse Size		A	100	125	125
Electronic Soft-start		A	79.1	86.44	93.78
Nominal Run Amps		A	177	204	211
Maximum Start Amps		A	100	125	125
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	85.6	102.8	119.8
Maximum Start Amps		A	207	252	242
Compressor Nominal Run Amps		A	34.2	42.8	34.2
Recommended Mains Fuse Size		A	125	125	160
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	99	119	137
Recommended Mains Fuse Size		A	125	160	200
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	99	120	139
Recommended Mains Fuse Size		A	125	160	200
Motor Rating		kW	2.2	3	3
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	98	118	137
Recommended Mains Fuse Size		A	125	160	200
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	100	120	138
Recommended Mains Fuse Size		A	125	160	200
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC015DR-04ADF0	DCC016DR-04AJJ0	DCC018DR-04BJK0
Nominal Run Amps	(1)	A	104	115	128
Maximum Start Amps	(2)	A	375	288	312
Recommended Mains Fuse Size		A	125	160	160
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	4
Quantity		A	4.3	4.3	4.3
Full Load Amps		A	15	15	15
Locked Rotor Amps		kW	2	2	2
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	4
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.6	2.6	2.6
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 38.3	24.5 / 24.5	31.0 / 24.5
Quantity			1 + 1	2 + 2	2 + 2
Motor Rating		kW	28.2 / 22.5	13.7 / 13.7	18.5 / 13.7
Sump Heater Rating		W	130 + 75	75	75
Start Amps (2)		A	320 / 260	197 / 197	215 / 197
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	20.9	28.5
Circuit 2 Comp RLA (PFC)			36.5	20.9	20.9
Nominal Run Amps		A	94.2	100.7	115.1
Maximum Start Amps		A	371.4	276.8	302.0
Compressor Nominal Run Amps		A	42.8 / 34.2	20.9 / 20.9	28.1 / 20.9
Recommended Mains Fuse Size		A	125	160	160
Electronic Soft-start					
Nominal Run Amps		A	103.7	115.28	128.14
Maximum Start Amps		A	247	209	2226
Recommended Mains Fuse		A	125	160	160
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	94.2	100.7	115.1
Maximum Start Amps		A	243	198	216
Compressor Nominal Run Amps		A	42.8 / 34.2	20.9 / 20.9	28.1 / 20.9
Recommended Mains Fuse Size		A	125	160	160
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	109	120	133
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	6.6	6.6
Unit Nominal Run Amps		A	109	122	135
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	3	3
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	108	120	133
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	110	122	134
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC019DR-04AFK0	DCC020DR-06AFK0	DCC021DR-04AKK0
Nominal Run Amps	(1)	A	127	136	141
Maximum Start Amps	(2)	A	339	408	325
Recommended Mains Fuse Size		A	160	160	160
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	6	4
Quantity		A	4.3	4.3	4.3
Full Load Amps		A	15	15	15
Locked Rotor Amps		kW	2	2	2
Motor Rating					
Condenser Fan - Per Fan (EC)			4	6	4
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.6	2.6	2.6
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 48.2	31.0 / 48.2	31.0 / 31.0
Quantity			2 + 1	2 + 1	2 + 2
Motor Rating		kW	18.5 / 28.2	18.5 / 28.2	18.5 / 18.5
Sump Heater Rating		W	130 + 75	130 + 75	75
Start Amps (2)		A	215 / 260	215 / 320	215 / 215
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	28.5	28.5
Circuit 2 Comp RLA (PFC)			42.8	42.8	28.5
Nominal Run Amps		A	116.2	124.8	129.6
Maximum Start Amps		A	393.4	402.0	316.5
Compressor Nominal Run Amps		A	28.1 / 42.8	28.1 / 42.8	28.1 / 28.1
Recommended Mains Fuse Size		A	160	160	160
Electronic Soft-start		A	127.31	135.91	141
Nominal Run Amps		A	235	280	239
Maximum Start Amps		A	160	160	160
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	116.2	124.8	129.6
Maximum Start Amps		A	265	274	231
Compressor Nominal Run Amps		A	28.1 / 42.8	28.1 / 42.8	28.1 / 28.1
Recommended Mains Fuse Size		A	160	160	160
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	6.2
Unit Nominal Run Amps		A	132	141	147
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.6	6.6	8.9
Unit Nominal Run Amps		A	134	143	150
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	3	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	6.3
Unit Nominal Run Amps		A	132	140	147
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	3
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	8
Unit Nominal Run Amps		A	134	142	149
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	3	4

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC022DR-06AKKO	DCC024DR-04BKL0	DCC025DR-06BKL0
Nominal Run Amps	(1)	A	150	156	164
Maximum Start Amps	(2)	A	334	340	348
Recommended Mains Fuse Size		A	200	200	200
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	4	6
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			6	4	6
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.6	2.6	2.6
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 31.0	31.0 / 38.3	31.0 / 38.3
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	18.5 / 18.5	18.5 / 24.0	18.5 / 24.0
Sump Heater Rating		W	75	75	75
Start Amps (2)		A	215 / 215	215 / 260	215 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			28.5	28.5	28.5
Nominal Run Amps		A	138.2	141.8	150.4
Maximum Start Amps		A	325.1	328.7	337.3
Compressor Nominal Run Amps		A	28.1 / 28.1	28.1 / 34.2	28.1 / 34.2
Recommended Mains Fuse Size		A	200	200	200
Electronic Soft-start					
Nominal Run Amps		A	149.6	155.68	164.28
Maximum Start Amps		A	248	254	262
Recommended Mains Fuse		A	200	200	200
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	138.2	141.8	150.4
Maximum Start Amps		A	239	243	251
Compressor Nominal Run Amps		A	28.1 / 28.1	28.1 / 34.2	28.1 / 34.2
Recommended Mains Fuse Size		A	200	200	200
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.2	6.2	6.2
Unit Nominal Run Amps		A	156	162	170
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	3	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	159	165	173
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	4	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	8.0	8.0
Unit Nominal Run Amps		A	156	164	172
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	3	4	4
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	11.2	11.2
Unit Nominal Run Amps		A	158	167	175
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	4	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC027DR-04BLLO	DCC028DR-06BLLO	DCC030DR-06BLMO
Nominal Run Amps	(1)	A	170	179	199
Maximum Start Amps	(2)	A	392	401	471
Recommended Mains Fuse Size		A	200	250	250
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			4	6	6
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			4	6	6
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.6	2.6	2.6
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 38.3	38.3 / 38.3	48.2 / 38.3
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	22.5 / 24.0	22.5 / 24.0	28.2 / 24.0
Sump Heater Rating		W	75	75	130 + 75
Start Amps (2)		A	260 / 260	260 / 260	320 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	36.5	42.8
Circuit 2 Comp RLA (PFC)			36.5	36.5	36.5
Nominal Run Amps		A	154.0	162.6	179.8
Maximum Start Amps		A	379.8	388.4	457.0
Compressor Nominal Run Amps		A	34.2 / 34.2	34.2 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	200	250	250
Electronic Soft-start		A	170.36	178.96	198.8
Nominal Run Amps		A	288	297	343
Maximum Start Amps		A	200	250	250
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	154.0	162.6	179.8
Maximum Start Amps		A	276	284	329
Compressor Nominal Run Amps		A	34.2 / 34.2	34.2 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	200	250	250
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.2	6.2	6.2
Unit Nominal Run Amps		A	177	185	205
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	3	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	179	188	208
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	4	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.0	8.0	11.2
Unit Nominal Run Amps		A	178	187	210
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	4	4	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	182	190	210
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC031DR-08BLMO	DCC032DR-06BMMO	DCC033DR-08BMMO
Nominal Run Amps	(1)	A	207	219	227
Maximum Start Amps	(2)	A	479	490	499
Recommended Mains Fuse Size		A	250	250	250
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			8	6	8
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			8	6	8
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.6	2.6	2.6
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 38.3	48.2 / 48.2	48.2 / 48.2
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	28.2 / 24.0	28.2 / 28.2	28.2 / 28.2
Sump Heater Rating		W	130 + 75	130	130
Start Amps (2)		A	320 / 260	320 / 260	320 / 320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	42.8	42.8
Circuit 2 Comp RLA (PFC)			36.5	42.8	42.8
Nominal Run Amps		A	188.4	197.1	205.7
Maximum Start Amps		A	465.6	414.2	482.8
Compressor Nominal Run Amps		A	42.8 / 34.2	42.8 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250	250
Electronic Soft-start		A	207.4	218.64	227.24
Nominal Run Amps		A	351	362	371
Maximum Start Amps		A	250	250	250
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	188.4	197.1	205.7
Maximum Start Amps		A	338	310	355
Compressor Nominal Run Amps		A	42.8 / 34.2	42.8 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250	250
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.2	8.9	8.9
Unit Nominal Run Amps		A	214	228	236
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	3	4	4
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	12	12
Unit Nominal Run Amps		A	216	231	239
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	4	5.5	5.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	219	230	238
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	219	230	238
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC036DR-06BMS0	DCC038DR-10BMS0	DCC039DR-06BSS0
Nominal Run Amps	(1)	A	237	254	256
Maximum Start Amps	(2)	A	509	526	477
Recommended Mains Fuse Size		A	315	315	315
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			6	10	6
Quantity		A	4.3	4.3	4.3
Full Load Amps		A	15	15	15
Locked Rotor Amps		kW	2	2	2
Motor Rating					
Condenser Fan - Per Fan (EC)			6	10	6
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.6	2.6	2.6
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 48.2	38.3 / 48.2	38.3 / 38.3
Quantity			3 + 2	3 + 2	3 + 3
Motor Rating		kW	22.5 / 28.2	22.5 / 28.2	22.5 / 22.5
Sump Heater Rating		W	130 + 75	130 + 75	75
Start Amps (2)		A	260 / 320	260 / 320	260 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			42.8	42.8	36.5
Nominal Run Amps		A	214.0	231.2	231.0
Maximum Start Amps		A	491.2	508.4	456.8
Compressor Nominal Run Amps		A	34.2 / 42.8	34.2 / 42.8	34.2 / 34.2
Recommended Mains Fuse Size		A	315	315	315
Electronic Soft-start		A	237.09	254.29	255.54
Nominal Run Amps		A	381	398	373
Maximum Start Amps		A	315	315	315
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	214.0	231.2	231.0
Maximum Start Amps		A	363	380	353
Compressor Nominal Run Amps		A	34.2 / 42.8	34.2 / 42.8	34.2 / 34.2
Recommended Mains Fuse Size		A	315	315	315
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	12
Unit Nominal Run Amps		A	249	266	268
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	5.5	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14	14	14
Unit Nominal Run Amps		A	251	268	270
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	7.5	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	248	265	267
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	248	265	267
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	5.5	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC042DR-10BSS0	DCC043DR-08BST0	DCC045DR-10BST0
Nominal Run Amps	(1)	A	273	294	303
Maximum Start Amps	(2)	A	494	566	574
Recommended Mains Fuse Size		A	315	355	355
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			10	8	10
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			10	8	10
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.6	2.6	2.6
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 38.3	48.2 / 38.3	48.2 / 38.3
Quantity			3 + 3	3 + 3	3 + 3
Motor Rating		kW	22.5 / 24.0	28.2 / 22.5	28.2 / 24.0
Sump Heater Rating		W	75	130 + 75	130 + 75
Start Amps (2)		A	260 / 260	320 / 260	320 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	42.8	42.8
Circuit 2 Comp RLA (PFC)			36.5	36.5	36.5
Nominal Run Amps		A	248.2	265.4	274.0
Maximum Start Amps		A	474.0	542.6	551.2
Compressor Nominal Run Amps		A	34.2 / 34.2	42.8 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	315	355	355
Electronic Soft-start					
Nominal Run Amps		A	272.74	293.9	302.5
Maximum Start Amps		A	390	389	398
Recommended Mains Fuse		A	315	355	355
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	248.2	265.4	274.0
Maximum Start Amps		A	370	372	380
Compressor Nominal Run Amps		A	34.2 / 34.2	42.8 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	315	355	355
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	12
Unit Nominal Run Amps		A	285	306	315
Recommended Mains Fuse Size		A	355	355	355
Motor Rating		kW	5.5	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14	14	14
Unit Nominal Run Amps		A	287	308	317
Recommended Mains Fuse Size		A	355	355	355
Motor Rating		kW	7.5	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	284	305	314
Recommended Mains Fuse Size		A	355	355	355
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	14.8	14.8
Unit Nominal Run Amps		A	284	309	317
Recommended Mains Fuse Size		A	355	355	355
Motor Rating		kW	5.5	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCC046DR-08BTT0	DCC048DR-10BTT0	DCC051DR-08BVV0
Nominal Run Amps	(1)	A	324	332	366
Maximum Start Amps	(2)	A	595	604	577
Recommended Mains Fuse Size		A	355	355	400
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	17
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			8	10	8
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			8	10	8
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.6	2.6	2.6
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 48.2	48.2 / 48.2	55.2 / 55.2
Quantity			3 + 3	3 + 3	3 + 3
Motor Rating		kW	28.2 / 28.2	28.2 / 28.2	33.1 / 33.1
Sump Heater Rating		W	130	130	140
Start Amps (2)		A	320 / 320	320 / 320	267 / 267
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	42.8	50.3
Circuit 2 Comp RLA (PFC)			42.8	42.8	50.3
Nominal Run Amps		A	291.3	299.9	336.1
Maximum Start Amps		A	568.5	577.1	552.9
Compressor Nominal Run Amps		A	42.8 / 42.8	42.8 / 42.8	50.3 / 50.3
Recommended Mains Fuse Size		A	355	355	400
Electronic Soft-start					
Nominal Run Amps		A	323.66	332.26	365.6
Maximum Start Amps		A	467	467	471
Recommended Mains Fuse		A	355	355	400
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	291.3	299.9	336.1
Maximum Start Amps		A	440	449	446
Compressor Nominal Run Amps		A	42.8 / 42.8	42.8 / 42.8	50.3 / 50.3
Recommended Mains Fuse Size		A	355	355	400
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	12
Unit Nominal Run Amps		A	336	344	378
Recommended Mains Fuse Size		A	355	355	400
Motor Rating		kW	5.5	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14	14	14
Unit Nominal Run Amps		A	338	346	380
Recommended Mains Fuse Size		A	355	355	400
Motor Rating		kW	7.5	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	335	343	377
Recommended Mains Fuse Size		A	355	355	400
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14.8	14.8	14.8
Unit Nominal Run Amps		A	338	347	380
Recommended Mains Fuse Size		A	355	355	400
Motor Rating		kW	7.5	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet

ELECTRICAL DATA Unit Data			DCC011SX-04AK00	DCC014SX-04AL00	DCC017SX-04AM00
Nominal Run Amps	(1)	A	72	87	106
Maximum Start Amps	(2)	A	256	308	378
Recommended Mains Fuse Size		A	100	125	125
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	4
Quantity		A	2.5	2.5	2.5
Full Load Amps		A	8.8	8.8	8.8
Locked Rotor Amps		kW	1.27	1.27	1.27
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	4
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	31.0	38.3	48.2
Quantity			2	2	2
Motor Rating		kW	18.5	22.5	28.2
Sump Heater Rating		W	75	75	130
Start Amps (2)		A	215	260	320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	42.8
Circuit 2 Comp RLA (PFC)			N/A	N/A	N/A
Nominal Run Amps		A	66.2	78.4	95.6
Maximum Start Amps		A	253.1	304.2	372.8
Compressor Nominal Run Amps		A	28.11	34.19	42.82
Recommended Mains Fuse Size		A	100	125	125
Electronic Soft-start		A	71.9	86.58	106.42
Nominal Run Amps		A	170	204	250
Maximum Start Amps		A	100	125	125
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	66.2	78.4	95.6
Maximum Start Amps		A	167	200	245
Compressor Nominal Run Amps		A	28.1	34.2	42.8
Recommended Mains Fuse Size		A	100	125	125
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	77	92	111
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	6.6
Unit Nominal Run Amps		A	77	92	113
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	2.2	2.2	3
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	76	91	111
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	78	93	113
Recommended Mains Fuse Size		A	100	125	160
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC021SX-06BS00	DCC023SX-04BT00	DCC024SX-06BT00
Nominal Run Amps	(1)	A	130	155	160
Maximum Start Amps	(2)	A	352	426	431
Recommended Mains Fuse Size		A	160	200	200
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	4	6
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.27	1.27	1.27
Condenser Fan - Per Fan (EC)					
Quantity			6	4	6
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	38.3	48.2	48.2
Quantity			3	3	3
Motor Rating		kW	22.5	28.2	28.2
Sump Heater Rating		W	75	130	130
Start Amps (2)		A	260	320	320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	42.8	42.8
Circuit 2 Comp RLA (PFC)			N/A	N/A	N/A
Nominal Run Amps		A	117.6	138.4	143.4
Maximum Start Amps		A	343.4	415.6	420.6
Compressor Nominal Run Amps		A	34.19	42.82	42.82
Recommended Mains Fuse Size		A	160	200	200
Electronic Soft-start		A	129.87	155	159.63
Nominal Run Amps		A	248	258	263
Maximum Start Amps		A	160	200	200
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	117.6	138.4	143.4
Maximum Start Amps		A	239	288	293
Compressor Nominal Run Amps		A	34.2	42.8	42.8
Recommended Mains Fuse Size		A	160	200	200
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	6.2	6.2
Unit Nominal Run Amps		A	135	161	166
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	2.2	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.6	8.9	8.9
Unit Nominal Run Amps		A	136	164	169
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	3	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	6.3	6.3
Unit Nominal Run Amps		A	134	161	166
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	2.2	3	3
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	8	8
Unit Nominal Run Amps		A	136	163	168
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	3	4	4

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC011DX-04ACCO	DCC013DX-04ACD0	DCC014DX-04ADD0
Nominal Run Amps	(1)	A	72	79	87
Maximum Start Amps	(2)	A	256	301	308
Recommended Mains Fuse Size		A	100	125	125
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	4
Quantity		A	2.5	2.5	2.5
Full Load Amps		A	8.8	8.8	8.8
Locked Rotor Amps		kW	1.27	1.27	1.27
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	4
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 31.0	38.3 / 31.0	38.3 / 38.3
Quantity			1 + 1	1 + 1	1 + 1
Motor Rating		kW	18.5 / 18.5	22.5 / 18.5	22.5 / 22.5
Sump Heater Rating		W	75	75	75
Start Amps (2)		A	215 / 215	260 / 260	260 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			28.5	28.5	36.5
Nominal Run Amps		A	66.2	72.3	78.4
Maximum Start Amps		A	253.1	298.1	304.2
Compressor Nominal Run Amps		A	28.1 / 28.1	34.2 / 28.1	34.2 / 34.2
Recommended Mains Fuse Size		A	100	125	125
Electronic Soft-start					
Nominal Run Amps		A	71.9	79.24	86.58
Maximum Start Amps		A	170	197	204
Recommended Mains Fuse		A	100	125	125
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	66.2	72.3	78.4
Maximum Start Amps		A	167	194	200
Compressor Nominal Run Amps		A	28.1 / 28.1	34.2 / 28.1	34.2 / 34.2
Recommended Mains Fuse Size		A	100	125	125
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	77	84	92
Recommended Mains Fuse Size		A	100	125	125
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	77	84	92
Recommended Mains Fuse Size		A	100	125	125
Motor Rating		kW	2.2	2.2	2.2
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	76	84	91
Recommended Mains Fuse Size		A	100	125	125
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	78	86	93
Recommended Mains Fuse Size		A	100	125	125
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC015DX-04ADF0	DCC016DX-04AJJ0	DCC018DX-04BJK0
Nominal Run Amps	(1)	A	97	108	126
Maximum Start Amps	(2)	A	368	281	310
Recommended Mains Fuse Size		A	125	160	160
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	6
Quantity		A	2.5	2.5	2.5
Full Load Amps		A	8.8	8.8	8.8
Locked Rotor Amps		kW	1.27	1.27	1.27
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	6
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 38.3	24.5 / 24.5	31.0 / 24.5
Quantity			1 + 1	2 + 2	2 + 2
Motor Rating		kW	28.2 / 22.5	13.7 / 13.7	18.5 / 13.7
Sump Heater Rating		W	130 + 75	75	75
Start Amps (2)		A	320 / 260	180 / 180	215 / 180
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	20.9	28.5
Circuit 2 Comp RLA (PFC)			36.5	20.9	20.9
Nominal Run Amps		A	87.0	93.5	112.9
Maximum Start Amps		A	364.2	269.6	299.8
Compressor Nominal Run Amps		A	42.8 / 34.2	20.9 / 20.9	28.1 / 20.9
Recommended Mains Fuse Size		A	125	160	160
Electronic Soft-start					
Nominal Run Amps		A	96.5	108.08	125.94
Maximum Start Amps		A	240	202	224
Recommended Mains Fuse		A	125	160	160
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	87.0	93.5	112.9
Maximum Start Amps		A	236	191	214
Compressor Nominal Run Amps		A	42.8 / 34.2	20.9 / 20.9	28.1 / 20.9
Recommended Mains Fuse Size		A	125	160	160
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	102	113	131
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	6.6	6.6
Unit Nominal Run Amps		A	102	115	133
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	3	3
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	101	113	130
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	103	114	132
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC019DX-04AFK0	DCC020DX-06AFK0	DCC021DX-04AKK0
Nominal Run Amps	(1)	A	120	125	134
Maximum Start Amps	(2)	A	332	397	318
Recommended Mains Fuse Size		A	160	160	160
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator Pad Heater Rating		W	80	80	80
External Trace Heating Available (fitted by others)		W	500	500	500
Condenser Fan - Per Fan (AC)					
Quantity			4	4	4
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.27	1.27	1.27
Condenser Fan - Per Fan (EC)					
Quantity			4	4	4
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 24.5	31.0 / 48.2	31.0 / 31.0
Quantity			2 + 1	2 + 1	2 + 2
Motor Rating		kW	18.8 / 28.2	18.8 / 28.2	13.7 / 18.8
Sump Heater Rating		W	131 + 75	130 + 75	75
Start Amps (2)		A	215 / 260	215 / 320	215 / 215
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	28.5	28.5
Circuit 2 Comp RLA (PFC)			42.8	42.8	28.5
Nominal Run Amps		A	109.0	114.0	122.4
Maximum Start Amps		A	386.2	391.2	309.3
Compressor Nominal Run Amps		A	28.1 / 42.8	28.1 / 42.8	28.1 / 28.1
Recommended Mains Fuse Size		A	160	160	160
Electronic Soft-start					
Nominal Run Amps		A	120.11	125.11	133.8
Maximum Start Amps		A	228	269	232
Recommended Mains Fuse		A	160	160	160
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	109.0	114.0	122.4
Maximum Start Amps		A	258	263	223
Compressor Nominal Run Amps		A	28.1 / 42.8	28.1 / 42.8	28.1 / 28.1
Recommended Mains Fuse Size		A	160	160	160
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	5	5	5
Unit Nominal Run Amps		A	125	130	139
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.6	6.6	6.6
Unit Nominal Run Amps		A	127	132	140
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	3	3
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	4.5	4.5	4.5
Unit Nominal Run Amps		A	125	130	138
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	2.2	2.2	2.2
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	126	131	140
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	3	3

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC022DX-06AKK0	DCC024DX-06BKL0	DCC025DX-08BKL0
Nominal Run Amps	(1)	A	139	153	158
Maximum Start Amps	(2)	A	323	338	343
Recommended Mains Fuse Size		A	200	200	200
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	6	8
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.27	1.27	1.27
Condenser Fan - Per Fan (EC)					
Quantity			6	6	8
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 31.0	31.0 / 38.3	31.0 / 38.3
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	18.5 / 18.5	18.5 / 24.0	18.5 / 24.0
Sump Heater Rating		W	75	75	75
Start Amps (2)		A	215 / 215	260 / 215	260 / 215
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			28.5	28.5	28.5
Nominal Run Amps		A	127.4	139.6	144.6
Maximum Start Amps		A	314.3	326.5	331.5
Compressor Nominal Run Amps		A	28.1 / 28.1	28.1 / 34.2	28.1 / 34.2
Recommended Mains Fuse Size		A	200	200	200
Electronic Soft-start		A	138.8	153.48	158.48
Nominal Run Amps		A	237	252	257
Maximum Start Amps		A	200	200	200
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	127.4	139.6	144.6
Maximum Start Amps		A	228	240	245
Compressor Nominal Run Amps		A	28.1 / 28.1	28.1 / 34.2	28.1 / 34.2
Recommended Mains Fuse Size		A	200	200	200
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.2	6.2	6.2
Unit Nominal Run Amps		A	145	160	165
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	3	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	148	162	167
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	4	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	8.0	8.0
Unit Nominal Run Amps		A	145	161	166
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	3	4	4
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	11.2	11.2
Unit Nominal Run Amps		A	147	165	170
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	4	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC027DX-06BLLO	DCC028DX-08BLLO	DCC030DX-06BLMO
Nominal Run Amps	(1)	A	168	173	188
Maximum Start Amps	(2)	A	390	395	460
Recommended Mains Fuse Size		A	250	250	250
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			6	8	6
Quantity		A	2.5	2.5	2.5
Full Load Amps		A	8.8	8.8	8.8
Locked Rotor Amps		kW	1.27	1.27	1.27
Motor Rating					
Condenser Fan - Per Fan (EC)			6	8	6
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 38.3	38.3 / 38.3	48.2 / 38.3
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	22.5 / 24.0	22.5 / 24.0	28.2 / 24.0
Sump Heater Rating		W	75	75	130 + 75
Start Amps (2)		A	260 / 260	260 / 260	320 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	36.5	42.8
Circuit 2 Comp RLA (PFC)			36.5	36.5	36.5
Nominal Run Amps		A	151.8	156.8	169.0
Maximum Start Amps		A	377.6	382.6	446.2
Compressor Nominal Run Amps		A	34.2 / 34.2	34.2 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	200	250	250
Electronic Soft-start		A	168.16	173.16	188
Nominal Run Amps		A	286	291	332
Maximum Start Amps		A	200	250	250
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	151.8	156.8	169.0
Maximum Start Amps		A	274	279	318
Compressor Nominal Run Amps		A	34.2 / 34.2	34.2 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	200	250	250
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.2	6.2	6.2
Unit Nominal Run Amps		A	174	179	194
Recommended Mains Fuse Size		A	200	250	250
Motor Rating		kW	3	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	177	182	197
Recommended Mains Fuse Size		A	200	250	250
Motor Rating		kW	4	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.0	8.0	11.2
Unit Nominal Run Amps		A	176	181	199
Recommended Mains Fuse Size		A	200	250	250
Motor Rating		kW	4	4	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	179	184	199
Recommended Mains Fuse Size		A	200	250	250
Motor Rating		kW	5.5	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC031DX-08BLMO	DCC032DX-06BMMO	DCC033DX-08BMMO
Nominal Run Amps	(1)	A	188	208	213
Maximum Start Amps	(2)	A	460	480	485
Recommended Mains Fuse Size		A	250	250	250
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	6	8
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.27	1.27	1.27
Condenser Fan - Per Fan (EC)					
Quantity			6	6	8
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 38.3	48.2 / 48.2	48.2 / 48.2
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	28.2 / 24.0	28.2 / 28.2	28.2 / 28.2
Sump Heater Rating		W	130 + 75	130	130
Start Amps (2)		A	320 / 260	320 / 260	320 / 320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	42.8	42.8
Circuit 2 Comp RLA (PFC)			36.5	42.8	42.8
Nominal Run Amps		A	169.0	186.3	191.3
Maximum Start Amps		A	446.2	463.4	468.4
Compressor Nominal Run Amps		A	42.8 / 34.2	42.8 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250	250
Electronic Soft-start					
Nominal Run Amps		A	188	207.84	212.84
Maximum Start Amps		A	332	352	357
Recommended Mains Fuse		A	250	250	250
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	169.0	186.3	191.3
Maximum Start Amps		A	318	335	340
Compressor Nominal Run Amps		A	42.8 / 34.2	42.8 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250	250
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.2	6.2	6.2
Unit Nominal Run Amps		A	194	214	219
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	3	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	197	217	222
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	4	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	199	219	224
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	199	219	224
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC036DX-08BMS0	DCC038DX-10BMS0	DCC039DX-08BSS0
Nominal Run Amps	(1)	A	231	236	250
Maximum Start Amps	(2)	A	503	508	471
Recommended Mains Fuse Size		A	315	315	315
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			8	10	8
Quantity		A	2.5	2.5	2.5
Full Load Amps		A	8.8	8.8	8.8
Locked Rotor Amps		kW	1.27	1.27	1.27
Motor Rating					
Condenser Fan - Per Fan (EC)			8	10	8
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 48.2	38.3 / 48.2	38.3 / 38.3
Quantity			3 + 2	3 + 2	3 + 3
Motor Rating		kW	22.5 / 28.2	22.5 / 28.2	22.5 / 22.5
Sump Heater Rating		W	130 + 75	130 + 75	75
Start Amps (2)		A	260 / 320	260 / 320	260 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			42.8	42.8	36.5
Nominal Run Amps		A	208.2	213.2	225.2
Maximum Start Amps		A	485.4	490.4	451.0
Compressor Nominal Run Amps		A	34.2 / 42.8	34.2 / 42.8	34.2 / 34.2
Recommended Mains Fuse Size		A	315	315	315
Electronic Soft-start					
Nominal Run Amps		A	231.29	236.29	249.74
Maximum Start Amps		A	375	380	367
Recommended Mains Fuse		A	315	315	315
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	208.2	213.2	225.2
Maximum Start Amps		A	357	362	347
Compressor Nominal Run Amps		A	34.2 / 42.8	34.2 / 42.8	34.2 / 34.2
Recommended Mains Fuse Size		A	315	315	315
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	12
Unit Nominal Run Amps		A	240	245	262
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	4	4	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	14
Unit Nominal Run Amps		A	243	248	264
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	5.5	5.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	242	247	261
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	242	247	261
Recommended Mains Fuse Size		A	315	315	315
Motor Rating		kW	5.5	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC042DX-12BSS0	DCC043DX-08BST0	DCC045DX-12BST0
Nominal Run Amps	(1)	A	260	280	290
Maximum Start Amps	(2)	A	481	551	561
Recommended Mains Fuse Size		A	315	315	355
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator Pad Heater Rating		W	100	100	100
External Trace Heating Available (fitted by others)		W	500	500	500
Condenser Fan - Per Fan (AC)					
Quantity			12	8	12
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.27	1.27	1.27
Condenser Fan - Per Fan (EC)					
Quantity			12	8	12
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 38.3	48.2 / 38.3	48.2 / 38.3
Quantity			3 + 3	3 + 3	3 + 3
Motor Rating		kW	22.5 / 22.5	28.2 / 22.5	28.2 / 24.0
Sump Heater Rating			75	130 + 75	130 + 75
Start Amps (2)		A	260 / 260	320 / 260	320 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	42.8	42.8
Circuit 2 Comp RLA (PFC)			36.5	36.5	36.5
Nominal Run Amps		A	235.2	251.0	261.0
Maximum Start Amps		A	461.0	528.2	538.2
Compressor Nominal Run Amps		A	34.2 / 34.2	42.8 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	315	315	355
Electronic Soft-start					
Nominal Run Amps		A	259.74	279.5	289.5
Maximum Start Amps		A	377	375	385
Recommended Mains Fuse		A	315	315	355
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	235.2	251.0	261.0
Maximum Start Amps		A	357	357	367
Compressor Nominal Run Amps		A	34.2 / 34.2	42.8 / 34.2	42.8 / 34.2
Recommended Mains Fuse Size		A	315	315	355
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	12
Unit Nominal Run Amps		A	272	292	302
Recommended Mains Fuse Size		A	315	355	355
Motor Rating		kW	5.5	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14	14	14
Unit Nominal Run Amps		A	274	264	304
Recommended Mains Fuse Size		A	315	355	355
Motor Rating		kW	7.5	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	271	291	301
Recommended Mains Fuse Size		A	315	355	355
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	14.8	14.8
Unit Nominal Run Amps		A	271	294	304
Recommended Mains Fuse Size		A	315	355	355
Motor Rating		kW	5.5	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCC046DX-10BTT0	DCC048DX-12BTT0	DCC051DX-10BVV0
Nominal Run Amps	(1)	A	314	319	356
Maximum Start Amps	(2)	A	586	591	568
Recommended Mains Fuse Size		A	355	355	400
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			10	12	10
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.27	1.27	1.27
Condenser Fan - Per Fan (EC)					
Quantity			10	12	10
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 48.2	48.2 / 48.2	55.2 / 55.2
Quantity			3 + 3	3 + 3	3 + 3
Motor Rating		kW	28.2 / 28.2	28.2 / 28.2	33.1 / 33.1
Sump Heater Rating		W	130	130	140
Start Amps (2)		A	320 / 320	320 / 320	267 / 267
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	42.8	50.3
Circuit 2 Comp RLA (PFC)			42.8	42.8	50.3
Nominal Run Amps		A	281.9	286.9	326.7
Maximum Start Amps		A	559.1	564.1	543.5
Compressor Nominal Run Amps		A	42.8 / 42.8	42.8 / 42.8	50.3 / 50.3
Recommended Mains Fuse Size		A	355	355	400
Electronic Soft-start		A	314.26	319.26	356.2
Nominal Run Amps		A	458	463	461
Maximum Start Amps		A	355	355	400
Recommended Mains Fuse					
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	281.9	286.9	326.7
Maximum Start Amps		A	431	436	437
Compressor Nominal Run Amps		A	42.8 / 42.8	42.8 / 42.8	50.3 / 50.3
Recommended Mains Fuse Size		A	355	355	400
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	12
Unit Nominal Run Amps		A	326	331	368
Recommended Mains Fuse Size		A	355	355	450
Motor Rating		kW	5.5	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14	14	14
Unit Nominal Run Amps		A	328	333	370
Recommended Mains Fuse Size		A	355	355	450
Motor Rating		kW	7.5	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	325	330	367
Recommended Mains Fuse Size		A	355	355	450
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14.8	14.8	14.8
Unit Nominal Run Amps		A	329	334	371
Recommended Mains Fuse Size		A	355	355	450
Motor Rating		kW	7.5	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

DeltaChill Free Cool

Cooling Performance Free Cool

The Freecool potential of the DeltaChill can be determined by the temperature difference of the ambient air and the return water temperatures. The graphs show a temperature difference and therefore changing Freecool ability.

The cooling capacity is derived by multiplying the total number of fans on the unit by the values of flowrate and capacity.

Example

Return water temperature 15°C

Temperature difference from ambient to return water temperature 10°C


Therefore ambient 5°C

DCF014SR-04AL00 chiller having 4 fans equates to


Cooling capacity	35kW x 4	=	140kW*
Flowrate	2 l/s x 4	=	8 l/s*

*Exact cooling capacity and water flowrate may change for unit given above.


High Airflow EC Fans


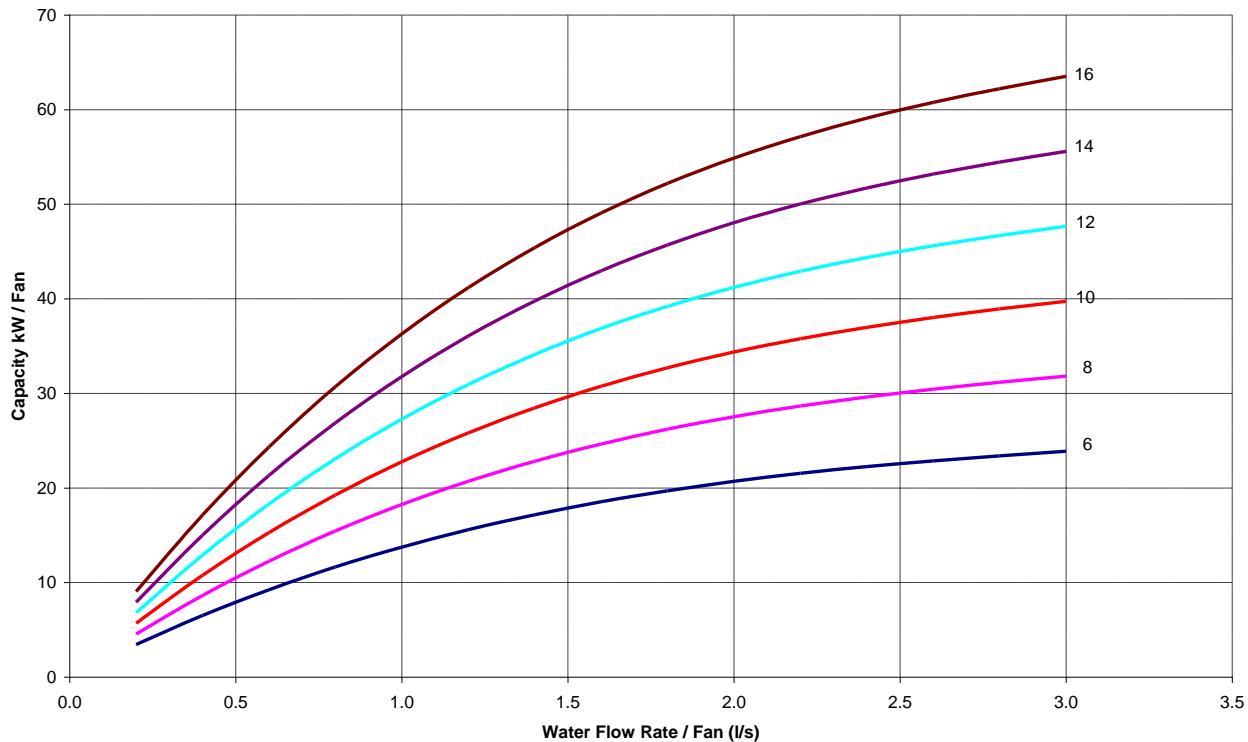


EC Fans Regular Quiet

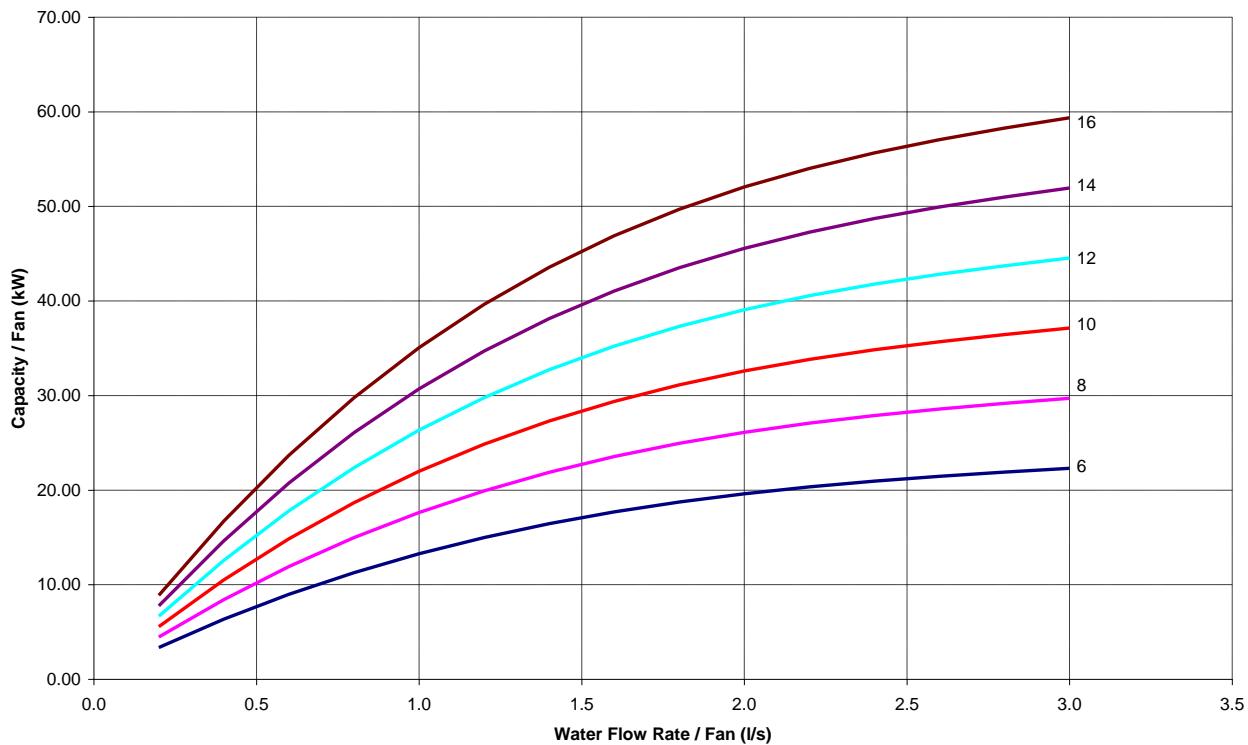

EC Fans Extra Quiet

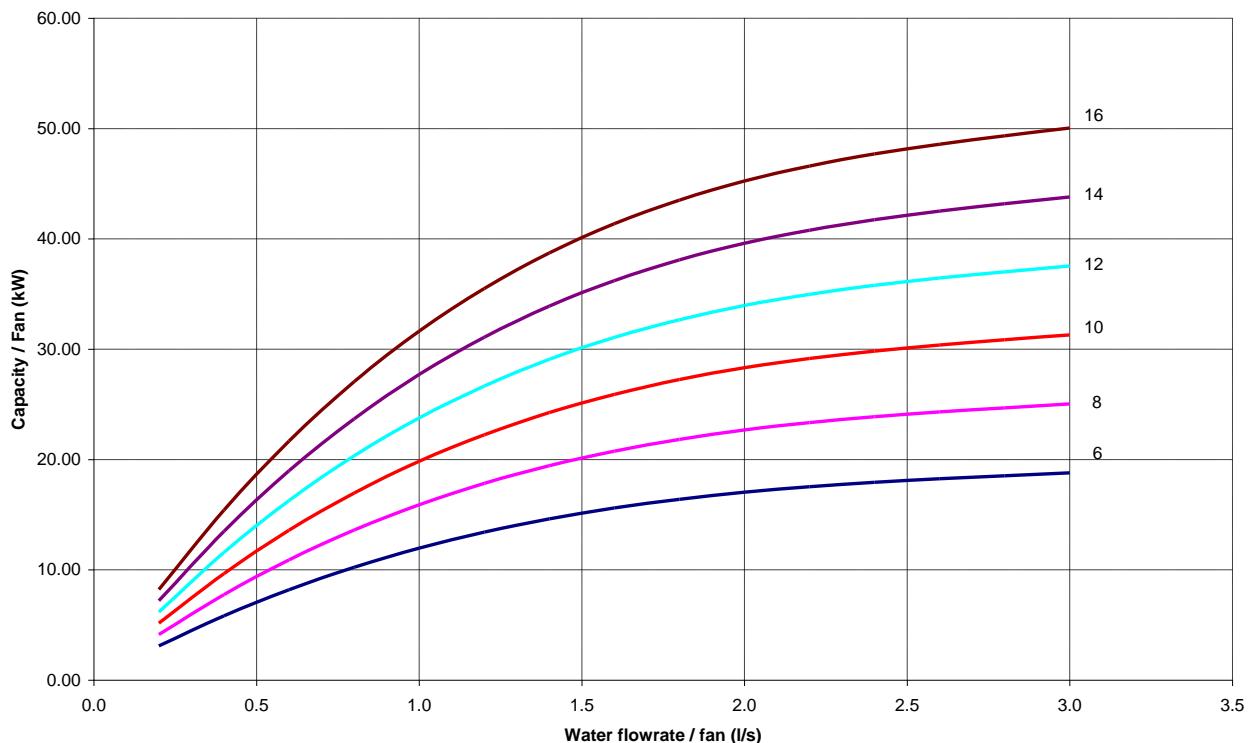

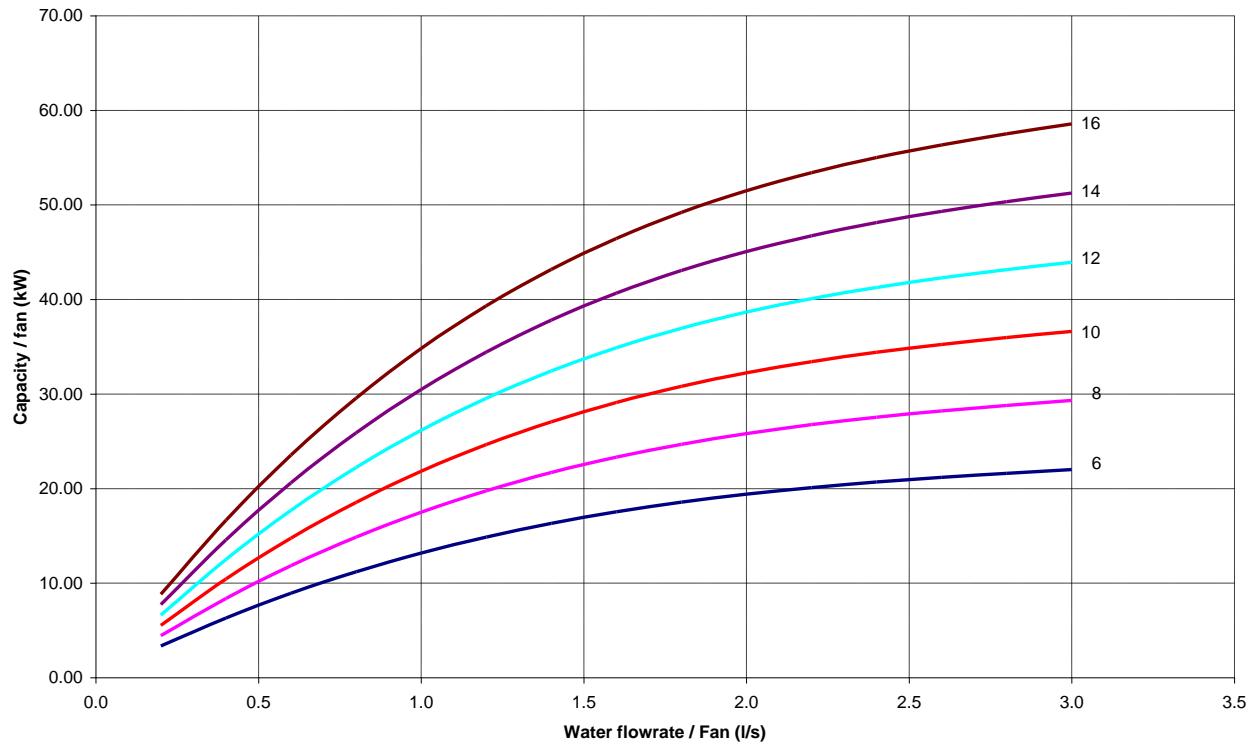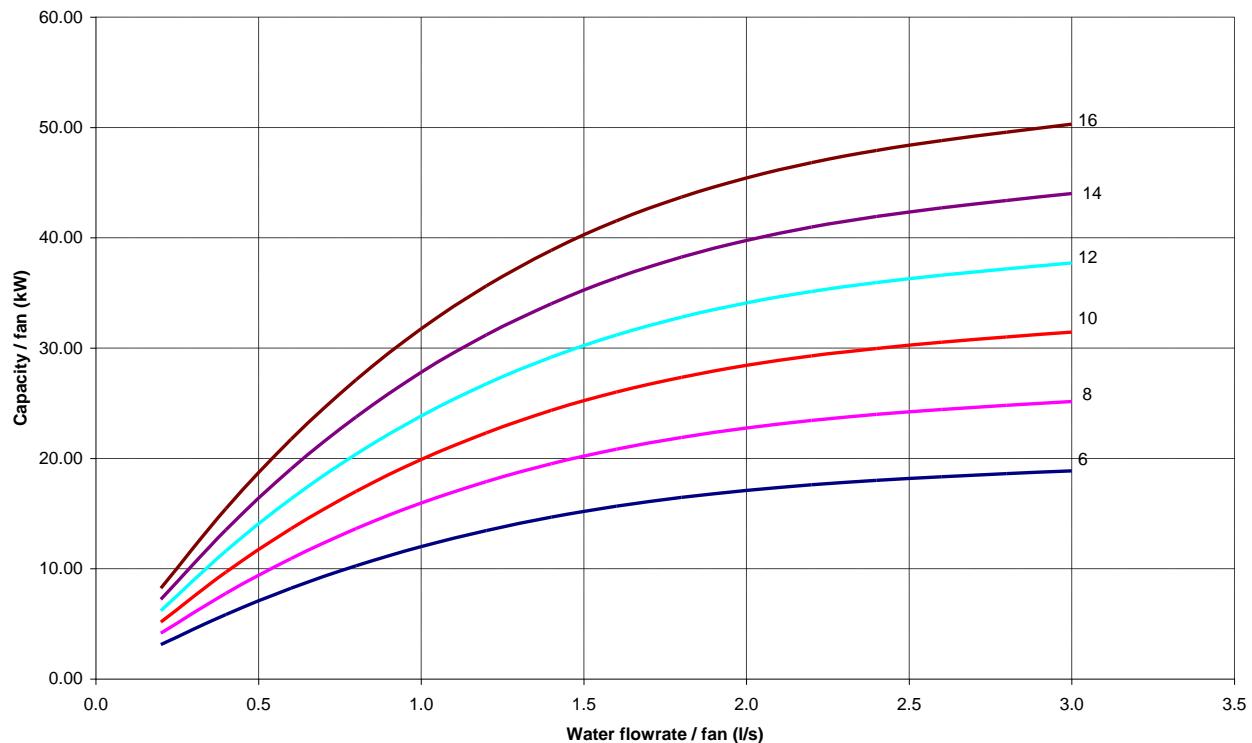AC Fans Regular noise level**AC Fans Extra Quiet**

Mechanical Cooling Performance AC Fans Regular

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF014SR-04AL00	6	149.4	38.3	142.1	41.8	134.1	45.8	125.5	50.2
	7	154.1	38.5	146.6	42.1	138.4	46.1	129.6	50.4
	8	158.9	38.8	151.1	42.4	142.7	46.3	133.7	50.7
	10	168.6	39.3	160.5	42.9	151.7	46.8	142.2	51.3
	12	178.7	39.8	170.1	43.4	160.9	47.4	150.9	51.8
	14	189.0	40.3	180.0	43.9	170.4	48.0	160.0	52.4
DCF017SR-04AM00	6	174.4	46.0	165.5	50.2	156.1	54.8	146.1	60.0
	7	179.7	46.4	170.6	50.6	161.0	55.2	150.7	60.4
	8	185.2	46.7	175.9	51.0	165.9	55.6	155.4	60.8
	10	196.5	47.5	186.6	51.7	176.1	56.4	165.1	61.6
	12	208.0	48.2	197.6	52.5	186.7	57.2	175.1	62.5
	14	219.9	49.0	209.1	53.4	197.3	58.0	185.4	63.3
DCF021SR-04BS00	6	213.8	62.1	203.0	67.8	191.6	74.1	179.4	81.1
	7	220.2	62.6	209.3	68.3	197.6	74.6	184.9	81.5
	8	226.9	63.0	215.7	68.8	203.7	75.1	190.4	81.9
	10	240.7	64.0	228.9	69.8	216.3	76.1	201.7	82.7
	12	254.8	65.0	242.5	70.8	229.3	77.1	213.4	83.6
	14	269.4	66.0	256.5	71.8	242.1	78.0	225.4	84.5
DCF025SR-06BT00	6	256.9	69.8	243.7	76.2	229.6	83.2	214.7	91.1
	7	264.8	70.3	251.2	76.7	236.8	83.8	221.4	91.7
	8	272.8	70.9	258.8	77.3	244.0	84.4	228.3	92.3
	10	289.3	72.0	274.5	78.5	258.9	85.6	242.5	93.5
	12	306.2	73.1	290.7	79.7	274.4	86.8	257.1	94.8
	14	323.6	74.3	307.4	80.9	289.9	88.0	272.1	96.1

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF013DR-04ACD0	6	137.7	35.5	131.0	38.5	123.8	42.0	116.0	45.8
	7	142.1	35.6	135.2	38.7	127.8	42.1	119.7	45.9
	8	146.5	35.8	139.4	38.9	131.9	42.3	123.5	46.1
	10	155.6	36.2	148.1	39.3	140.2	42.7	131.3	46.5
	12	164.9	36.7	157.1	39.7	148.7	43.1	139.2	46.8
	14	174.6	37.1	166.4	40.2	157.4	43.5	147.4	47.2
DCF014DR-04ADD0	6	152.6	40.5	145.0	43.9	136.7	47.5	127.7	51.6
	7	157.3	40.7	149.5	44.0	141.0	47.7	131.7	51.8
	8	162.1	40.9	154.1	44.2	145.3	47.9	135.8	52.0
	10	172.0	41.3	163.5	44.6	154.2	48.3	144.2	52.4
	12	182.1	41.7	173.2	45.0	163.4	48.7	152.8	52.8
	14	192.5	42.1	183.1	45.5	172.9	49.2	161.7	53.3
DCF015DR-04ADF0	6	165.6	44.2	157.0	47.9	147.7	51.9	137.7	56.3
	7	170.7	44.5	161.9	48.1	152.3	52.1	142.0	56.6
	8	175.9	44.7	166.8	48.4	156.9	52.4	146.3	56.9
	10	186.4	45.2	176.8	48.9	166.4	52.9	155.2	57.4
	12	197.2	45.7	187.1	49.4	176.2	53.5	164.4	58.0
	14	208.4	46.3	197.7	50.0	186.2	54.1	173.8	58.6
DCF016DR-04AJJ0	6	171.8	46.1	162.6	50.0	152.8	54.5	142.3	59.4
	7	177.2	46.3	167.7	50.3	157.7	54.7	146.9	59.7
	8	182.7	46.5	173.0	50.5	162.6	55.0	151.6	59.9
	10	193.9	47.1	183.6	51.1	172.7	55.5	161.0	60.5
	12	205.4	47.6	194.6	51.7	183.1	56.1	170.8	61.1
	14	217.2	48.2	205.8	52.2	193.3	56.8	180.8	61.8
DCF018DR-04BJK0	6	198.0	55.0	187.0	60.0	175.3	65.6	162.7	71.9
	7	204.0	55.3	192.6	60.4	180.6	66.0	167.8	72.3
	8	210.0	55.7	198.4	60.8	186.1	66.4	172.9	72.7
	10	222.4	56.5	210.2	61.6	197.1	67.2	183.2	73.5
	12	235.1	57.3	222.2	62.4	208.5	68.1	193.9	74.4
	14	248.1	58.2	234.5	63.3	220.2	69.0	204.8	75.3
DCF020DR-06BFK0	6	209.3	54.2	198.8	59.1	187.7	64.4	176.0	70.5
	7	215.9	54.6	205.1	59.4	193.7	64.8	181.6	70.7
	8	222.5	54.9	211.5	59.7	199.8	65.1	187.2	71.0
	10	236.2	55.6	224.5	60.4	212.3	65.8	198.8	71.7
	12	250.2	56.3	238.0	61.1	225.1	66.5	210.7	72.3
	14	264.8	57.0	252.0	61.8	238.1	67.1	223.0	73.0

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF023DR-06BKK0	6	236.0	61.4	223.6	67.0	210.5	73.2	196.6	80.2
	7	243.2	61.7	230.5	67.3	217.0	73.5	202.7	80.5
	8	250.5	62.1	237.5	67.6	223.7	73.9	209.0	80.9
	10	265.5	62.8	251.8	68.4	237.3	74.6	221.8	81.6
	12	281.0	63.6	266.6	69.2	251.3	75.4	235.1	82.4
	14	296.8	64.5	281.7	70.0	265.7	76.2	248.7	83.2
DCF026DR-06BKLO	6	267.1	72.1	252.7	78.3	237.4	85.3	220.8	93.1
	7	275.2	72.5	260.4	78.8	244.6	85.8	227.7	93.5
	8	283.4	72.9	268.3	79.2	252.0	86.2	234.6	94.0
	10	300.2	73.8	284.2	80.1	267.1	87.1	248.8	94.9
	12	317.4	74.8	300.6	81.1	282.7	88.1	263.4	95.9
	14	335.1	75.8	317.5	82.1	298.6	89.1	278.4	96.9
DCF029DR-06BLL0	6	292.9	82.5	277.1	89.5	260.0	97.2	241.4	105.8
	7	301.7	83.0	285.5	90.0	267.8	97.7	248.7	106.3
	8	310.6	83.5	293.9	90.5	275.8	98.3	256.1	106.9
	10	328.8	84.5	311.2	91.6	292.1	99.4	271.4	108.0
	12	347.5	85.6	328.9	92.7	308.8	100.5	287.0	109.2
	14	366.6	86.7	347.0	93.8	325.9	101.7	303.0	110.4
DCF032DR-08BLMO	6	328.7	88.4	311.7	95.7	293.3	103.7	273.4	112.6
	7	338.7	88.9	321.2	96.2	302.3	104.3	281.9	113.2
	8	348.9	89.4	330.9	96.7	311.5	104.8	290.5	113.7
	10	369.7	90.4	350.7	97.8	330.2	105.9	308.0	114.8
	12	391.1	91.4	371.1	98.8	349.5	107.0	326.1	116.0
	14	413.0	92.4	392.0	99.9	369.2	108.1	344.7	117.2
DCF035DR-08BMM0	6	350.7	95.3	332.2	103.2	312.3	111.9	290.9	121.5
	7	361.3	95.8	342.2	103.8	321.8	112.5	299.8	122.2
	8	372.0	96.4	352.4	104.5	331.4	113.2	308.8	122.8
	10	393.9	97.7	373.2	105.7	351.0	114.5	327.1	124.2
	12	416.3	98.9	394.5	107.1	371.1	115.9	346.0	125.7
	14	439.4	100.2	416.4	108.4	391.8	117.3	365.4	127.1
DCF039DR-10BMS0	6	405.2	109.1	384.1	118.1	361.3	128.1	336.7	139.0
	7	417.5	109.7	395.9	118.7	372.5	128.7	347.2	139.7
	8	430.1	110.2	407.9	119.4	383.8	129.3	357.8	140.3
	10	455.8	111.4	432.3	120.6	407.0	130.6	379.5	141.7
	12	482.3	112.7	457.5	121.9	430.8	132.0	401.9	143.1
	14	509.4	113.9	483.4	123.2	455.2	133.4	424.9	144.5
DCF044DR-10BSS0	6	444.9	123.0	421.4	133.3	396.0	144.7	368.4	157.3
	7	458.4	123.6	434.3	134.0	408.1	145.4	379.7	158.1
	8	472.1	124.3	447.4	134.7	420.5	146.1	391.3	158.8
	10	500.2	125.7	474.0	136.1	445.7	147.6	414.9	160.4
	12	529.0	127.1	501.4	137.6	471.6	149.2	439.2	161.9
	14	558.5	128.6	529.5	139.1	498.1	150.7	464.2	163.6

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling Performance AC Fans Extra Quiet

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF014SX-04AL00	6	148.9	39.9	141.1	43.3	132.5	47.2	123.1	51.4
	7	153.5	40.1	145.4	43.6	136.5	47.4	126.9	51.7
	8	158.1	40.3	149.8	43.8	140.7	47.7	130.8	51.9
	10	167.5	40.8	158.7	44.3	149.1	48.2	138.7	52.5
	12	177.2	41.3	167.9	44.8	157.8	48.7	146.8	53.0
	14	187.1	41.8	177.3	45.3	166.7	49.2	155.1	53.6
DCF017SX-04AM00	6	171.9	47.4	162.3	51.5	151.9	56.0	140.8	61.1
	7	177.0	47.8	167.1	51.9	156.4	56.4	145.0	61.5
	8	182.2	48.1	172.0	52.3	161.0	56.8	149.2	61.9
	10	192.7	48.9	181.9	53.1	170.3	57.6	157.8	62.7
	12	203.4	49.6	192.0	53.9	179.8	58.5	166.7	63.6
	14	214.4	50.4	202.4	54.7	189.5	59.4	175.8	64.5
DCF021SX-06BS00	6	220.0	59.8	208.4	65.0	195.8	70.7	182.1	77.1
	7	226.6	60.1	214.7	65.3	201.8	71.1	187.6	77.5
	8	233.4	60.5	221.2	65.7	207.8	71.5	193.3	77.9
	10	247.2	61.1	234.3	66.4	220.2	72.2	204.9	78.7
	12	261.4	61.8	247.8	67.1	232.9	73.0	216.8	79.5
	14	276.0	62.6	261.6	67.9	246.0	73.8	229.1	80.3
DCF025SX-06BT00	6	253.3	71.9	238.9	78.1	223.5	85.0	206.8	92.7
	7	260.7	72.4	246.0	78.7	230.0	85.6	212.9	93.3
	8	268.3	73.0	253.1	79.3	236.7	86.2	219.1	93.9
	10	283.7	74.1	267.6	80.4	250.3	87.4	231.7	95.2
	12	299.4	75.2	282.4	81.6	264.2	88.7	244.7	96.5
	14	315.5	76.4	297.6	82.9	278.4	90.0	257.9	97.8

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling Performance AC Fans Extra Quiet

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF013DX-04ACD0	6	135.9	34.7	128.8	37.7	121.1	41.2	112.8	45.0
	7	140.1	34.9	132.8	37.9	124.9	41.4	116.4	45.2
	8	144.4	35.1	136.9	38.1	128.7	41.6	120.0	45.4
	10	153.1	35.5	145.1	38.6	136.6	42.0	127.3	45.9
	12	162.0	35.9	153.6	39.0	144.6	42.5	134.9	46.3
	14	171.2	36.4	162.3	39.5	152.9	42.9	142.7	46.8
DCF014DX-04ADD0	6	149.4	39.7	141.6	43.1	133.0	46.9	123.7	51.1
	7	154.0	39.9	145.9	43.3	137.1	47.2	127.5	51.4
	8	158.6	40.1	150.3	43.6	141.3	47.4	131.4	51.6
	10	168.0	40.6	159.3	44.1	149.7	47.9	139.3	52.2
	12	177.7	41.1	168.5	44.6	158.4	48.4	147.5	52.7
	14	187.7	41.6	177.9	45.1	167.3	49.0	155.9	53.3
DCF015DX-04ADF0	6	161.7	43.7	152.8	47.4	143.3	51.6	132.9	56.2
	7	166.5	44.0	157.4	47.7	147.6	51.9	136.9	56.6
	8	171.5	44.2	162.1	48.0	152.0	52.2	141.0	56.9
	10	181.5	44.9	171.6	48.7	160.9	52.9	149.3	57.6
	12	191.8	45.5	181.4	49.3	170.1	53.6	157.9	58.3
	14	202.3	46.1	191.3	50.0	179.4	54.3	166.7	59.0
DCF016DX-04AJJ0	6	167.4	45.7	158.0	49.9	147.9	54.5	137.2	59.7
	7	172.6	46.0	162.9	50.2	152.6	54.8	141.5	60.0
	8	177.8	46.3	167.8	50.5	157.2	55.1	145.8	60.3
	10	188.4	46.9	178.0	51.1	166.7	55.8	154.7	61.0
	12	199.4	47.6	188.3	51.9	176.5	56.6	163.8	61.8
	14	210.5	48.3	198.9	52.6	186.4	57.3	173.1	62.6
DCF018DX-04BJK0	6	191.7	55.6	180.4	60.9	168.3	66.9	155.3	73.5
	7	197.3	56.1	185.7	61.4	173.3	67.3	160.0	74.0
	8	202.9	56.6	191.1	61.9	178.2	67.9	164.7	74.5
	10	214.6	57.5	202.0	62.9	188.6	68.9	174.2	75.5
	12	226.5	58.5	213.2	63.9	199.1	69.9	183.9	76.6
	14	238.6	59.5	224.6	65.0	209.8	71.0	193.9	77.8
DCF020DX-06BFK0	6	206.4	53.3	195.4	58.1	183.7	63.5	171.1	69.5
	7	212.7	53.6	201.4	58.4	189.3	63.8	176.4	69.9
	8	219.0	53.9	207.5	58.8	195.1	64.2	181.8	70.2
	10	232.0	54.6	219.8	59.5	206.8	64.9	192.7	71.0
	12	245.4	55.3	232.6	60.2	218.8	65.7	204.0	71.8
	14	259.1	56.1	245.6	61.0	231.2	66.5	215.7	72.6
DCF023DX-06BKK0	6	230.6	60.4	218.0	66.2	204.6	72.8	190.3	80.1
	7	237.5	60.8	224.6	66.6	210.9	73.2	196.2	80.5
	8	244.6	61.2	231.3	67.0	217.2	73.6	202.1	80.9
	10	258.9	62.1	245.0	67.9	230.1	74.5	214.2	81.8
	12	273.7	63.0	259.0	68.8	243.4	75.4	226.7	82.8
	14	288.8	64.0	273.4	69.8	257.0	76.4	239.5	83.8

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25	30	35	40	Output kW	Input kW	Output kW	Input kW
DCF026DX-08BKL0	6	270.4	69.6	256.2	75.8	240.8	82.7	224.3	90.4
	7	278.7	70.0	264.1	76.2	248.3	83.1	231.3	90.8
	8	287.1	70.4	272.1	76.6	255.9	83.5	238.4	91.2
	10	304.3	71.2	288.4	77.4	271.3	84.3	252.9	92.1
	12	321.9	72.1	305.2	78.3	287.3	85.2	267.9	93.0
	14	340.1	73.0	322.5	79.2	303.6	86.2	283.3	94.0
DCF029DX-08BLL0	6	296.9	79.7	281.3	86.6	264.2	94.3	245.6	102.8
	7	305.9	80.2	289.8	87.1	272.2	94.8	253.1	103.3
	8	315.1	80.6	298.5	87.6	280.4	95.2	260.8	103.8
	10	333.7	81.5	316.2	88.5	297.2	96.3	276.4	104.8
	12	352.9	82.5	334.5	89.5	314.3	97.3	292.5	105.9
	14	372.6	83.5	353.1	90.6	332.0	98.4	309.1	107.1
DCF032DX-08BLM0	6	321.0	87.3	303.5	94.8	284.5	103.2	264.0	112.5
	7	330.5	87.9	312.5	95.4	293.0	103.8	271.9	113.1
	8	340.3	88.4	321.8	96.1	301.7	104.5	280.0	113.8
	10	360.1	89.6	340.5	97.3	319.3	105.8	296.5	115.1
	12	380.4	90.9	359.8	98.6	337.4	107.1	313.4	116.6
	14	401.2	92.2	379.5	100.0	356.0	108.5	330.7	118.0
DCF035DX-08BMM0	6	341.7	94.7	322.7	102.9	302.2	111.9	280.1	122.0
	7	351.7	95.4	332.2	103.6	311.1	112.7	288.4	122.8
	8	361.9	96.1	341.8	104.4	320.1	113.5	296.8	123.6
	10	382.7	97.6	361.4	105.9	338.5	115.1	313.9	125.3
	12	404.0	99.1	381.5	107.5	357.3	116.8	331.4	127.0
	14	425.7	100.6	402.0	109.2	376.6	118.5	349.4	128.8
DCF039DX-10BMS0	6	395.8	107.4	374.2	116.7	350.8	127.0	325.5	138.4
	7	407.6	108.1	385.5	117.4	361.4	127.7	335.4	139.2
	8	419.7	108.8	396.9	118.2	372.1	128.5	345.4	140.0
	10	444.2	110.3	420.1	119.7	394.0	130.1	365.8	141.6
	12	469.4	111.8	444.0	121.3	416.4	131.7	386.8	143.3
	14	495.2	113.3	468.4	122.9	439.4	133.4	408.3	145.1
DCF044DX-12BSS0	6	444.6	119.8	421.1	130.2	395.4	141.7	367.4	154.5
	7	458.1	120.5	433.9	130.9	407.5	142.4	378.7	155.2
	8	471.8	121.2	446.9	131.6	419.8	143.2	390.2	156.0
	10	499.8	122.5	473.5	133.0	444.8	144.7	413.7	157.6
	12	528.6	124.0	500.8	134.5	470.6	146.3	437.8	159.2
	14	558.1	125.5	528.8	136.1	497.0	147.9	462.6	160.9

¹ Output kW refers to the chilled water duty.² Input kW refers to the unit input power (compressor + fans).³ Duties applicable for chilled water ΔT between 4 and 8°C.⁴ Interpolate for water temperatures between those quoted, do not extrapolate.⁵ Water flow rate (l/s) = Output ÷ (Cp x ΔT)⁶ For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling EC Fans Regular Quiet

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF014SR-04AL00	6	149.2	38.5	141.9	42.1	134.0	46.1	125.4	50.5
	7	153.9	38.8	146.4	42.3	138.2	46.3	129.5	50.7
	8	158.7	39.0	150.9	42.6	142.6	46.6	133.6	51.0
	10	168.4	39.5	160.3	43.1	151.5	47.1	142.0	51.6
	12	178.5	40.1	169.9	43.7	160.7	47.7	150.8	52.2
	14	188.8	40.6	179.9	44.2	170.2	48.3	159.9	52.7
DCF017SR-04AM00	6	174.2	46.3	165.3	50.5	156.0	55.1	146.0	60.3
	7	179.6	46.7	170.5	50.9	160.8	55.5	150.6	60.7
	8	185.1	47.0	175.7	51.3	165.8	55.9	155.4	61.1
	10	196.3	47.8	186.4	52.1	176.0	56.7	165.0	62.0
	12	207.8	48.6	197.5	52.9	186.6	57.6	175.1	62.8
	14	219.8	49.4	208.9	53.7	197.5	58.5	185.4	63.7
DCF021SR-04BS00	6	213.8	62.5	203.0	68.2	191.1	74.3	177.4	80.7
	7	220.4	63.0	209.3	68.7	196.9	74.7	182.7	81.2
	8	227.0	63.5	215.8	69.2	202.7	75.1	188.2	81.6
	10	240.8	64.4	228.7	70.1	214.6	76.0	199.3	82.5
	12	254.9	65.4	241.6	70.9	226.8	76.9	210.7	83.4
	14	269.4	66.4	254.9	71.8	239.3	77.8	222.4	84.3
DCF025SR-06BT00	6	256.7	70.2	243.5	76.6	229.4	83.7	214.6	91.6
	7	264.6	70.8	251.0	77.2	236.6	84.3	221.4	92.2
	8	272.6	71.3	258.6	77.8	243.9	84.9	228.3	92.8
	10	289.0	72.4	274.3	78.9	258.8	86.1	242.4	94.1
	12	306.0	73.6	290.6	80.2	274.3	87.3	257.1	95.4
	14	323.4	74.8	307.3	81.4	290.2	88.6	272.3	96.7

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling EC Fans Regular Quiet

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF013DR-04ACD0	6	135.6	33.1	128.9	36.3	121.7	39.8	114.0	43.8
	7	139.8	33.3	132.9	36.5	125.6	40.1	117.7	44.1
	8	144.1	33.5	137.1	36.7	129.5	40.3	121.5	44.3
	10	153.0	34.0	145.6	37.2	137.7	40.8	129.2	44.8
	12	162.2	34.5	154.4	37.7	146.1	41.3	137.2	45.3
	14	171.6	35.0	163.4	38.2	154.8	41.8	145.5	45.8
DCF014DR-04ADDO	6	149.7	38.3	142.4	41.9	134.5	45.8	125.9	50.2
	7	154.3	38.6	146.9	42.1	138.8	46.1	130.0	50.5
	8	159.1	38.8	151.4	42.4	143.1	46.3	134.2	50.7
	10	168.9	39.3	160.8	42.9	152.1	46.9	142.7	51.3
	12	179.0	39.8	170.5	43.4	161.3	47.4	151.5	51.9
	14	189.3	40.4	180.4	44.0	170.9	48.0	160.5	52.4
DCF015DR-04ADF0	6	163.0	42.4	154.8	46.3	146.1	50.6	136.7	55.4
	7	168.1	42.7	159.7	46.6	150.7	50.9	141.1	55.7
	8	173.2	43.0	164.6	46.9	155.4	51.3	145.6	56.1
	10	183.8	43.7	174.7	47.6	165.0	52.0	154.7	56.8
	12	194.7	44.3	185.2	48.3	175.0	52.7	164.2	57.5
	14	206.0	45.0	196.1	49.0	185.3	53.4	174.0	58.3
DCF016DR-04AJJ0	6	169.4	44.6	160.7	48.8	151.5	53.5	141.9	58.8
	7	174.8	44.9	165.9	49.1	156.5	53.8	146.6	59.2
	8	180.3	45.2	171.2	49.4	161.6	54.2	151.4	59.5
	10	191.6	45.8	182.0	50.1	171.9	54.9	161.3	60.2
	12	203.3	46.5	193.2	50.8	182.6	55.6	171.5	61.0
	14	215.3	47.2	204.7	51.5	193.6	56.4	182.0	61.7
DCF018DR-04BJK0	6	197.8	54.3	187.4	59.5	176.1	65.1	164.1	71.5
	7	203.9	54.7	193.2	59.9	181.6	65.5	169.3	71.9
	8	210.2	55.1	199.0	60.3	187.1	66.0	174.5	72.3
	10	222.9	56.0	211.0	61.1	198.5	66.8	185.3	73.2
	12	235.8	56.8	223.4	62.0	210.3	67.7	196.3	74.1
	14	249.1	57.7	236.0	62.9	222.3	68.6	207.7	75.0
DCF020DR-06BFK0	6	206.2	50.9	195.9	55.9	184.9	61.5	173.2	67.7
	7	212.6	51.3	202.0	56.3	190.8	61.9	178.8	68.1
	8	219.1	51.6	208.3	56.7	196.7	62.2	184.4	68.5
	10	232.5	52.4	221.1	57.4	208.9	63.0	196.1	69.3
	12	246.2	53.2	234.3	58.2	221.6	63.8	208.1	70.1
	14	260.4	54.0	247.9	59.1	234.6	64.7	220.5	70.9
DCF023DR-06BKK0	6	231.9	58.5	220.1	64.5	207.8	71.1	194.7	78.7
	7	239.0	58.9	227.0	64.9	214.3	71.6	201.0	79.1
	8	246.3	59.4	234.0	65.3	221.0	72.0	207.4	79.5
	10	261.2	60.3	248.3	66.2	234.8	72.9	220.5	80.4
	12	276.5	61.2	263.2	67.2	249.0	73.9	234.0	81.4
	14	292.4	62.2	278.4	68.2	263.6	74.8	248.0	82.4

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF026DR-06BKLO	6	264.1	70.1	250.7	76.8	236.5	84.2	221.4	92.6
	7	272.3	70.6	258.5	77.3	244.0	84.8	228.6	93.1
	8	280.6	71.1	266.5	77.8	251.6	85.3	235.7	93.6
	10	297.5	72.2	282.9	78.9	267.3	86.4	250.3	94.6
	12	315.1	73.3	299.8	80.0	283.5	87.6	265.2	95.6
	14	333.2	74.5	317.1	81.2	300.0	88.7	280.7	96.7
DCF029DR-06BLL0	6	291.2	81.4	276.6	88.8	261.0	97.0	244.3	106.2
	7	300.2	81.9	285.2	89.4	269.2	97.6	252.2	106.8
	8	309.3	82.5	293.9	90.0	277.6	98.3	259.9	107.4
	10	328.1	83.7	312.0	91.2	294.8	99.6	275.6	108.5
	12	347.4	85.0	330.5	92.5	312.6	100.9	291.6	109.6
	14	367.3	86.3	349.7	93.8	330.7	102.1	308.1	110.7
DCF032DR-08BLMO	6	323.5	84.8	307.3	92.6	290.0	101.2	271.4	110.8
	7	333.5	85.4	316.9	93.2	299.1	101.8	280.1	111.4
	8	343.7	86.0	326.6	93.8	308.4	102.5	288.9	112.1
	10	364.5	87.3	346.6	95.2	327.4	103.8	307.0	113.5
	12	386.1	88.6	367.2	96.5	347.1	105.2	325.7	115.0
	14	408.2	89.9	388.8	98.0	367.4	106.7	345.0	116.4
DCF035DR-08BMM0	6	346.1	92.4	328.6	100.8	310.0	110.1	290.3	120.5
	7	356.7	93.1	338.7	101.6	319.6	110.9	299.5	121.3
	8	367.5	93.9	349.0	102.3	329.5	111.7	308.7	122.1
	10	389.7	95.4	370.2	103.9	349.7	113.3	327.9	123.8
	12	412.5	96.9	392.1	105.5	370.5	115.0	347.7	125.5
	14	436.1	98.5	414.6	107.1	392.1	116.7	368.3	127.2
DCF039DR-10BMS0	6	398.6	104.4	378.6	114.0	357.2	124.6	334.3	136.4
	7	411.0	105.1	390.5	114.8	368.5	125.4	345.0	137.3
	8	423.6	105.9	402.5	115.6	379.9	126.2	355.9	138.1
	10	449.4	107.4	427.2	117.1	403.5	127.9	378.2	139.8
	12	476.0	109.0	452.7	118.8	427.8	129.5	401.4	141.5
	14	503.4	110.6	478.9	120.4	452.9	131.3	425.3	143.3
DCF044DR-10BSS0	6	439.6	119.7	417.6	130.7	393.9	142.9	368.7	156.5
	7	453.2	120.5	430.7	131.6	406.4	143.8	380.5	157.4
	8	467.1	121.4	443.9	132.4	419.1	144.7	392.6	158.3
	10	495.5	123.1	471.1	134.2	445.1	146.5	417.3	160.2
	12	524.8	124.8	499.3	136.0	472.0	148.4	443.0	162.2
	14	555.0	126.6	528.2	137.8	499.8	150.3	469.5	164.1

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling EC Fans Extra Quiet

Model	Supply Temp °C	Ambient (°C)							
		25		30		35		40	
		Output kW	Input kW	Output kW	Input kW	Output kW	Input kW	Output kW	Input kW
DCF014SX-04AL00	6	147.3	38.3	139.3	41.8	130.6	45.7	121.1	50.1
	7	151.7	38.6	143.5	42.1	134.5	46.0	124.8	50.3
	8	156.3	38.8	147.8	42.4	138.5	46.3	128.5	50.6
	10	165.5	39.3	156.5	42.9	146.8	46.8	136.2	51.2
	12	174.9	39.9	165.5	43.4	155.2	47.4	144.0	51.8
	14	184.6	40.4	174.6	44.0	163.8	48.0	152.1	52.4
DCF017SX-04AM00	6	169.5	46.1	159.8	50.3	149.3	55.0	138.0	60.1
	7	174.5	46.5	164.4	50.7	153.6	55.4	142.0	60.5
	8	179.5	46.9	169.2	51.1	158.0	55.8	146.1	61.0
	10	189.7	47.7	178.8	52.0	167.0	56.7	154.4	61.9
	12	200.2	48.6	188.6	52.9	176.2	57.6	162.9	62.8
	14	210.8	49.4	198.6	53.8	185.5	58.6	171.6	63.8
DCF021SX-06BS00	6	217.6	57.4	205.8	62.7	193.0	68.6	179.1	75.1
	7	224.1	57.8	212.0	63.1	198.8	69.0	184.5	75.5
	8	230.7	58.2	218.3	63.5	204.7	69.4	190.0	75.9
	10	244.2	58.9	231.1	64.3	216.8	70.2	201.3	76.8
	12	258.1	59.7	244.3	65.1	229.2	71.1	212.8	77.7
	14	272.3	60.5	257.7	65.9	241.9	71.9	224.7	78.6
DCF025SX-06BT00	6	249.8	70.0	235.2	76.4	219.5	83.4	202.6	91.3
	7	257.0	70.6	242.0	77.0	225.9	84.0	208.5	91.9
	8	264.4	71.2	248.9	77.6	232.3	84.7	214.5	92.6
	10	279.3	72.4	263.0	78.8	245.4	86.0	226.6	93.9
	12	294.6	73.6	277.4	80.2	258.9	87.4	239.1	95.3
	14	310.2	74.9	292.0	81.5	272.6	88.8	251.8	96.8

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling EC Fans Extra Quiet

Model	Supply Temp °C	Ambient (°C)							
		25	Input kW	30	Input kW	35	Input kW	40	Input kW
DCF013DX-04ACD0	6	134.6	33.0	127.4	36.1	119.6	39.6	111.2	43.5
	7	138.7	33.2	131.3	36.3	123.3	39.8	114.7	43.7
	8	142.9	33.4	135.2	36.5	127.0	40.1	118.2	44.0
	10	151.4	33.9	143.3	37.0	134.7	40.5	125.3	44.5
	12	160.1	34.3	151.6	37.5	142.5	41.0	132.7	45.0
	14	169.1	34.8	160.2	38.0	150.6	41.5	140.2	45.5
DCF014DX-04ADD0	6	147.8	38.1	139.8	41.6	131.1	45.5	121.7	49.8
	7	152.2	38.4	144.0	41.9	135.1	45.8	125.4	50.1
	8	156.7	38.6	148.3	42.1	139.1	46.0	129.2	50.4
	10	166.0	39.1	157.1	42.7	147.4	46.6	136.9	50.9
	12	175.5	39.7	166.1	43.2	155.8	47.2	144.8	51.5
	14	185.2	40.2	175.3	43.8	164.5	47.8	152.9	52.2
DCF015DX-04ADF0	6	159.6	42.2	150.7	46.1	140.9	50.3	130.4	55.1
	7	164.4	42.6	155.1	46.4	145.1	50.7	134.3	55.4
	8	169.2	42.9	159.7	46.8	149.4	51.0	138.3	55.8
	10	179.0	43.6	168.9	47.5	158.0	51.8	146.3	56.5
	12	189.0	44.2	178.4	48.2	166.9	52.5	154.6	57.3
	14	199.2	45.0	188.0	48.9	176.0	53.3	163.0	58.1
DCF016DX-04AJJ0	6	165.2	44.4	155.6	48.6	145.4	53.4	134.6	58.7
	7	170.2	44.7	160.4	49.0	149.9	53.7	138.7	59.1
	8	175.3	45.1	165.2	49.3	154.4	54.1	142.9	59.4
	10	185.6	45.8	175.0	50.1	163.6	54.9	151.5	60.2
	12	196.3	46.5	185.0	50.9	173.0	55.7	160.2	61.1
	14	207.1	47.3	195.3	51.7	182.6	56.5	169.1	61.9
DCF018DX-04BJK0	6	188.4	54.9	176.9	60.3	164.7	66.4	151.5	73.2
	7	193.9	55.4	182.1	60.8	169.5	67.0	156.0	73.8
	8	199.4	55.9	187.3	61.4	174.3	67.5	160.4	74.3
	10	210.6	56.9	197.8	62.4	184.2	68.6	169.6	75.5
	12	222.1	58.0	208.6	63.6	194.2	69.8	178.8	76.7
	14	233.7	59.2	219.5	64.8	204.4	71.0	188.3	77.9
DCF020DX-06BFK0	6	204.2	50.8	193.2	55.7	181.3	61.2	168.5	67.4
	7	210.4	51.1	199.0	56.1	186.8	61.6	173.7	67.7
	8	216.6	51.5	204.9	56.5	192.4	62.0	178.9	68.1
	10	229.4	52.2	217.0	57.2	203.8	62.8	189.6	68.9
	12	242.5	53.0	229.5	58.0	215.5	63.6	200.6	69.8
	14	255.9	53.8	242.2	58.9	227.6	64.5	211.9	70.7
DCF023DX-06BKK0	6	227.9	58.2	215.1	64.2	201.6	70.9	187.1	78.3
	7	234.6	58.7	221.6	64.6	207.7	71.3	192.8	78.8
	8	241.5	59.1	228.1	65.1	213.8	71.8	198.6	79.3
	10	255.6	60.1	241.4	66.0	226.4	72.7	210.3	80.3
	12	270.0	61.1	255.1	67.0	239.3	73.8	222.4	81.3
	14	284.7	62.1	269.1	68.1	252.5	74.8	234.8	82.4

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25	Input kW	30	Input kW	35	Input kW	40	Input kW
DCF026DX-08BKL0	6	267.7	66.2	253.3	72.5	237.7	79.5	221.0	87.4
	7	275.8	66.6	261.0	72.9	245.0	80.0	227.8	87.9
	8	284.1	67.1	268.9	73.4	252.4	80.4	234.8	88.3
	10	300.9	67.9	284.9	74.3	267.6	81.4	248.9	89.3
	12	318.2	68.9	301.3	75.2	283.1	82.3	263.5	90.3
	14	335.9	69.9	318.1	76.2	299.0	83.3	278.5	91.3
DCF029DX-08BLL0	6	293.7	76.6	277.8	83.6	260.4	91.4	241.5	100.1
	7	302.5	77.1	286.1	84.1	268.3	92.0	248.8	100.6
	8	311.4	77.6	294.6	84.7	276.2	92.5	256.3	101.2
	10	329.7	78.6	311.9	85.7	292.5	93.6	271.5	102.4
	12	348.4	79.6	329.6	86.8	309.2	94.8	287.1	103.6
	14	367.6	80.7	347.8	88.0	326.3	96.0	303.1	104.8
DCF032DX-08BLM0	6	316.9	84.5	299.2	92.1	279.9	100.7	259.1	110.1
	7	326.3	85.1	308.0	92.8	288.2	101.4	266.8	110.9
	8	335.8	85.7	317.0	93.5	296.6	102.1	274.6	111.6
	10	355.1	87.0	335.2	94.9	313.7	103.5	290.6	113.1
	12	374.9	88.4	353.9	96.3	331.2	105.0	306.9	114.6
	14	395.1	89.8	373.0	97.8	349.2	106.5	323.6	116.2
DCF035DX-08BMM0	6	337.0	92.1	317.7	100.5	296.9	109.7	274.6	120.0
	7	346.8	92.9	326.9	101.3	305.6	110.6	282.5	120.9
	8	356.7	93.7	336.3	102.1	314.3	111.4	290.6	121.8
	10	376.9	95.3	355.3	103.8	332.0	113.2	307.1	123.6
	12	397.6	96.9	374.7	105.5	350.2	115.0	324.0	125.4
	14	418.6	98.6	394.5	107.3	368.7	116.9	341.2	127.4
DCF039DX-10BMS0	6	390.9	103.8	369.0	113.3	345.3	123.8	319.6	135.4
	7	402.5	104.6	379.9	114.1	355.5	124.6	329.2	136.3
	8	414.2	105.3	391.0	114.9	365.9	125.4	338.8	137.1
	10	438.2	106.9	413.7	116.5	387.2	127.2	358.6	138.9
	12	462.7	108.6	436.8	118.3	408.9	129.0	378.8	140.8
	14	487.7	110.2	460.5	120.0	431.1	130.8	399.6	142.7
DCF044DX-12BSS0	6	439.7	115.1	415.8	125.7	389.7	137.4	361.4	150.4
	7	452.9	115.9	428.3	126.5	401.5	138.2	372.4	151.3
	8	466.4	116.6	441.1	127.2	413.5	139.0	383.5	152.1
	10	493.7	118.1	467.0	128.8	437.9	140.7	406.3	153.9
	12	521.8	119.7	493.6	130.5	462.9	142.4	429.7	155.7
	14	550.6	121.3	520.8	132.2	488.5	144.2	453.6	157.5

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Cooling EC Fan high air flow

Model	Supply Temp °C	Ambient (°C)							
		25	30	35	40	Output kW	Input kW	Output kW	Input kW
DCF014SR-04AL00	6	149.4	38.3	142.1	41.8	134.1	45.8	125.5	50.2
	7	154.1	38.5	146.6	42.1	138.4	46.1	129.6	50.4
	8	158.9	38.8	151.1	42.4	142.7	46.3	133.7	50.7
	10	168.6	39.3	160.5	42.9	151.7	46.8	142.2	51.3
	12	178.7	39.8	170.1	43.4	160.9	47.4	150.9	51.8
	14	189.0	40.3	180.0	43.9	170.4	48.0	160.0	52.4
DCF017SR-04AM00	6	174.4	46.0	165.5	50.2	156.1	54.8	146.1	60.0
	7	179.7	46.4	170.6	50.6	161.0	55.2	150.7	60.4
	8	185.2	46.7	175.9	51.0	165.9	55.6	155.4	60.8
	10	196.5	47.5	186.6	51.7	176.1	56.4	165.1	61.6
	12	208.0	48.2	197.6	52.5	186.7	57.2	175.1	62.5
	14	219.9	49.0	209.1	53.4	197.3	58.0	185.4	63.3
DCF021SR-04BS00	6	213.8	62.1	203.0	67.8	191.6	74.1	179.4	81.1
	7	220.2	62.6	209.3	68.3	197.6	74.6	184.9	81.5
	8	226.9	63.0	215.7	68.8	203.7	75.1	190.4	81.9
	10	240.7	64.0	228.9	69.8	216.3	76.1	201.7	82.7
	12	254.8	65.0	242.5	70.8	229.3	77.1	213.4	83.6
	14	269.4	66.0	256.5	71.8	242.1	78.0	225.4	84.5
DCF025SR-06BT00	6	256.9	69.8	243.7	76.2	229.6	83.2	214.7	91.1
	7	264.8	70.3	251.2	76.7	236.8	83.8	221.4	91.7
	8	272.8	70.9	258.8	77.3	244.0	84.4	228.3	92.3
	10	289.3	72.0	274.5	78.5	258.9	85.6	242.5	93.5
	12	306.2	73.1	290.7	79.7	274.4	86.8	257.1	94.8
	14	323.6	74.3	307.4	80.9	289.9	88.0	272.1	96.1

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25	Input kW	30	Input kW	35	Input kW	40	Input kW
DCF013DR-04ACD0	6	135.8	32.9	129.0	36.1	121.8	39.6	114.1	43.6
	7	140.0	33.1	133.1	36.3	125.7	39.8	117.8	43.8
	8	144.4	33.3	137.3	36.5	129.7	40.1	121.6	44.0
	10	153.3	33.8	145.8	37.0	137.9	40.5	129.3	44.5
	12	162.4	34.3	154.6	37.4	146.3	41.0	137.4	45.0
	14	171.8	34.8	163.7	37.9	154.9	41.5	145.6	45.5
DCF014DR-04ADD0	6	149.9	38.1	142.6	41.6	134.6	45.5	126.1	49.9
	7	154.5	38.3	147.1	41.9	138.9	45.8	130.1	50.2
	8	159.3	38.6	151.6	42.1	143.3	46.1	134.3	50.4
	10	169.1	39.1	161.0	42.6	152.2	46.6	142.8	51.0
	12	179.2	39.6	170.7	43.2	161.5	47.1	151.6	51.6
	14	189.6	40.1	180.6	43.7	171.0	47.7	160.7	52.1
DCF015DR-04ADF0	6	163.2	42.2	155.0	46.0	146.2	50.3	136.8	55.1
	7	168.3	42.5	159.8	46.3	150.8	50.6	141.2	55.4
	8	173.4	42.8	164.8	46.7	155.5	51.0	145.6	55.7
	10	184.0	43.4	174.9	47.3	165.2	51.6	154.8	56.4
	12	194.9	44.0	185.3	48.0	175.1	52.3	164.3	57.2
	14	206.1	44.7	196.1	48.7	185.3	53.0	174.0	57.9
DCF016DR-04AJJ0	6	169.6	44.3	160.8	48.5	151.7	53.2	142.0	58.5
	7	175.0	44.6	166.1	48.8	156.6	53.5	146.7	58.8
	8	180.5	44.9	171.3	49.1	161.7	53.8	151.5	59.1
	10	191.8	45.5	182.1	49.8	172.0	54.5	161.3	59.8
	12	203.5	46.2	193.3	50.5	182.7	55.2	171.5	60.6
	14	215.5	46.9	204.9	51.2	193.7	56.0	181.9	61.3
DCF018DR-04BJK0	6	197.8	53.9	187.6	59.2	177.0	65.1	165.2	71.4
	7	204.0	54.3	193.6	59.6	182.7	65.5	170.4	71.8
	8	210.2	54.8	199.6	60.0	188.3	65.9	175.7	72.2
	10	223.1	55.7	211.9	60.9	199.8	66.7	186.6	73.0
	12	236.3	56.6	224.7	61.9	211.7	67.6	197.7	73.9
	14	250.0	57.5	237.6	62.8	223.7	68.4	209.3	74.8
DCF020DR-06BFK0	6	206.6	50.6	196.1	55.6	185.1	61.1	173.4	67.3
	7	213.0	51.0	202.3	56.0	191.0	61.5	179.0	67.7
	8	219.5	51.3	208.5	56.3	197.0	61.9	184.6	68.1
	10	232.8	52.1	221.4	57.1	209.2	62.6	196.3	68.9
	12	246.6	52.8	234.6	57.9	221.8	63.4	208.3	69.7
	14	260.8	53.7	248.2	58.7	234.9	64.3	220.7	70.5
DCF023DR-06BKK0	6	232.2	58.1	220.4	64.1	208.0	70.7	194.9	78.2
	7	239.3	58.5	227.2	64.5	214.5	71.1	201.2	78.6
	8	246.6	59.0	234.2	64.9	221.2	71.6	207.5	79.1
	10	261.6	59.9	248.6	65.8	235.0	72.4	220.6	79.9
	12	277.0	60.8	263.4	66.7	249.2	73.4	234.2	80.9
	14	292.8	61.8	278.7	67.7	263.8	74.4	248.1	81.8

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Model	Supply Temp °C	Ambient (°C)							
		25 Output kW	Input kW	30 Output kW	Input kW	35 Output kW	Input kW	40 Output kW	Input kW
DCF026DR-06BKL0	6	264.4	69.6	250.9	76.3	236.6	83.7	221.5	92.0
	7	272.5	70.2	258.7	76.8	244.1	84.2	228.6	92.6
	8	280.8	70.7	266.7	77.3	251.7	84.8	235.9	93.1
	10	297.8	71.7	282.9	78.4	267.3	85.9	250.7	94.2
	12	315.1	72.8	299.8	79.5	283.5	87.0	266.2	95.4
	14	333.4	74.0	317.2	80.7	300.2	88.2	282.1	96.6
DCF029DR-06BLL0	6	291.4	80.9	276.7	88.2	261.0	96.4	244.3	105.6
	7	300.4	81.4	285.3	88.8	269.2	97.1	252.1	106.2
	8	309.5	82.0	294.1	89.4	277.6	97.7	260.0	106.9
	10	328.2	83.2	311.7	90.6	294.6	98.9	276.4	108.2
	12	347.0	84.3	330.3	91.9	312.4	100.3	293.4	109.6
	14	367.4	85.7	349.5	93.2	330.8	101.6	310.9	110.9
DCF032DR-08BLMO	6	323.9	84.3	307.6	92.0	290.2	100.6	271.6	110.1
	7	333.9	84.9	317.2	92.6	299.3	101.2	280.3	110.8
	8	344.1	85.5	327.0	93.3	308.6	101.9	289.1	111.5
	10	364.9	86.7	346.9	94.6	327.7	103.2	307.1	112.9
	12	386.4	88.0	367.5	95.9	347.4	104.6	325.8	114.3
	14	408.6	89.3	388.7	97.2	367.6	106.0	345.0	115.7
DCF035DR-08BMM0	6	346.4	91.8	328.8	100.2	310.2	109.5	290.4	119.8
	7	357.1	92.6	339.0	101.0	319.9	110.2	299.6	120.6
	8	367.9	93.3	349.3	101.7	329.7	111.0	308.9	121.4
	10	390.0	94.8	370.5	103.3	349.8	112.6	328.0	123.0
	12	412.8	96.3	392.3	104.9	370.7	114.3	347.8	124.7
	14	436.4	97.8	414.9	106.5	392.2	116.0	368.0	126.4
DCF039DR-10BMS0	6	399.1	103.8	379.0	113.3	357.5	123.9	334.5	135.7
	7	411.5	104.5	390.8	114.1	368.8	124.7	345.2	136.5
	8	424.1	105.2	402.9	114.9	380.3	125.5	356.1	137.3
	10	449.9	106.7	427.6	116.4	403.8	127.1	378.4	139.0
	12	476.5	108.3	453.1	118.0	427.8	128.7	401.4	140.6
	14	503.8	109.8	479.3	119.6	453.0	130.4	425.4	142.4
DCF044DR-10BSS0	6	440.0	119.0	417.9	129.9	394.2	142.1	368.8	155.6
	7	453.7	119.8	430.9	130.8	406.7	142.9	380.6	156.5
	8	467.5	120.6	444.2	131.6	419.3	143.8	392.6	157.4
	10	495.9	122.3	471.4	133.4	445.3	145.6	417.3	159.3
	12	525.2	124.0	499.6	135.1	471.5	147.3	442.7	161.1
	14	555.3	125.8	528.5	137.0	499.4	149.2	469.3	163.1

1 Output kW refers to the chilled water duty.

2 Input kW refers to the unit input power (compressor + fans).

3 Duties applicable for chilled water ΔT between 4 and 8°C.

4 Interpolate for water temperatures between those quoted, do not extrapolate.

5 Water flow rate (l/s) = Output ÷ (Cp x ΔT)

6 For conditions outside of those quoted please refer to Airedale.

Mechanical Data Free Cool Chillers Regular Quiet

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed			DCF014SR-04AL00 1 Yes Yes	DCF017SR-04AM00 1 Yes Yes	DCF021SR-04BS00 1 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 2 6 5	kW kW kW °C	151.7 46.8 3.2 4.2 4.0 163.9 3.8	176.1 56.4 3.1 4.1 3.9 174.4 2.8	216.3 76.1 2.8 4.1 3.9 187.1 1.1
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 2 6 5	kW kW kW °C	151.5 47.1 3.21 4.14 4.02 159.63 3.6	176.0 56.7 3.10 4.04 3.92 169.51 2.5	214.6 76.0 2.82 4.07 3.92 180.72 0.7
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	6 5	kW kW kW °C	153.6 48.6 3.2 3.74 3.66 154.65 3.00	176.7 57.3 3.1 3.71 3.62 162.84 1.90	211.3 75.9 2.8 3.77 3.65 171.80 0.20
Capacity Steps Minimum Turndown Ratio		%	55-100 0.54	55-100 0.55	40-75-100 0.40
Dimensions (H x W x L)		mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3	kg kg	1940 2085	1975 2125	2185 2335
Construction - Material / Colour			Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		l l/s	13.2 9.9	16.2 11.4	20.3 13.6
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans		m² m³/s m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 8.05 24.14 23.8 20.5	8.05 N/A 23.8 20.5	8.05 N/A 23.8 20.5
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		mm rpm rpm rpm	4 800 N/A 1032 903	Sickle Bladed Fan 4 800 N/A 1032 903	4 800 N/A 1032 903
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type		l	Tandem 2 2 x 6.7	Tandem 2 2 x 7.2 Polyol Ester	Trio 3 3 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)		kg	26	28	30
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap		inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4	l Bar	1558 10	1823 10	1571 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol
All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF025SR-06BT00 1 Yes Yes	DCF013DR-04ACD0 2 Yes Yes	DCF014DR-04ADD0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	258.9 85.6 3.0 4.3 4.1 259.6 3.0	137.9 40.5 3.4 4.3 4.1 156.6 4.4	152.2 46.6 3.3 3.8 3.8 164.1 3.8
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	258.8 86.1 3.01 4.27 4.11 252.40 2.6	137.7 40.8 3.38 4.24 4.12 152.77 4.1	152.1 46.9 3.24 3.81 3.73 159.89 3.5
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 5	259.7 87.0 3.0 3.83 3.73 242.58 2.10	140.2 42.7 3.3 3.96 3.86 148.71 3.60	154.2 48.3 3.2 3.68 3.61 154.89 3.00
Capacity Steps Minimum Turndown Ratio	% 0.38	40-75-100 0.38	45-100 0.45	50-100 0.50
Dimensions (H x W x L)	mm	2415 x 2200 x 3690	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3 kg kg	2855 3120	1905 2050	1955 2095
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	I l/s	25.7 16.8	13.2 9.0	13.2 10.0
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 12.07 36.21 35.7 30.7	8.05 N/A 23.8 20.5	8.05 N/A 23.8 20.5
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm 800 N/A 1032 903	6 800 N/A 1032 903	4 800 N/A 1032 903	4 800 N/A 1032 903
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	I	Trio 3 3 x 7.2	Single + Single 2 1 x 6.7 + 1 x 6.7 Polyol Ester	Single + Single 2 1 x 6.7 + 1 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	44	Electronic Expansion Valve (EEV) R410A 13 + 14	13 + 14
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN100 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1854 10	1182 10	1446 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF015DR-04ADF0 2 Yes Yes	DCF016DR-04AJJ0 2 Yes Yes	DCF018DR-04BJK0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	165.2 51.6 3.2 3.9 3.8 170.0 3.3	172.0 54.5 3.2 4.3 4.1 172.8 3.0	199.8 66.7 3.0 4.2 4.1 182.5 1.8
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	165.0 52.0 3.18 3.85 3.76 165.42 3.0	171.9 54.9 3.13 4.25 4.11 168.03 2.7	198.5 66.8 2.97 4.21 4.06 176.54 1.5
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 5	166.4 52.9 3.1 3.73 3.65 159.48 2.40	172.7 55.5 3.1 3.88 3.78 161.59 2.10	197.1 67.2 2.9 3.89 3.77 168.51 0.90
Capacity Steps Minimum Turndown Ratio	% 0.47	45-100 0.47	25-55-75-100 0.27	25-55-75-100 0.24
Dimensions (H x W x L)	mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3 kg kg	1980 2125	2120 2270	2165 2325
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		Brazed Plate Class 1		
	I l/s	16.4 10.7	16.4 11.1	22.5 12.7
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 8.05 24.14 23.8 20.5	8.05 N/A 23.8 20.5	8.05 N/A 23.8 20.5
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm mm rpm rpm	4 800 N/A 1032 903	4 800 N/A 1032 903	4 800 N/A 1032 903
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	I	Single + Single 2 1 x 6.7 + 1 x 7.2	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	14 + 14	14 + 14	15 + 16
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1466 10	889 10	893 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF020DR-06BFK0 2 Yes Yes	DCF023DR-06BKK0 2 Yes Yes	DCF026DR-06BKL0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 2 6 5 kW °C	209.2 62.6 3.3 4.2 4.1 236.2 4.3	235.0 72.4 3.2 4.4 4.3 249.4 3.6	267.3 85.9 3.1 4.4 4.2 262.8 2.7
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 2 6 5 kW °C	208.9 63.0 3.32 4.16 4.05 230.45 4.1	234.8 72.9 3.22 4.41 4.26 242.82 3.3	267.3 86.4 3.09 4.34 4.18 255.38 2.4
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	 kW kW 6 5 kW °C	212.3 65.8 3.2 3.85 3.77 224.01 3.60	237.3 74.6 3.2 3.97 3.86 234.69 2.80	267.1 87.1 3.1 3.95 3.84 244.92 1.90
Capacity Steps Minimum Turndown Ratio	% 0.44	45-75-100 0.44	25-55-75-100 0.27	25-55-75-100 0.25
Dimensions (H x W x L)	mm	2415 x 2200 x 3690	2415 x 2200 x 3690	2415 x 2200 x 3690
Mass Machine Operating	3 kg kg	2680 2900	2750 2970	2945 3215
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	 I l/s	22.5 13.7	22.5 15.3	30.6 17.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	 m² m³/s m³/s	Epoxy Coated 12.07 36.21 35.7 30.7	Aluminium Micro channel & Aluminium Fins 12.07 N/A 35.7 30.7	12.07 N/A 35.7 30.7
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	 mm rpm rpm	6 800 N/A 1032 903	Sickle Bladed Fan 6 800 N/A 1032 903	6 800 N/A 1032 903
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	 I	Single + Tandem 3 1 x 7.2 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	 kg	21 + 21	21 + 21	22 + 24
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	 inch	DN80 1/2	Grooved Terminations DN80 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1755 10	1213 10	1228 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF029DR-06BLLO 2 Yes Yes	DCF032DR-08BLMO 2 Yes Yes	DCF035DR-08BMMO 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 2 6 5 kW °C	294.6 98.9 3.0 4.1 3.9 272.1 2.0	327.7 103.2 3.2 4.3 4.2 338.9 3.4	349.8 112.6 3.1 4.2 4.1 348.0 2.9
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 2 6 5 kW °C	294.8 99.6 2.96 4.05 3.91 263.97 1.5	327.4 103.8 3.15 4.28 4.14 329.77 3.0	349.7 113.3 3.09 4.18 4.04 338.18 2.5
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	 kW kW 6 5 kW °C	292.1 99.4 2.9 3.76 3.65 251.85 1.00	330.2 105.9 3.1 3.88 3.77 318.02 2.50	351.0 114.5 3.1 3.83 3.73 324.96 2.00
Capacity Steps Minimum Turndown Ratio	%	30-55-80-100 0.28	25-55-75-100 0.25	30-55-80-100 0.28
Dimensions (H x W x L)	mm	2415 x 2200 x 3690	2415 x 2200 x 4820	2415 x 2200 x 4820
Mass Machine Operating	3 kg kg	3050 3320	3620 3980	3650 4005
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation		Brazed Plate Class 1		
Water Volume (Total Internal) Total Maximum Water flow	l l/s	30.6 18.8	36.9 21.3	36.9 22.6
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins		
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm mm rpm rpm	6 800 N/A 1032 903	8 800 N/A 1032 903	8 800 N/A 1032 903
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	l	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 7.2 Polyol Ester	Tandem + Tandem 4 2 x 7.2 + 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	23 + 24	29 + 31	29 + 31
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 l Bar	1544 10	1565 10	1815 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Regular Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF039DR-10BMS0 2 Yes Yes	DCF044DR-10BSS0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 °C 5	403.8 127.1 3.2 4.4 4.3 421.1 3.4	445.3 145.6 3.1 4.4 4.2 438.0 2.7
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 °C 5	403.5 127.9 3.16 4.39 4.23 409.86 3.1	445.1 146.5 3.04 4.35 4.18 425.52 2.4
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 °C 5	407.0 130.6 3.1 3.93 3.82 395.44 2.60	445.7 147.6 3.0 3.91 3.80 408.33 1.80
Capacity Steps Minimum Turndown Ratio	% 0.24	25-45-65-85-100	20-40-55-70-85-100 0.19
Dimensions (H x W x L)	mm	2415 x 2200 x 5956	2415 x 2200 x 5956
Mass Machine Operating	3 kg kg	4430 4885	4580 5025
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)	
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	l l/s	Brazed Plate Class 1 54.0 26.2	
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 20.11 60.35 59.5 51.1	20.11 N/A 59.5 51.1
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm rpm rpm	Sickle Bladed Fan 10 800 N/A 1032 903	
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	l	Tandem + Trio 5 2 x 7.2 + 3 x 6.7	Trio + Trio 6 3 x 6.7 + 3 x 6.7 Polyol Ester
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	Electronic Expansion Valve (EEV) R410A 39 + 41	
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 l Bar	1842 10	1586 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Extra Quiet

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF014SX-04AL00 1 Yes Yes	DCF017SX-04AM00 1 Yes Yes	DCF021SX-06BS00 1 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5 °C	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5 °C	146.8 46.8 3.13 4.13 4.00 125.78 0.9	167.0 56.7 2.95 4.01 3.88 130.79 -0.4	216.8 70.2 3.09 4.40 4.24 187.68 1.1
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 5 kW °C	149.1 48.2 3.1 3.78 3.69 134.98 1.70	170.3 57.6 3.0 3.74 3.64 140.82 0.40	220.2 72.2 3.0 3.95 3.84 201.34 1.80
Capacity Steps Minimum Turndown Ratio	% 0.56	55-100 0.56	55-100 0.57	40-75-100 0.39
Dimensions (H x W x L)	mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2415 x 2200 x 3690
Mass Machine Operating	3 kg kg	2020 2170	2060 2210	2835 3055
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow		Brazed Plate Class 1		
	l l/s	13.2 9.6	16.2 11.0	20.3 14.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins		
		8.05 N/A	8.05 N/A	12.07 N/A
		14.8	14.8	22.2
		15.9	15.9	23.9
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans		Sickle Bladed Fan		
	mm	4 800 N/A	4 800 N/A	6 800 N/A
	rpm rpm	657 726	657 726	657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	l	Tandem 2 2 x 6.7	Tandem 2 2 x 7.2 Polyol Ester	Trio 3 3 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	26	28	41
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 l Bar	1564 10	1831 10	1591 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol
All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF025SX-06BT00 1 Yes Yes	DCF013DX-04ACD0 2 Yes Yes	DCF014DX-04ADD0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5 °C	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5 °C	245.4 86.0 2.85 4.29 4.12 195.09 -0.2	134.7 40.5 3.32 4.22 4.10 121.90 1.7	147.4 46.6 3.16 3.77 3.68 125.96 0.9
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 2 6 5 °C	250.3 87.4 2.9 3.90 3.78 209.99 0.60	136.6 42.0 3.3 4.02 3.91 130.55 2.40	149.7 47.9 3.1 3.67 3.59 135.18 1.70
Capacity Steps Minimum Turndown Ratio	% 0.40	40-75-100 0.40	45-100 0.45	50-100 0.50
Dimensions (H x W x L)	mm	2415 x 2200 x 3690	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3 kg kg	2965 3235	2030 2175	2080 2230
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	I l/s	25.7 16.2	13.2 8.8	13.2 9.7
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 12.07 N/A 22.2 23.9	8.05 N/A 14.8 15.9	8.05 N/A 14.8 15.9
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm mm rpm rpm	6 800 N/A 657 726	Sickle Bladed Fan 4 800 N/A 657 726	4 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	I	Trio 3 3 x 7.2	Single + Single 2 1 x 6.7 + 1 x 6.7 Polyol Ester	Single + Single 2 1 x 6.7 + 1 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	44	Electronic Expansion Valve (EEV) R410A 13 + 14	13 + 14
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN100 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1861 10	1157 10	1403 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF015DX-04ADF0 2 Yes Yes	DCF016DX-04AJJ0 2 Yes Yes	DCF018DX-04BJK0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	158.0 51.8 3.05 3.80 3.70 128.77 0.2	163.6 54.9 2.98 4.23 4.08 130.06 -0.2	184.2 68.6 2.68 4.20 4.02 133.91 -1.6
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 5	160.9 52.9 3.0 3.70 3.61 138.46 1.00	166.7 55.8 3.0 3.93 3.81 139.96 0.60	188.6 68.9 2.7 3.94 3.79 144.59 -0.70
Capacity Steps Minimum Turndown Ratio	% 0.47	45-100 0.47	30-55-80-100 0.29	25-60-80-100 0.25
Dimensions (H x W x L)	mm	2405 x 2200 x 2554	2405 x 2200 x 2554	2405 x 2200 x 2554
Mass Machine Operating	3 kg kg	2105 2250	2250 2400	2290 2450
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	I l/s	16.4 10.4	16.4 10.8	22.5 12.2
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 8.05 N/A 14.8 15.9	8.05 N/A 14.8 15.9	8.05 N/A 14.8 15.9
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm 800 N/A 657 726	4 800 N/A 657 726	Sickle Bladed Fan 4 800 N/A 657 726	4 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	I	Single + Single 2 1 x 6.7 + 1 x 7.2	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	14 + 14	14 + 14	15 + 16
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN80 1/2	Grooved Terminations DN80 1/2	DN80 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1422 10	893 10	896 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF020DX-06BFK0 2 Yes Yes	DCF023DX-06BKK0 2 Yes Yes	DCF026DX-08BKL0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5 °C	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5 °C	203.8 62.8 3.25 4.15 4.03 183.49 1.6	226.4 72.7 3.11 4.40 4.24 190.42 0.7	267.6 81.4 3.29 4.58 4.42 243.18 1.7
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 5 kW °C	206.8 64.9 3.2 3.92 3.82 196.56 2.30	230.1 74.5 3.1 4.03 3.91 204.48 1.40	271.3 84.3 3.2 4.12 4.00 260.40 2.40
Capacity Steps Minimum Turndown Ratio	% 0.44	45-75-100 0.44	30-55-80-100 0.28	25-55-75-100 0.24
Dimensions (H x W x L)	mm	2415 x 2200 x 3690	2415 x 2200 x 3690	2415 x 2200 x 4820
Mass Machine Operating	3 kg kg	2830 3050	2910 3130	3665 4010
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	I l/s	22.5 13.3	22.5 14.8	30.6 17.5
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 12.07 N/A 22.2 23.9	12.07 N/A 22.2 23.9	16.09 N/A 29.6 31.9
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm mm rpm rpm	6 800 N/A 657 726	6 800 N/A 657 726	8 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	I	Single + Tandem 3 1 x 7.2 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7 Polyol Ester	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	21 + 21	21 + 21	27 + 30
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN80 1/2	Grooved Terminations DN80 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1719 10	1218 10	1241 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF029DX-08BLLO 2 Yes Yes	DCF032DX-08BLMO 2 Yes Yes	DCF035DX-08BMM0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 5	292.5 93.6 3.12 4.28 4.14 251.26 1.0	313.7 103.5 3.03 4.27 4.12 256.97 0.3	332.0 113.2 2.93 4.16 4.01 261.15 -0.3
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 5	297.2 96.3 3.1 3.92 3.81 269.62 1.70	319.3 105.8 3.0 3.93 3.82 276.25 1.10	338.5 115.1 2.9 3.88 3.76 281.15 0.50
Capacity Steps Minimum Turndown Ratio	% 0.28	30-55-80-100 0.28	25-55-75-100 0.26	30-55-80-100 0.29
Dimensions (H x W x L)	mm	2415 x 2200 x 4820	2415 x 2200 x 4820	2415 x 2200 x 4820
Mass Machine Operating	3 kg kg	3775 4120	3820 4175	3850 4210
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)		
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	I l/s	30.6 19.2	36.9 20.6	36.9 21.8
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 16.09 N/A 29.6 31.9	16.09 N/A 29.6 31.9	16.09 N/A 29.6 31.9
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm 800 N/A 657 726	8 800 N/A 657 726	Sickle Bladed Fan 8 800 N/A 657 726	8 800 N/A 657 726
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	I	Tandem + Tandem 4 2 x 6.7 + 2 x 6.7	Tandem + Tandem 4 2 x 6.7 + 2 x 7.2 Polyol Ester	Tandem + Tandem 4 2 x 7.2 + 2 x 7.2
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	28 + 30	29 + 31	29 + 31
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN100 1/2	Grooved Terminations DN100 1/2	DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 I Bar	1561 10	1571 10	1824 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol

All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.

For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Mechanical Data Free Cool Chillers Extra Quiet Continued

Number of Refrigeration Circuits Free Cool Enabled Enhance Capital Allowance listed		DCF039DX-10BMS0 2 Yes Yes	DCF044DX-12BSS0 2 Yes Yes
Cooling Duty - High Airflow EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 °C 5	N/A N/A N/A N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A
Cooling Duty - EC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	1 kW kW 2 6 °C 5	387.2 127.2 3.04 4.27 4.11 319.96 0.4	437.9 140.7 3.11 4.50 4.33 376.62 1.0
Cooling Duty - AC Fans Nominal Output - Mechanical Nominal Input - Mechanical EER ESEER SEER Nominal Output - Free Cooling Ambient temperature for 100% Free Cooling	kW kW 6 °C 5	394.0 130.1 3.0 3.93 3.81 343.86 1.20	444.8 144.7 3.1 4.04 3.92 404.13 1.70
Capacity Steps Minimum Turndown Ratio	%	25-45-65-85-100 0.25	20-40-55-75-85-100 0.19
Dimensions (H x W x L)	mm	2415 x 2200 x 5956	2415 x 2200 x 7090
Mass Machine Operating	3 kg kg	4655 5100	5150 5680
Construction - Material / Colour		Base: Plain Galvanised Steel, Panels: Galvanised Sheet Steel, Epoxy Baked Powder Paint, Light Grey (RAL7035)	
Evaporator Insulation Water Volume (Total Internal) Total Maximum Water flow	l l/s	Brazed Plate Class 1 54.0 25.4	
Condenser Face Area (Total) Nominal Airflow - High Airflow EC Fans Nominal Airflow - EC Fans Nominal Airflow - AC Fans	m² m³/s m³/s	Epoxy Coated Aluminium Micro channel & Aluminium Fins 20.11 N/A 37 39.8	
Condenser Fan & Motor Quantity Diameter Maximum Speed - High Airflow EC Fans Maximum Speed - EC Fans Maximum Speed - AC Fans	mm rpm rpm	Sickle Bladed Fan 10 800 N/A 657 726	
Compressor Quantity of Compressors Oil Charge Volume (Total) Oil Type	l	Tandem + Trio 5 2 x 7.2 + 3 x 6.7	Trio + Trio 6 3 x 6.7 + 3 x 6.7 Polyol Ester
Refrigeration Refrigerant Control Refrigerant Precharged Charge (Total)	kg	Electronic Expansion Valve (EEV) R410A 34 + 45	
Connections Water Inlet / Outlet - Unit Water Drain / Bleed - Evap	inch	DN100 1/2	Grooved Terminations DN100 1/2
Water System Minimum System Water Volume Maximum System Operating Pressure	4 l Bar	1840 10	1598 10

(1) Based on units performance at 15/10°C return/supply temperatures, 35°C ambient, 20% Ethylene Glycol
All performance data is supplied in accordance with BS EN 14511-1:2013

(2) EER = DX Cooling Output ÷ (Compressor input power + Fan Input Power),

(3) Based on standard unit without options, operating weight includes refrigerant charge and water volume.
For unit weights with waterside options fitted please refer to Airedale.

(4) For minimum system volume, refer to **Design Features & Information - Minimum System Water Volume Calculations**

(5) Ambient temperature that full Freecool capacity can be achieved

(6) Nominal Free Cooling at 3°C

Electrical Data Free Cool Chiller Regular Quiet

ELECTRICAL DATA				DCF014SR-04AL00	DCF017SR-04AM00	DCF021SR-04BS00
Unit Data						
Nominal Run Amps	(1)	A	94	114	132	
Maximum Start Amps		A	315	385	354	
Recommended Mains Fuse Size		A	125	125	160	
Mains Supply		VAC		400 V 3 PH 50 Hz		
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar		
Recommended Permanent Fuse Size		A	16	16	16	
Permanent Supply		VAC		230 V 1 PH 50 Hz		
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals		
Control Circuit		VAC		24V/230VAC		
Evaporator		W	80	80	100	
Pad Heater Rating		W	500	500	500	
External Trace Heating						
Available (fitted by others)						
Condenser Fan - Per Fan (AC)			4	4	4	
Quantity		A	4.3	4.3	4.3	
Full Load Amps		A	15	15	15	
Locked Rotor Amps		A	2	2	2	
Motor Rating		kW				
Condenser Fan - Per Fan (EC)			4	4	4	
Quantity		A	3.9	3.9	3.9	
Full Load Amps		A	N/A	N/A	N/A	
Locked Rotor Amps		A	2.56	2.56	2.56	
Motor Rating		kW				
Compressor - Per Compressor						
Nominal Run Amps		A	38.3	48.2	38.3	
Quantity			2	2	3	
Motor Rating		kW	24.0	28.2	24.0	
Sump Heater Rating		W	75	130	75	
Start Amps		A	260	320	260	
Type Of Start				Direct on line		
OPTIONAL EXTRAS						
Power Factor Correction						
Circuit 1 Comp RLA (PFC)			36.5	42.8	36.5	
Circuit 2 Comp RLA (PFC)			N/A	N/A	N/A	
Nominal Run Amps		A	86.4	103.6	120.6	
Maximum Start Amps		A	312.2	380.8	346.4	
Compressor Nominal Run Amps		A	34.2	42.8	34.2	
Recommended Mains Fuse Size		A	125	125	160	
Electronic Soft-start		A	93.8	113.6	132.1	
Nominal Run Amps		A	211	257	250	
Maximum Start Amps		A	125.0	125.0	160.0	
Recommended Mains Fuse						
Power Factor Correction & Electronic Soft Start						
Nominal Run Amps		A	86.4	103.6	120.6	
Maximum Start Amps		A	208	253	242	
Compressor Nominal Run Amps		A	34.2	42.8	34.2	
Recommended Mains Fuse Size		A	125	125	160	
Condenser Fan - Per Fan (EC Extra Freecooling)						
Quantity			4	4	4	
Full Load Amps		A	4.5	4.5	4.5	
Locked Rotor Amps		A	N/A	N/A	N/A	
Motor Rating		kW	2.86	2.86	2.86	
Standard Head Pump (Single or Run/Standby)						
Pump Full Load Amps		A	6.6	8.9	8.9	
Unit Nominal Run Amps		A	100	123	141	
Recommended Mains Fuse Size		A	125	160	200	
Motor Rating		kW	3	4	4	
Larger Head Pump (Single or Run/Standby)						
Pump Full Load Amps		A	9.8	11.8	11.8	
Unit Nominal Run Amps		A	104	125	144	
Recommended Mains Fuse Size		A	125	160	200	
Motor Rating		kW	4	5.5	5.5	
Standard Head Inverter Pump (Single or Run/Standby)						
Pump Full Load Amps		A	6.3	6.3	8	
Unit Nominal Run Amps		A	100	120	140	
Recommended Mains Fuse Size		A	125	160	200	
Motor Rating		kW	3	3	4	
Larger Head Inverter Pump (Single or Run/Standby)						
Pump Full Load Amps		A	8	8	11.2	
Unit Nominal Run Amps		A	102	122	143	
Recommended Mains Fuse Size		A	125	160	200	
Motor Rating		kW	4	4	5.5	

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCF025SR-06BT00	DCF013DR-04ACD0	DCF014DR-04ADD0
Nominal Run Amps	(1)	A	170	86	94
Maximum Start Amps		A	442	315	315
Recommended Mains Fuse Size		A	200	125	125
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	4	4
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			6	4	4
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	48.2	31.0 / 38.3	38.3 / 38.3
Quantity			3	1 + 1	1 + 1
Motor Rating		kW	28.2	18.5 / 24.0	24.0 / 24.0
Sump Heater Rating		W	130	75	75
Start Amps		A	320	215 / 260	260 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	28.5	36.5
Circuit 2 Comp RLA (PFC)			N/A	36.5	36.5
Nominal Run Amps		A	155.4	80.3	86.4
Maximum Start Amps		A	432.6	312.2	312.2
Compressor Nominal Run Amps		A	42.8	28.1 / 34.2	34.2 / 34.2
Recommended Mains Fuse Size		A	200	125	125
Electronic Soft-start					
Nominal Run Amps		A	170.4	86.4	93.8
Maximum Start Amps		A	314	204	211
Recommended Mains Fuse		A	200.0	125.0	125.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	155.4	80.3	86.4
Maximum Start Amps		A	305	202	208
Compressor Nominal Run Amps		A	42.8	28.1 / 34.2	34.2 / 34.2
Recommended Mains Fuse Size		A	200	125	125
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			6	4	4
Full Load Amps		A	4.5	4.5	4.5
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.86	2.86	2.86
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	6.6	6.6
Unit Nominal Run Amps		A	182	93	100
Recommended Mains Fuse Size		A	200	125	125
Motor Rating		kW	5.5	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.8	9.8	9.8
Unit Nominal Run Amps		A	182	96	104
Recommended Mains Fuse Size		A	200	125	125
Motor Rating		kW	5.5	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	6.3	6.3
Unit Nominal Run Amps		A	182	93	100
Recommended Mains Fuse Size		A	200	125	125
Motor Rating		kW	5.5	3	3
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14.8	8	8
Unit Nominal Run Amps		A	185	94	102
Recommended Mains Fuse Size		A	200	125	125
Motor Rating		kW	7.5	4	4

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCF015DR-04ADF0	DCF016DR-04AJJO	DCF018DR-04BJK0
Nominal Run Amps	(1)	A	104	115	128
Maximum Start Amps		A	385	288	312
Recommended Mains Fuse Size		A	125	160	160
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			4	4	4
Quantity		A	4.3	4.3	4.3
Full Load Amps		A	15	15	15
Locked Rotor Amps		kW	2	2	2
Motor Rating					
Condenser Fan - Per Fan (EC)			4	4	4
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 48.2	24.5 / 24.5	24.5 / 31.0
Quantity			1 + 1	4	2 + 2
Motor Rating		kW	24.0 / 28.2	13.7 / 13.7	13.7 / 18.8
Sump Heater Rating			75	75	75
Start Amps		A	260 / 320	180 / 180	180 / 215
Type Of Start			Direct on line	Direct on line	Direct on line
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	20.9	20.9
Circuit 2 Comp RLA (PFC)			42.8	20.9	28.5
Nominal Run Amps		A	95.0	101.5	115.9
Maximum Start Amps		A	380.8	277.6	302.8
Compressor Nominal Run Amps		A	34.2 / 42.8	20.9 / 20.9	20.9 / 28.1
Recommended Mains Fuse Size		A	125	160	160
Electronic Soft-start					
Nominal Run Amps		A	103.7	115.3	128.1
Maximum Start Amps		A	247	209	226
Recommended Mains Fuse		A	125.0	160.0	160.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	95.0	101.5	115.9
Maximum Start Amps		A	244	199	217
Compressor Nominal Run Amps		A	34.2 / 42.8	20.9 / 20.9	20.9 / 28.1
Recommended Mains Fuse Size		A	125	160	160
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			4	4	4
Full Load Amps		A	4.5	4.5	4.5
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.86	2.86	2.86
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	113	124	137
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	4	4	4
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.8	11.8	11.8
Unit Nominal Run Amps		A	116	127	140
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	5.5	5.5	5.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	8
Unit Nominal Run Amps		A	110	122	136
Recommended Mains Fuse Size		A	125	160	160
Motor Rating		kW	3	3	4
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	8	11.2
Unit Nominal Run Amps		A	112	123	139
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	4	4	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCF020DR-06BFK0	DCF023DR-06BKK0	DCF026DR-06BKLO
Nominal Run Amps	(1)	A	136	150	164
Maximum Start Amps		A	408	334	386
Recommended Mains Fuse Size		A	160	200	200
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	6	6
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			6	6	6
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	48.2 / 31.0	31.0 / 31.0	31.0 / 38.3
Quantity			1 + 2	2 + 2	2 + 2
Motor Rating		kW	28.2 / 18.5	18.5 / 18.5	18.5 / 24.0
Sump Heater Rating		W	130 / 75	75	75
Start Amps		A	320 / 215	215 / 215	215 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			42.8	28.5	28.5
Circuit 2 Comp RLA (PFC)			28.5	28.5	36.5
Nominal Run Amps		A	126.0	139.4	151.6
Maximum Start Amps		A	403.2	326.3	377.4
Compressor Nominal Run Amps		A	42.8 / 28.1	28.1 / 28.1	28.1 / 34.2
Recommended Mains Fuse Size		A	160	200	200
Electronic Soft-start					
Nominal Run Amps		A	135.9	149.6	164.3
Maximum Start Amps		A	280	248	282
Recommended Mains Fuse		A	160.0	200.0	200.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	126.0	139.4	15.6
Maximum Start Amps		A	275	240	273
Compressor Nominal Run Amps		A	42.8 / 28.1	28.1 / 28.1	28.1 / 34.2
Recommended Mains Fuse Size		A	160	200	200
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			6	6	6
Full Load Amps		A	4.5	4.5	4.5
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.86	2.86	2.86
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	12
Unit Nominal Run Amps		A	145	159	176
Recommended Mains Fuse Size		A	200	200	200
Motor Rating		kW	4	4	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.8	11.8	11.8
Unit Nominal Run Amps		A	148	161	176
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	5.5	5.5	5.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	8	11.2
Unit Nominal Run Amps		A	144	158	175
Recommended Mains Fuse Size		A	160	200	200
Motor Rating		kW	4	4	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	14.8
Unit Nominal Run Amps		A	147	161	179
Recommended Mains Fuse Size		A	160	200	200
Motor Rating		kW	5.5	5.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Regular Quiet Continued

ELECTRICAL DATA Unit Data			DCF029DR-06BLL0	DCF032DR-08BLMO	DCF035DR-08BMM0
Nominal Run Amps	(1)	A	179	207	227
Maximum Start Amps		A	401	479	499
Recommended Mains Fuse Size		A	250	250	250
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			6	8	8
Full Load Amps		A	4.3	4.3	4.3
Locked Rotor Amps		A	15	15	15
Motor Rating		kW	2	2	2
Condenser Fan - Per Fan (EC)					
Quantity			6	6	8
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	38.3 / 38.3	38.3 / 48.2	48.2 / 48.2
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	24.0 / 24.0	24.0 / 28.2	28.2 / 28.2
Sump Heater Rating		W	75	75 + 130	130
Start Amps		A	260 / 260	260 / 320	320 / 320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			36.5	36.5	42.8
Circuit 2 Comp RLA (PFC)			36.5	42.8	42.8
Nominal Run Amps		A	163.8	190.0	207.3
Maximum Start Amps		A	389.6	467.2	484.4
Compressor Nominal Run Amps		A	34.2 / 34.2	34.2 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250	250
Electronic Soft-start					
Nominal Run Amps		A	179.0	207.4	227.2
Maximum Start Amps		A	297	351	371
Recommended Mains Fuse		A	250.0	250.0	250.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	163.8	190.0	207.3
Maximum Start Amps		A	286	339	356
Compressor Nominal Run Amps		A	34.2 / 34.2	34.2 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250	250
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			6	8	8
Full Load Amps		A	4.5	4.5	4.5
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.86	2.86	2.86
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	12	12	12
Unit Nominal Run Amps		A	191	219	239
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14	14	14
Unit Nominal Run Amps		A	193	221	241
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	7.5	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	11.2	11.2
Unit Nominal Run Amps		A	190	219	238
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	5.5	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	14.8	14.8	14.8
Unit Nominal Run Amps		A	194	222	242
Recommended Mains Fuse Size		A	250	250	250
Motor Rating		kW	7.5	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Regular Quiet Continued

ELECTRICAL DATA Unit Data				DCF039DR-10BMS0	DCF044DR-10BSS0	DCF014SX-04AL00
Nominal Run Amps	(1)	A	254	273	87	
Maximum Start Amps		A	526	494	308	
Recommended Mains Fuse Size		A	315	315	125	
Mains Supply		VAC		400 V 3 PH 50 Hz		
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar		
Recommended Permanent Fuse Size		A	16	16	16	
Permanent Supply		VAC		230 V 1 PH 50 Hz		
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals		
Control Circuit		VAC		24V/230VAC		
Evaporator		W	100	100	80	
Pad Heater Rating		W	500	500	500	
External Trace Heating						
Available (fitted by others)						
Condenser Fan - Per Fan (AC)						
Quantity			10	10	4	
Full Load Amps		A	4.3	4.3	2.5	
Locked Rotor Amps		A	15	15	8.8	
Motor Rating		kW	2	2	1.27	
Condenser Fan - Per Fan (EC)						
Quantity			10	10	4	
Full Load Amps		A	3.9	3.9	3.9	
Locked Rotor Amps		A	N/A	N/A	N/A	
Motor Rating		kW	2.56	2.56	2.56	
Compressor - Per Compressor						
Nominal Run Amps		A	48.2 / 38.3	38.3 / 38.3	38.3	
Quantity			2 + 3	3 + 3	2	
Motor Rating		kW	28.2 / 24.0	24.0 / 24.0	24.0	
Sump Heater Rating		W	130 + 75	75	75	
Start Amps		A	320 / 260	260 / 260	260	
Type Of Start				Direct on line		
OPTIONAL EXTRAS						
Power Factor Correction						
Circuit 1 Comp RLA (PFC)			42.8	36.5	36.5	
Circuit 2 Comp RLA (PFC)			36.5	36.5	N/A	
Nominal Run Amps		A	233.2	250.2	78.4	
Maximum Start Amps		A	510.4	476.0	304.2	
Compressor Nominal Run Amps		A	42.8 / 34.2	34.2 / 34.2	34.2	
Recommended Mains Fuse Size		A	315	315	125	
Electronic Soft-start						
Nominal Run Amps		A	254.3	272.7	86.6	
Maximum Start Amps		A	398	390	204	
Recommended Mains Fuse		A	315.0	315.0	125.0	
Power Factor Correction & Electronic Soft Start						
Nominal Run Amps		A	233.2	250.2	78.4	
Maximum Start Amps		A	382	372	200	
Compressor Nominal Run Amps		A	42.8 / 34.2	34.2 / 34.2	34.2	
Recommended Mains Fuse Size		A	315	315	125	
Condenser Fan - Per Fan (EC Extra Freecooling)						
Quantity			10	10	N/A	
Full Load Amps		A	4.5	4.5	N/A	
Locked Rotor Amps		A	N/A	N/A	N/A	
Motor Rating		kW	2.86	2.86	N/A	
Standard Head Pump (Single or Run/Standby)						
Pump Full Load Amps		A	14	14	6.6	
Unit Nominal Run Amps		A	268	287	93	
Recommended Mains Fuse Size		A	315	355	125	
Motor Rating		kW	7.5	7.5	3	
Larger Head Pump (Single or Run/Standby)						
Pump Full Load Amps		A	20.8	20.8	9.8	
Unit Nominal Run Amps		A	275	294	96	
Recommended Mains Fuse Size		A	315	355	125	
Motor Rating		kW	11	11	4	
Standard Head Inverter Pump (Single or Run/Standby)						
Pump Full Load Amps		A	14.8	14.8	6.3	
Unit Nominal Run Amps		A	269	288	93	
Recommended Mains Fuse Size		A	315	355	125	
Motor Rating		kW	7.5	7.5	3	
Larger Head Inverter Pump (Single or Run/Standby)						
Pump Full Load Amps		A	21.2	21.2	8	
Unit Nominal Run Amps		A	275	294	95	
Recommended Mains Fuse Size		A	315	355	125	
Motor Rating		kW	11	11	4	

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Extra Quiet

ELECTRICAL DATA				DCF017SX-04AM00	DCF021SX-06BS00	DCF025SX-06BT00
Unit Data						
Nominal Run Amps	(1)	A	106	130	160	
Maximum Start Amps		A	378	313	383	
Recommended Mains Fuse Size		A	125	200	200	
Mains Supply		VAC		400 V 3 PH 50 Hz		
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar		
Recommended Permanent Fuse Size		A	16	16	16	
Permanent Supply		VAC		230 V 1 PH 50 Hz		
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals		
Control Circuit		VAC		24V/230VAC		
Evaporator		W	80	100	100	
Pad Heater Rating		W	500	500	500	
External Trace Heating						
Available (fitted by others)						
Condenser Fan - Per Fan (AC)			4	6	6	
Quantity		A	2.5	2.5	2.5	
Full Load Amps		A	8.8	8.8	8.8	
Locked Rotor Amps		kW	1.3	1.3	1.3	
Motor Rating						
Condenser Fan - Per Fan (EC)			4	6	6	
Quantity		A	3.9	3.9	3.9	
Full Load Amps		A	N/A	N/A	N/A	
Locked Rotor Amps		kW	2.56	2.56	2.56	
Motor Rating						
Compressor - Per Compressor						
Nominal Run Amps		A	48.2	38.3	48.2	
Quantity			2	3	3	
Motor Rating		kW	28.2	24.0	28.2	
Sump Heater Rating		W	130	75	130	
Start Amps		A	320	260	320	
Type Of Start				Direct on line		
OPTIONAL EXTRAS						
Power Factor Correction						
Circuit 1 Comp RLA (PFC)			42.8	36.5	42.8	
Circuit 2 Comp RLA (PFC)			N/A	N/A	N/A	
Nominal Run Amps		A	95.6	117.6	143.4	
Maximum Start Amps		A	372.8	309.2	377.8	
Compressor Nominal Run Amps		A	42.8	34.2	42.8	
Recommended Mains Fuse Size		A	125	160	200	
Electronic Soft-start		A	106.4	129.9	159.6	
Nominal Run Amps		A	250	248	303	
Maximum Start Amps		A	125.0	200.0	200.0	
Recommended Mains Fuse						
Power Factor Correction & Electronic Soft Start						
Nominal Run Amps		A	95.6	117.6	143.4	
Maximum Start Amps		A	245	239	293	
Compressor Nominal Run Amps		A	42.8	34.2	42.8	
Recommended Mains Fuse Size		A	125	160	200	
Condenser Fan - Per Fan (EC Extra Freecooling)						
Quantity		A	N/A	N/A	N/A	
Full Load Amps		A	N/A	N/A	N/A	
Locked Rotor Amps		A	N/A	N/A	N/A	
Motor Rating		kW	N/A	N/A	N/A	
Standard Head Pump (Single or Run/Standby)		A	8.9	8.9	8.9	
Pump Full Load Amps		A	115	139	169	
Unit Nominal Run Amps		A	160	200	200	
Recommended Mains Fuse Size		kW	4	4	4	
Motor Rating						
Larger Head Pump (Single or Run/Standby)		A	11.8	11.8	11.8	
Pump Full Load Amps		A	118	142	171	
Unit Nominal Run Amps		A	160	200	200	
Recommended Mains Fuse Size		kW	5.5	5.5	5.5	
Motor Rating						
Standard Head Inverter Pump (Single or Run/Standby)		A	6.3	8	11.2	
Pump Full Load Amps		A	113	138	171	
Unit Nominal Run Amps		A	160	200	200	
Recommended Mains Fuse Size		kW	3	4	5.5	
Motor Rating						
Larger Head Inverter Pump (Single or Run/Standby)		A	8	11.2	14.8	
Pump Full Load Amps		A	114	141	174	
Unit Nominal Run Amps		A	160	200	200	
Recommended Mains Fuse Size		kW	4	5.5	7.5	
Motor Rating						

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCF013DX-04ACD0	DCF014DX-04ADD0	DCF015DX-04ADF0
Nominal Run Amps	(1)	A	79	87	97
Maximum Start Amps		A	308	308	378
Recommended Mains Fuse Size		A	125	125	125
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	80	80
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			4	4	4
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.3	1.3	1.3
Condenser Fan - Per Fan (EC)					
Quantity			4	4	4
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 38.3	38.3 / 38.3	38.3 / 48.2
Quantity			1 + 1	1 + 1	1 + 1
Motor Rating		kW	18.5 / 24.0	24.0 / 24.0	24.0 / 28.2
Sump Heater Rating		W	75	75	75
Start Amps		A	215 / 260	260 / 260	260 / 320
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	36.5	36.5
Circuit 2 Comp RLA (PFC)			36.5	36.5	42.8
Nominal Run Amps		A	72.3	78.4	87.0
Maximum Start Amps		A	304.2	304.2	372.8
Compressor Nominal Run Amps		A	28.1 / 34.2	34.2 / 34.2	34.2 / 42.8
Recommended Mains Fuse Size		A	125	125	125
Electronic Soft-start					
Nominal Run Amps		A	79.2	86.6	96.5
Maximum Start Amps		A	197	204	240
Recommended Mains Fuse		A	125.0	125.0	125.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	72.3	78.4	87.0
Maximum Start Amps		A	194	200	236
Compressor Nominal Run Amps		A	28.1 / 34.2	34.2 / 34.2	34.2 / 42.8
Recommended Mains Fuse Size		A	125	125	125
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			N/A	N/A	N/A
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	N/A	N/A	N/A
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.6	6.6	6.6
Unit Nominal Run Amps		A	86	93	103
Recommended Mains Fuse Size		A	125	125	125
Motor Rating		kW	3	3	3
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	9.8	9.8	9.8
Unit Nominal Run Amps		A	89	96	106
Recommended Mains Fuse Size		A	125	125	125
Motor Rating		kW	4	4	4
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	6.3	6.3
Unit Nominal Run Amps		A	86	93	103
Recommended Mains Fuse Size		A	125	125	125
Motor Rating		kW	3	3	3
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	8	8
Unit Nominal Run Amps		A	87	95	105
Recommended Mains Fuse Size		A	125	125	125
Motor Rating		kW	4	4	4

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCF016DX-04AJJ0	DCF018DX-04BJK0	DCF020DX-06BFK0
Nominal Run Amps	(1)	A	108	121	125
Maximum Start Amps		A	281	305	397
Recommended Mains Fuse Size		A	160	160	160
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	80	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)					
Quantity			4	4	6
Full Load Amps		A	2.5	2.5	2.5
Locked Rotor Amps		A	8.8	8.8	8.8
Motor Rating		kW	1.3	1.3	1.3
Condenser Fan - Per Fan (EC)					
Quantity			4	4	6
Full Load Amps		A	3.9	3.9	3.9
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	2.56	2.56	2.56
Compressor - Per Compressor					
Nominal Run Amps		A	24.5 / 24.5	24.5 / 31.0	48.2 / 31.0
Quantity			4	2 + 2	1 + 2
Motor Rating		kW	13.7 / 13.7	13.7 / 18.5	28.2 / 18.5
Sump Heater Rating		W	75	75	130 / 75
Start Amps		A	180 / 180	180 / 215	320 / 215
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			20.9	20.9	42.8
Circuit 2 Comp RLA (PFC)			20.9	28.5	28.5
Nominal Run Amps		A	93.5	107.9	114.0
Maximum Start Amps		A	269.6	294.8	391.2
Compressor Nominal Run Amps		A	20.9 / 20.9	20.9 / 28.1	42.8 / 28.1
Recommended Mains Fuse Size		A	160	160	160
Electronic Soft-start					
Nominal Run Amps		A	108.1	120.9	125.1
Maximum Start Amps		A	202	219	269
Recommended Mains Fuse		A	160.0	160.0	160.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	93.5	107.9	114.0
Maximum Start Amps		A	191	209	263
Compressor Nominal Run Amps		A	20.9 / 20.9	20.9 / 28.1	42.8 / 28.1
Recommended Mains Fuse Size		A	160	160	160
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			N/A	N/A	N/A
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	N/A	N/A	N/A
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	8.9	8.9
Unit Nominal Run Amps		A	117	130	134
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	4	4	4
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.8	11.8	11.8
Unit Nominal Run Amps		A	120	133	137
Recommended Mains Fuse Size		A	160	160	200
Motor Rating		kW	5.5	5.5	5.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	6.3	8	8
Unit Nominal Run Amps		A	114	129	133
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	3	4	4
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	11.2	11.2
Unit Nominal Run Amps		A	116	132	136
Recommended Mains Fuse Size		A	160	160	160
Motor Rating		kW	4	5.5	5.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCF023DX-06BKK0	DCF026DX-08BKLO	DCF029DX-08BLLO
Nominal Run Amps	(1)	A	139	158	173
Maximum Start Amps		A	323	380	395
Recommended Mains Fuse Size		A	160	200	250
Mains Supply		VAC		400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²		Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16	16
Permanent Supply		VAC		230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²		4 mm ² terminals	
Control Circuit		VAC		24V/230VAC	
Evaporator		W	100	100	100
Pad Heater Rating		W	500	500	500
External Trace Heating					
Available (fitted by others)					
Condenser Fan - Per Fan (AC)			6	8	8
Quantity		A	2.5	2.5	2.5
Full Load Amps		A	8.8	8.8	8.8
Locked Rotor Amps		kW	1.3	1.3	1.3
Motor Rating					
Condenser Fan - Per Fan (EC)			6	8	8
Quantity		A	3.9	3.9	3.9
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56	2.56
Motor Rating					
Compressor - Per Compressor					
Nominal Run Amps		A	31.0 / 31.0	31.0 / 38.3	38.3 / 38.3
Quantity			2 + 2	2 + 2	2 + 2
Motor Rating		kW	18.5 / 18.5	18.5 / 24.0	24.0 / 24.0
Sump Heater Rating		W	75	75	75
Start Amps		A	215 / 215	215 / 260	260 / 260
Type Of Start				Direct on line	
OPTIONAL EXTRAS					
Power Factor Correction					
Circuit 1 Comp RLA (PFC)			28.5	28.5	36.5
Circuit 2 Comp RLA (PFC)			28.5	36.5	36.5
Nominal Run Amps		A	127.4	144.6	156.8
Maximum Start Amps		A	314.3	370.4	382.6
Compressor Nominal Run Amps		A	28.1 / 28.1	28.1 / 34.2	34.2 / 34.2
Recommended Mains Fuse Size		A	160	200	250
Electronic Soft-start					
Nominal Run Amps		A	138.8	158.5	173.2
Maximum Start Amps		A	237	276	291
Recommended Mains Fuse		A	160.0	200.0	250.0
Power Factor Correction & Electronic Soft Start					
Nominal Run Amps		A	127.4	144.6	156.8
Maximum Start Amps		A	228	266	279
Compressor Nominal Run Amps		A	28.1 / 28.1	28.1 / 34.2	34.2 / 34.2
Recommended Mains Fuse Size		A	160	200	250
Condenser Fan - Per Fan (EC Extra Freecooling)					
Quantity			N/A	N/A	N/A
Full Load Amps		A	N/A	N/A	N/A
Locked Rotor Amps		A	N/A	N/A	N/A
Motor Rating		kW	N/A	N/A	N/A
Standard Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8.9	12	12
Unit Nominal Run Amps		A	148	170	185
Recommended Mains Fuse Size		A	200	250	250
Motor Rating		kW	4	5.5	5.5
Larger Head Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.8	11.8	14
Unit Nominal Run Amps		A	151	170	187
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	5.5	5.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	8	11.2	11.2
Unit Nominal Run Amps		A	147	170	184
Recommended Mains Fuse Size		A	200	250	250
Motor Rating		kW	4	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)					
Pump Full Load Amps		A	11.2	14.8	14.8
Unit Nominal Run Amps		A	150	173	188
Recommended Mains Fuse Size		A	200	200	250
Motor Rating		kW	5.5	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCF032DX-08BLM0	DCF035DX-08BMM0
Nominal Run Amps	(1)	A	193	213
Maximum Start Amps		A	465	485
Recommended Mains Fuse Size		A	250	250
Mains Supply		VAC	400 V 3 PH 50 Hz	
Max Mains Incoming Cable Size		mm ²	Direct to Bus Bar	
Recommended Permanent Fuse Size		A	16	16
Permanent Supply		VAC	230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²	4 mm ² terminals	
Control Circuit		VAC	24V/230VAC	
Evaporator		W	100	100
Pad Heater Rating		W	500	500
External Trace Heating				
Available (fitted by others)				
Condenser Fan - Per Fan (AC)			8	8
Quantity		A	2.5	2.5
Full Load Amps		A	8.8	8.8
Locked Rotor Amps		kW	1.3	1.3
Motor Rating				
Condenser Fan - Per Fan (EC)			8	8
Quantity		A	3.9	3.9
Full Load Amps		A	N/A	N/A
Locked Rotor Amps		kW	2.56	2.56
Motor Rating				
Compressor - Per Compressor				
Nominal Run Amps		A	38.3 / 48.2	48.2 / 48.2
Quantity			2 + 2	2 + 2
Motor Rating		kW	24.0 / 28.2	28.2 / 28.2
Sump Heater Rating		W	75 + 130	130
Start Amps		A	260 / 320	320 / 320
Type Of Start				Direct on line
OPTIONAL EXTRAS				
Power Factor Correction				
Circuit 1 Comp RLA (PFC)			36.5	42.8
Circuit 2 Comp RLA (PFC)			42.8	42.8
Nominal Run Amps		A	174.0	191.3
Maximum Start Amps		A	451.2	468.4
Compressor Nominal Run Amps		A	34.2 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250
Electronic Soft-start		A	193.0	212.8
Nominal Run Amps		A	337	357
Maximum Start Amps		A	250.0	250.0
Recommended Mains Fuse				
Power Factor Correction & Electronic Soft Start				
Nominal Run Amps		A	174.0	191.3
Maximum Start Amps		A	323	340
Compressor Nominal Run Amps		A	34.2 / 42.8	42.8 / 42.8
Recommended Mains Fuse Size		A	250	250
Condenser Fan - Per Fan (EC Extra Freecooling)				
Quantity			N/A	N/A
Full Load Amps		A	N/A	N/A
Locked Rotor Amps		A	N/A	N/A
Motor Rating		kW	N/A	N/A
Standard Head Pump (Single or Run/Standby)				
Pump Full Load Amps		A	12	12
Unit Nominal Run Amps		A	205	225
Recommended Mains Fuse Size		A	250	250
Motor Rating		kW	5.5	5.5
Larger Head Pump (Single or Run/Standby)				
Pump Full Load Amps		A	14	14
Unit Nominal Run Amps		A	207	227
Recommended Mains Fuse Size		A	250	250
Motor Rating		kW	7.5	7.5
Standard Head Inverter Pump (Single or Run/Standby)				
Pump Full Load Amps		A	11.2	11.2
Unit Nominal Run Amps		A	204	224
Recommended Mains Fuse Size		A	250	250
Motor Rating		kW	5.5	5.5
Larger Head Inverter Pump (Single or Run/Standby)				
Pump Full Load Amps		A	14.8	14.8
Unit Nominal Run Amps		A	208	228
Recommended Mains Fuse Size		A	250	250
Motor Rating		kW	7.5	7.5

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Electrical Data Free Cool Chiller Extra Quiet Continued

ELECTRICAL DATA Unit Data			DCF039DX-10BMS0	DCF044DX-12BSS0
Nominal Run Amps	(1)	A	236	260
Maximum Start Amps		A	508	481
Recommended Mains Fuse Size		A	315	315
Mains Supply		VAC		
Max Mains Incoming Cable Size		mm ²		
Recommended Permanent Fuse Size		A	16	16
Permanent Supply		VAC	230 V 1 PH 50 Hz	
Max Permanent Incoming Cable Size		mm ²	4 mm ² terminals	
Control Circuit		VAC	24V/230VAC	
Evaporator		W	100	100
Pad Heater Rating		W	500	500
External Trace Heating				
Available (fitted by others)				
Condenser Fan - Per Fan (AC)				
Quantity			10	12
Full Load Amps		A	2.5	2.5
Locked Rotor Amps		A	8.8	8.8
Motor Rating		kW	1.3	1.3
Condenser Fan - Per Fan (EC)				
Quantity			10	12
Full Load Amps		A	3.4	3.4
Locked Rotor Amps		A	N/A	N/A
Motor Rating		kW	2.2	2.2
Compressor - Per Compressor				
Nominal Run Amps		A	48.2 / 38.3	38.3 / 38.3
Quantity			2 + 3	3 + 3
Motor Rating		kW	28.2 / 24.0	24.0 / 24.0
Sump Heater Rating		W	130 + 75	75
Start Amps		A	320 / 260	260 / 260
Type Of Start			Direct on line	Direct on line
OPTIONAL EXTRAS				
Power Factor Correction				
Circuit 1 Comp RLA (PFC)			42.8	36.5
Circuit 2 Comp RLA (PFC)			36.5	36.5
Nominal Run Amps		A	213.2	235.2
Maximum Start Amps		A	490.4	461.0
Compressor Nominal Run Amps		A	42.8 / 34.2	34.2 / 34.2
Recommended Mains Fuse Size		A	315	315
Electronic Soft-start				
Nominal Run Amps		A	236.3	259.7
Maximum Start Amps		A	380	377
Recommended Mains Fuse		A	315.0	315.0
Power Factor Correction & Electronic Soft Start				
Nominal Run Amps		A	213.2	235.2
Maximum Start Amps		A	362	357
Compressor Nominal Run Amps		A	42.8 / 34.2	34.2 / 34.2
Recommended Mains Fuse Size		A	315	315
Condenser Fan - Per Fan (EC Extra Freecooling)				
Quantity			N/A	N/A
Full Load Amps		A	N/A	N/A
Locked Rotor Amps		A	N/A	N/A
Motor Rating		kW	N/A	N/A
Standard Head Pump (Single or Run/Standby)				
Pump Full Load Amps		A	14	14
Unit Nominal Run Amps		A	250	274
Recommended Mains Fuse Size		A	315	355
Motor Rating		kW	7.5	7.5
Larger Head Pump (Single or Run/Standby)				
Pump Full Load Amps		A	20.8	20.8
Unit Nominal Run Amps		A	257	281
Recommended Mains Fuse Size		A	315	355
Motor Rating		kW	11	11
Standard Head Inverter Pump (Single or Run/Standby)				
Pump Full Load Amps		A	14.8	14.8
Unit Nominal Run Amps		A	251	275
Recommended Mains Fuse Size		A	315	355
Motor Rating		kW	7.5	7.5
Larger Head Inverter Pump (Single or Run/Standby)				
Pump Full Load Amps		A	21.2	21.2
Unit Nominal Run Amps		A	257	281
Recommended Mains Fuse Size		A	315	355
Motor Rating		kW	11	11

(1) Based at 7.2°C Evap / 54.4°C Condensing, AC Standard Fans.

(2) Starting amps refers to the direct on line connections.

Hydronic Data

CAUTION  Full design water flow **MUST** be maintained at all times. Variable water volume is NOT recommended and will invalidate warranty.

Use the formula below to calculate the External Head Available:

$$\boxed{\text{Total Pump Head Available}} - \boxed{\text{Chiller Pressure Drop}} = \boxed{\text{External Head Available}}$$

Example: DCC033DR-08BMH0


Water flow : 15.6 l/s

Pump Option : 6

Chiller Pressure Drop : 39.6 kPa

Total Pump Head Available : 182 kPa

$$\boxed{182 \text{ kPa}} - \boxed{39.6 \text{ kPa}} = \boxed{142.4 \text{ kPa}}$$

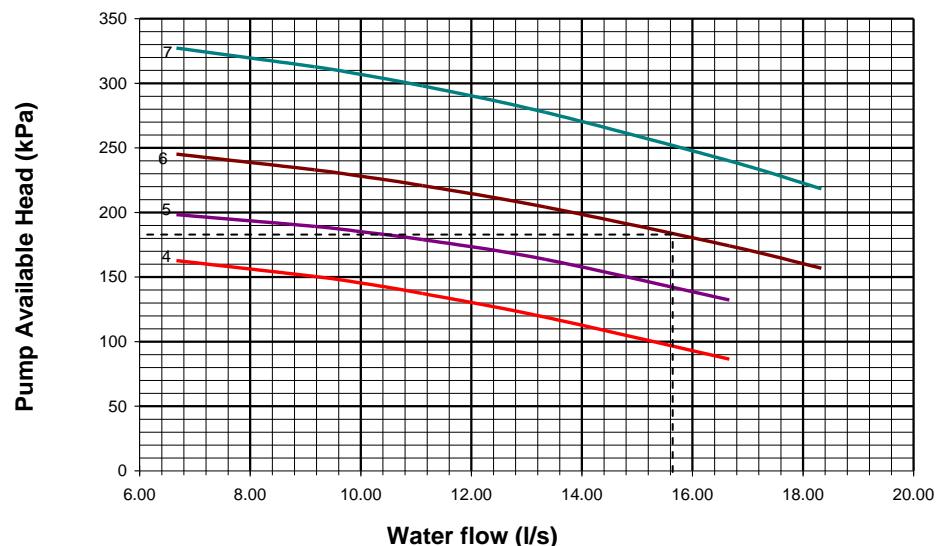

- 1 Chiller pressure drop refers to standard unit only. For pump options, please contact Airedale.
- 2 For glycol solutions, please refer to [Error! Reference source not found.](#), [Error! Bookmark not defined..](#)

NOTE



To determine a flow rate from the available external head; adjust the flow until the unit pressure matches the total head available (from the pump curve minus the pressure drop of the unit). Checks can be made on the evaporator pressure drop to ensure correct operation.

Waterside Pressure Drop - DCC

Unit	Waterflow(l/s)												
	4	6	8	10	12	14	16	18	20	22	24	26	28
	Pressure Drop (kPa)												
DCC011SR-04AK00	22.3	45.5	77.3	118.3	168.9	228.6	296.4						
DCC014SR-04AL00	14.6	30.5	51.2	77.3	109.5	147.7	191.6						
DCC017SR-04AM00	10.7	23.3	39.0	58.5	82.2	110.3	142.9						
DCC021SR-04BS00	6.1	12.5	21.0	31.3	43.5	57.5	73.4						
DCC023SR-04BT00	3.5	8.1	14.1	21.4	30.0	39.8	50.9						
DCC024SR-06BT00	3.5	8.1	14.1	21.4	30.0	39.8	50.9	63.1	76.5				
DCC011DR-04ACCO	19.9	40.7	68.9	105.2	149.9	202.7	262.8						
DCC013DR-04ACD0	14.1	29.7	49.7	75.1	106.2	143.2	185.8						
DCC014DR-04ADDO	14.1	29.7	49.7	75.1	106.2	143.2	185.8						
DCC015DR-04ADF0	10.7	23.3	39.0	58.5	82.2	110.4	143.0						
DCC016DR-04AJ00	10.7	23.3	39.0	58.5	82.2	110.4	143.0						
DCC018DR-04BJK0	7.5	15.3	25.5	38.1	53.0	70.0	89.3						
DCC019DR-04AFK0	7.0	14.6	25.0	37.9	53.1	70.7	90.6						
DCC020DR-06AFK0	7.0	14.7	25.2	38.1	53.5	71.2	91.3	113.8	139.0				
DCC021DR-04AKKO	7.0	14.6	25.0	37.9	53.1	70.7	90.6						
DCC022DR-06AKKO	7.1	14.9	25.4	38.5	54.0	71.9	92.1	114.9	140.3				
DCC024DR-04BKLO	3.2	7.4	13.0	19.8	27.7	36.8	46.9						
DCC025DR-06BKLO	3.2	7.5	13.2	20.0	28.1	37.2	47.6	59.0	71.4				
DCC027DR-04BLLO	3.2	7.4	13.0	19.8	27.7	36.8	46.9						
DCC028DR-06BLLO	3.2	7.5	13.2	20.0	28.1	37.2	47.6	59.0	71.4				
DCC030DR-06BLMO	2.3	5.8	10.2	15.7	22.0	29.3	37.4	46.3	56.1				
DCC031DR-08BLMO		5.8	10.3	15.8	22.3	29.6	37.8	46.8	56.7	67.4	78.9	91.2	104.2
DCC032DR-06BMM0	2.3	5.8	10.2	15.7	22.0	29.3	37.4	46.3	56.1				
DCC033DR-08BMM0		5.7	10.2	15.7	22.0	29.3	37.4	46.3	56.1	66.6	78.0	90.1	103.0
DCC036DR-06BMS0	2.6	4.3	6.7	10.0	13.9	18.4	23.6	29.4	35.7	42.6	49.9	57.7	65.9
DCC038DR-10BMS0		4.3	6.7	10.0	13.9	18.4	23.6	29.4	35.7	42.6	49.9	57.7	65.9
DCC039DR-06BSS0	2.6	4.3	6.7	10.0	13.9	18.4	23.6	29.4	35.7	42.6	49.9	57.7	65.9
DCC042DR-10BSS0		4.3	6.7	10.0	13.9	18.4	23.6	29.4	35.7	42.6	49.9	57.7	65.9
DCC043DR-08BST0		6.4	8.3	10.3	12.5	15.1	18.1	21.6	25.7	30.3	35.7	41.7	48.5
DCC045DR-10BST0		6.3	8.2	10.2	12.5	15.0	18.0	21.4	25.4	30.1	35.4	41.4	48.1
DCC046DR-08BTTO		6.4	8.3	10.3	12.5	15.1	18.1	21.6	25.7	30.3	35.7	41.7	48.5
DCC048DR-10BTTO		6.3	8.2	10.2	12.5	15.0	18.0	21.4	25.4	30.1	35.4	41.4	48.1
DCC051DR-08BVV0		6.4	8.3	10.3	12.5	15.1	18.1	21.6	25.7	30.3	35.7	41.7	48.5
DCC011SX-04AK00	22.3	45.5	77.3	118.3	168.9	228.6	296.4						
DCC014SX-04AL00	14.6	30.5	51.2	77.3	109.5	147.7	191.6						
DCC017SX-04AM00	10.7	23.3	39.0	58.5	82.2	110.3	142.9						
DCC021SX-06BS00	6.1	12.5	21.0	31.3	43.5	57.5	73.4	91.1	110.9				
DCC023SX-04BT00	3.5	8.1	14.1	21.4	30.0	39.8	50.9						
DCC024SX-06BT00	3.5	8.1	14.0	21.3	29.9	39.7	50.7	62.8	76.2				
DCC011DX-04ACCO	19.9	40.7	68.9	105.2	149.9	202.7	262.8						
DCC013DX-04ACD0	14.1	29.7	49.7	75.1	106.2	143.2	185.8						
DCC014DX-04ADDO	14.1	29.7	49.7	75.1	106.2	143.2	185.8						
DCC015DX-04ADF0	10.7	23.3	39.0	58.5	82.2	110.3	142.9						
DCC016DX-04AJ00	10.7	23.3	39.0	58.5	82.2	110.3	142.9						
DCC018DX-04BJK0	7.5	15.2	25.4	37.9	52.6	69.4	88.6						
DCC019DX-04AFK0	7.0	14.6	25.0	37.9	53.1	70.7	90.6						
DCC020DX-06AFK0	7.0	14.6	25.0	37.8	53.1	70.6	90.5	112.9	137.8				
DCC021DX-04AKKO	7.0	14.6	25.0	37.9	53.1	70.7	90.6						
DCC022DX-06AKKO	7.0	14.6	25.0	37.8	53.1	70.6	90.5	112.9	137.8				
DCC024DX-06BKLO	3.2	7.5	13.1	19.9	27.8	36.9	47.2	58.5	70.8				
DCC025DX-08BKLO		7.5	13.1	19.9	27.9	37.1	47.3	58.7	71.1	84.6	99.1	114.7	131.3
DCC027DX-06BLLO	3.2	7.5	13.1	19.9	27.8	36.9	47.2	58.5	70.8				
DCC028DX-08BLLO		7.5	13.1	19.9	27.9	37.1	47.3	58.7	71.1	84.6	99.1	114.7	131.3
DCC030DX-06BLMO	2.3	5.8	10.2	15.7	22.0	29.3	37.4	46.3	56.1				
DCC032DX-06BMM0	2.3	5.8	10.2	15.7	22.0	29.3	37.4	46.3	56.1				
DCC031DX-08BLMO		5.8	10.3	15.7	22.1	29.4	37.6	46.6	56.4	67.0	78.4	90.6	103.6
DCC033DX-08BMM0		5.8	10.3	15.7	22.1	29.4	37.6	46.6	56.4	67.0	78.4	90.6	103.6
DCC036DX-08BMS0	4.3	6.8	10.0	14.0	18.6	23.8	29.6	36.0	42.9	50.3	58.1	66.4	
DCC038DX-10BMS0		4.3	6.9	10.1	14.1	18.7	24.0	29.9	36.3	43.3	50.8	58.7	67.1
DCC039DX-08BSS0		4.3	6.8	10.0	14.0	18.6	23.8	29.6	36.0	42.9	50.3	58.1	66.4
DCC042DX-12BSS0		4.4	6.9	10.2	14.2	18.9	24.3	30.2	36.7	43.7	51.3	59.3	67.7
DCC043DX-08BST0		6.4	8.3	10.3	12.5	15.1	18.1	21.6	25.7	30.3	35.7	41.7	48.5
DCC045DX-12BST0		6.4	8.4	10.5	12.8	15.5	18.6	22.2	26.4	31.2	36.7	42.9	49.8
DCC046DX-10BTTO		6.4	8.3	10.4	12.7	15.3	18.3	21.9	26.0	30.8	36.2	42.3	49.2
DCC048DX-12BTTO		6.4	8.4	10.5	12.8	15.5	18.6	22.2	26.4	31.2	36.7	42.9	49.8
DCC051DX-10BVV0		6.4	8.3	10.4	12.7	15.3	18.3	21.9	26.0	30.8	36.2	42.3	49.2


Waterside pressure drops based upon a standard configured unit. For pressure drop information with different configurations contact Airedale.

Waterside Pressure Drop - DCF


Unit	Waterflow(l/s)												
	4	6	8	10	12	14	16	18	20	22	24	26	28
Pressure Drop (kPa)													
DCF014SR-04AL00	30.9	61.7	103.0	154.5	216.1	287.7	369.1						
DCF017SR-04AM00	28.0	55.7	93.0	139.7	195.7	260.8	335.1						
DCF021SR-04BS00	21.5	44.2	73.3	108.9	150.8	198.9	253.3						
DCF025SR-06BT00	10.1	24.7	43.0	64.8	90.3	119.2	151.7	187.6	227.0				
DCF013DR-04ACDO	30.9	61.7	103.0	154.6	216.2	287.8	369.2						
DCF014DR-04ADDO	30.9	61.7	103.0	154.5	216.1	287.7	369.1						
DCF015DR-04ADF0	27.8	55.5	92.6	139.0	194.7	259.6	333.6						
DCF016DR-04AJJ0	27.8	55.5	92.6	139.0	194.7	259.5	333.5						
DCF018DR-04BJK0	24.2	48.0	79.9	119.9	167.9	223.8	287.6						
DCF020DR-06BFK0	15.7	32.8	54.9	81.7	113.2	149.4	190.2	235.7	285.6				
DCF023DR-06BK0	15.7	32.8	54.8	81.6	113.1	149.3	190.1	235.6	285.5				
DCF026DR-06BKLO	9.2	22.9	39.9	60.3	83.9	110.8	141.0	174.4	211.1				
DCF029DR-06BLLO	9.2	22.8	39.8	60.2	83.8	110.8	140.9	174.3	211.0				
DCF032DR-08BLMO	15.3	26.6	39.9	55.2	72.6	91.9	113.2	136.5	161.8	188.9	218.0	249.1	
DCF035DR-08BMM0	15.2	26.5	39.9	55.2	72.5	91.9	113.2	136.5	161.7	188.9	218.0	249.0	
DCF039DR-10BMS0	11.4	20.3	30.9	43.0	56.6	71.8	88.4	106.7	126.4	147.6	170.4	194.7	
DCF044DR-10BSS0	11.3	20.3	30.8	42.9	56.5	71.7	88.4	106.6	126.3	147.6	170.3	194.6	
DCF014SX-04AL00	30.9	61.7	103.0	154.5	216.1	287.7	369.2						
DCF017SX-04AM00	28.0	55.8	93.1	139.7	195.7	260.9	335.2						
DCF021SX-06BS00	16.7	34.9	58.3	86.8	120.4	158.9	202.4	250.7	303.8				
DCF025SX-06BT00	10.2	24.9	43.3	65.3	90.9	120.1	152.8	189.0	228.7				
DCF013DX-04ACDO	30.9	61.8	103.0	154.6	216.2	287.8	369.3						
DCF014DX-04ADDO	30.9	61.7	103.0	154.5	216.1	287.7	369.2						
DCF015DX-04ADF0	27.9	55.5	92.6	139.1	194.8	259.6	333.6						
DCF016DX-04AJJ0	27.8	55.5	92.6	139.0	194.7	259.6	333.6						
DCF018DX-04BJK0	24.2	48.0	79.9	119.8	167.8	223.7	287.5						
DCF020DX-06BFK0	19.4	38.8	65.0	98.0	137.8	184.2	237.2	296.9	363.1				
DCF023DX-06BK0	15.7	32.8	54.8	81.6	113.1	149.3	190.2	235.6	285.6				
DCF026DX-08BKLO	19.3	34.2	52.0	72.7	96.3	122.6	151.8	183.8	218.5	255.9	296.2	339.1	
DCF029DX-08BLLO	19.2	34.2	52.0	72.7	96.2	122.6	151.7	183.7	218.4	255.9	296.1	339.0	
DCF032DX-08BLMO	15.3	26.6	39.9	55.3	72.6	92.0	113.3	136.6	161.8	189.0	218.1	249.1	
DCF035DX-08BMM0	15.2	26.5	39.9	55.2	72.6	91.9	113.2	136.5	161.7	188.9	218.0	249.0	
DCF039DX-10BMS0	11.4	20.4	30.9	43.0	56.6	71.8	88.5	106.7	126.4	147.7	170.4	194.7	
DCF044DX-12BSS0	10.3	18.7	28.6	40.0	52.8	67.0	82.7	99.8	118.3	138.2	159.6	182.4	

Waterside pressure drops based upon a standard configured unit including water filter. For pressure drop information with different configurations contact Airedale.

Evaporator Pressure Drops

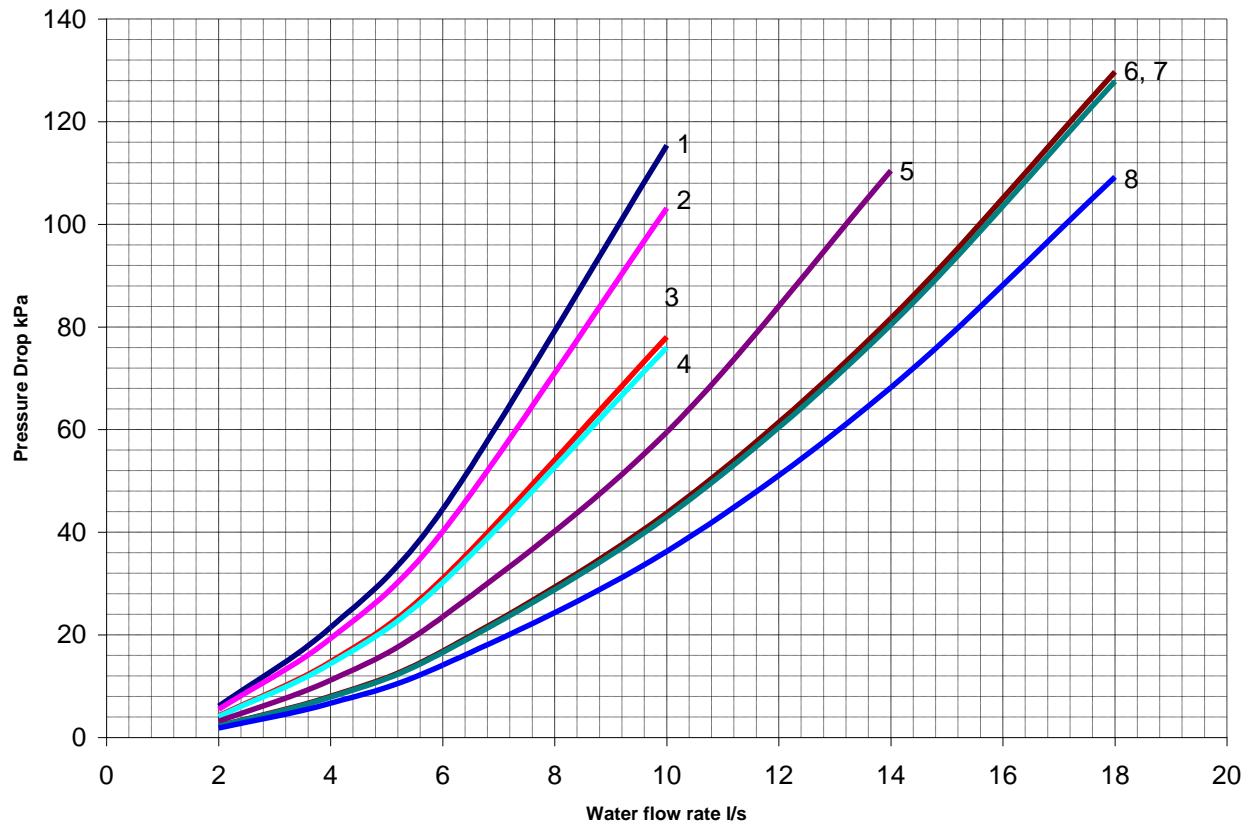

Evaporator Pressure Drop Continued

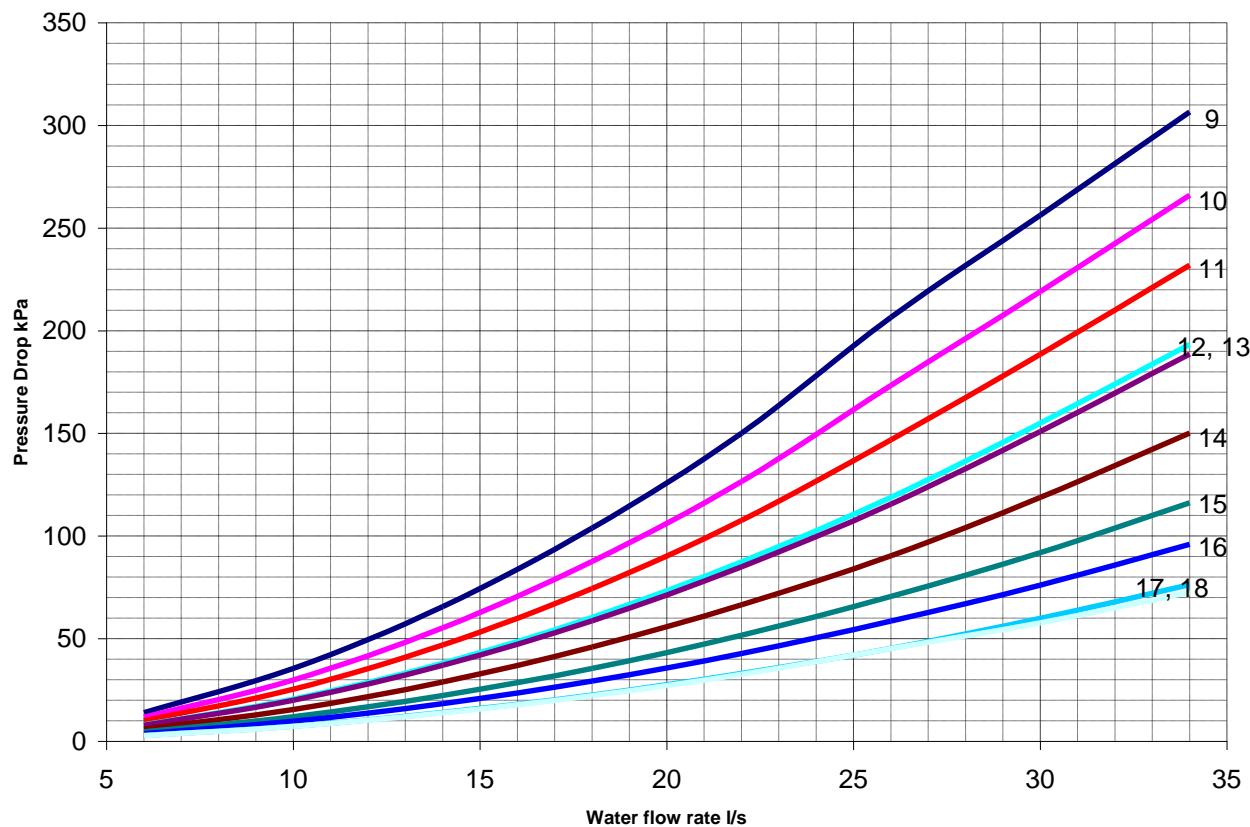

Unit	Graph Reference
DCF014SR-04AL00	5
DCF017SR-04AM00	6
DCF021SR-04BS00	10
DCF025SR-06BT00	12
DCF013DR-04ACD0	5
DCF014DR-04ADD0	5
DCF015DR-04ADFO	7
DCF016DR-04AJJ0	7
DCF018DR-04BJK0	11
DCF020DR-06BFK0	11
DCF023DR-06BKK0	11
DCF026DR-06BKL0	14
DCF029DR-06BL00	14
DCF032DR-08BLM0	15
DCF035DR-08BMM0	15
DCF039DR-10BMS0	17
DCF044DR-10BSS0	17
DCF014SX-04AL00	5
DCF017SX-04AM00	6
DCF021SX-06BS00	10
DCF025SX-06BT00	12
DCF013DX-04ACD0	5
DCF014DX-04ADD0	5
DCF015DX-04ADFO	7
DCF016DX-04AJJ0	7
DCF018DX-04BJK0	11
DCF020DX-06BFK0	11
DCF023DX-06BKK0	11
DCF026DX-08BKL0	14
DCF029DX-08BL00	14
DCF032DX-08BLM0	15
DCF035DX-08BMM0	15
DCF039DX-10BMS0	17
DCF044DX-12BSS0	17

Unit	Graph Reference
DCC011SR-04AK00	1
DCC014SR-04AL00	3
DCC017SR-04AM00	5
DCC021SR-04BS00	10
DCC023SR-04BT00	12
DCC024SR-06BT00	12
DCC011DR-04ACCO	2
DCC013DR-04ACD0	4
DCC014DR-04ADD0	4
DCC015DR-04ADF0	5
DCC016DR-04AJJ0	5
DCC018DR-04BJK0	9
DCC019DR-04AFK0	8
DCC020DR-06AFK0	8
DCC021DR-04AKK0	8
DCC022DR-06AKK0	8
DCC024DR-06BKL0	13
DCC025DR-06BKL0	13
DCC027DR-04BLLO	13
DCC028DR-06BLLO	13
DCC030DR-06BLMO	14
DCC031DR-08BLMO	14
DCC032DR-06BMM0	14
DCC033DR-08BMM0	14
DCC036DR-08BMS0	16
DCC038DR-10BMS0	16
DCC039DR-06BSS0	16
DCC042DR-10BSS0	16
DCC043DR-08BST0	18
DCC045DR-10BST0	18
DCC046DR-08BTTO	18
DCC048DR-10BTTO	18
DCC051DR-08BVV0	18
DCC011SX-04AK00	1
DCC014SX-04AL00	3
DCC017SX-04AM00	5
DCC021SX-06BS00	10
DCC023SX-04BT00	12
DCC024SX-06BT00	12

Unit	Graph Reference
DCC011DX-04ACC0	2
DCC013DX-04ACD0	4
DCC014DX-04ADD0	4
DCC015DX-04ADF0	5
DCC016DX-04AJJ0	5
DCC018DX-04BJK0	9
DCC019DX-04AFK0	8
DCC020DX-06AFK0	8
DCC021DX-04AKK0	8
DCC022DX-06AKK0	8
DCC024DX-06BKL0	13
DCC025DX-08BKL0	13
DCC027DX-06BLLO	13
DCC028DX-08BLLO	13
DCC030DX-06BLMO	14
DCC031DX-08BLMO	14
DCC032DX-06BMM0	14
DCC033DX-08BMM0	14
DCC036DX-08BMS0	16
DCC038DX-10BMS0	16
DCC039DX-08BSS0	16
DCC042DX-12BSS0	16
DCC043DX-08BST0	18
DCC045DX-12BST0	18
DCC046DX-10BTTO	18
DCC048DX-12BTTO	18
DCC051DX-10BVV0	18

Pump Packages**DeltaChill Air Cooled Models**




Air-Cooled	Pump Curve (refer to Graphs)			
	Standard		External Inverter	
	Standard Head	High Head	Standard Head	High Head
DCC011SR-04AK00	4	1	11	12
DCC014SR-04AL00	4	1	11	12
DCC017SR-04AM00	4	2	11	12
DCC021SR-04BS00	4	2	11	12
DCC023SR-04BT00	5	6	15	13
DCC024SR-06BT00	5	6	20	13
DCC011DR-04ACCO	4	1	11	12
DCC013DR-04ACD0	4	1	11	12
DCC014DR-04ADD0	4	1	11	12
DCC015DR-04ADFO	4	1	11	12
DCC016DR-04AJJO	4	2	11	12
DCC018DR-04BJK0	4	2	11	12
DCC019DR-04AFK0	4	2	11	12
DCC020DR-06AFK0	4	2	11	12
DCC021DR-04AKK0	5	6	15	13
DCC022DR-06AKK0	5	6	15	13
DCC024DR-04BKL0	5	6	20	16
DCC025DR-06BKL0	5	6	20	16
DCC027DR-04BLLO	5	6	20	16
DCC028DR-06BLLO	5	6	20	16
DCC030DR-06BLM0	5	6	21	16
DCC031DR-08BLM0	5	6	21	16
DCC032DR-06BMM0	6	8	21	16
DCC033DR-08BMM0	6	8	21	16
DCC036DR-06BMS0	8	9	21	16
DCC038DR-10BMS0	8	9	21	16
DCC039DR-06BSS0	8	9	21	16
DCC042DR-10BSS0	8	9	21	16
DCC043DR-08BST0	8	9	21	18
DCC045DR-10BST0	8	9	21	18
DCC046DR-08BTT0	8	9	21	18
DCC048DR-10BTT0	8	9	21	18
DCC051DR-08BVV0	8	9	21	18
DCC011SX-04AK00	4	1	11	12
DCC014SX-04AL00	4	1	11	12
DCC017SX-04AM00	4	2	11	12
DCC021SX-06BS00	4	2	11	12
DCC023SX-04BT00	5	6	15	13
DCC024SX-06BT00	5	6	15	13
DCC011DX-04ACCO	4	1	11	12
DCC013DX-04ACD0	4	1	11	12
DCC014DX-04ADD0	4	1	11	12
DCC015DX-04ADFO	4	1	11	12
DCC016DX-04AJJO	4	2	11	12
DCC018DX-04BJK0	4	2	11	12
DCC019DX-04AFK0	4	2	11	12
DCC020DX-06AFK0	4	2	11	12
DCC021DX-04AKK0	4	2	11	12
DCC022DX-06AKK0	5	6	15	13
DCC024DX-06BKL0	5	6	20	16
DCC025DX-08BKL0	5	6	20	16
DCC027DX-06BLLO	5	6	20	16
DCC028DX-08BLLO	5	6	20	16
DCC030DX-06BLM0	5	6	21	16
DCC031DX-08BLM0	5	6	21	16
DCC032DX-06BMM0	5	6	21	16
DCC033DX-08BMM0	5	6	21	16
DCC036DX-08BMS0	6	8	21	16
DCC038DX-10BMS0	6	8	21	16
DCC039DX-08BSS0	8	9	21	16
DCC042DX-12BSS0	8	9	21	16
DCC043DX-08BST0	8	9	21	18
DCC045DX-12BST0	8	9	21	18
DCC046DX-10BTT0	8	9	21	18
DCC048DX-12BTT0	8	9	21	18
DCC051DX-10BVV0	8	9	21	18

Pump Packages DeltaChill Freecool Models

	Pump Curve (refer to graphs)			
	Standard		External Inverter	
	Standard Head	High Head	Standard Head	High Head
DCF014SR-04AL00	2	3	12	13
DCF017SR-04AM00	6	7	12	13
DCF021SR-04BS00	6	7	13	14
DCF025SR-06BT00	8	7	16	17
DCF013DR-04ACD0	2	3	12	13
DCF014DR-04ADD0	2	3	12	13
DCF015DR-04ADF0	6	7	12	13
DCF016DR-04AJ00	6	7	12	13
DCF018DR-04BJK0	6	7	13	14
DCF020DR-06BFK0	6	7	13	14
DCF023DR-06BKK0	6	7	13	14
DCF026DR-06BKL0	8	7	16	17
DCF029DR-06BL00	8	9	16	17
DCF032DR-08BLMO	8	9	16	17
DCF035DR-08BMM0	8	9	16	17
DCF039DR-10BMS0	9	10	18	19
DCF044DR-10BSS0	9	10	18	19
DCF014SX-04AL00	2	3	12	13
DCF017SX-04AM00	6	7	12	13
DCF021SX-06BS00	6	7	13	14
DCF025SX-06BT00	6	7	16	17
DCF013DX-04ACD0	2	3	12	13
DCF014DX-04ADD0	2	3	12	13
DCF015DX-04ADF0	2	3	12	13
DCF016DX-04AJ00	6	7	12	13
DCF018DX-04BJK0	6	7	13	14
DCF020DX-06BFK0	6	7	13	14
DCF023DX-06BKK0	6	7	13	14
DCF026DX-08BKL0	8	7	16	17
DCF029DX-08BL00	8	9	16	17
DCF032DX-08BLMO	8	9	16	17
DCF035DX-08BMM0	8	9	16	17
DCF039DX-10BMS0	9	10	18	19
DCF044DX-12BSS0	9	10	18	19


Single Head Pump or Run/Standby

Standard AC Pumps

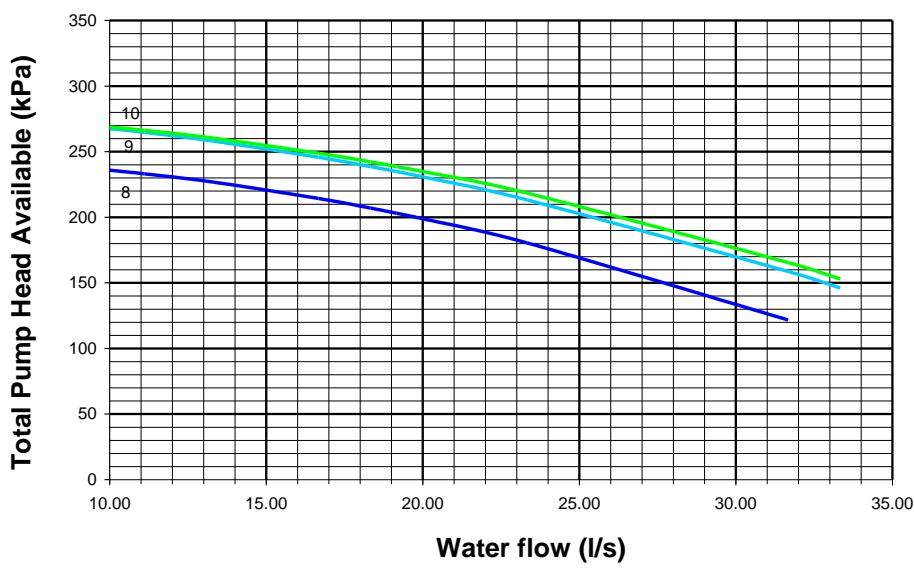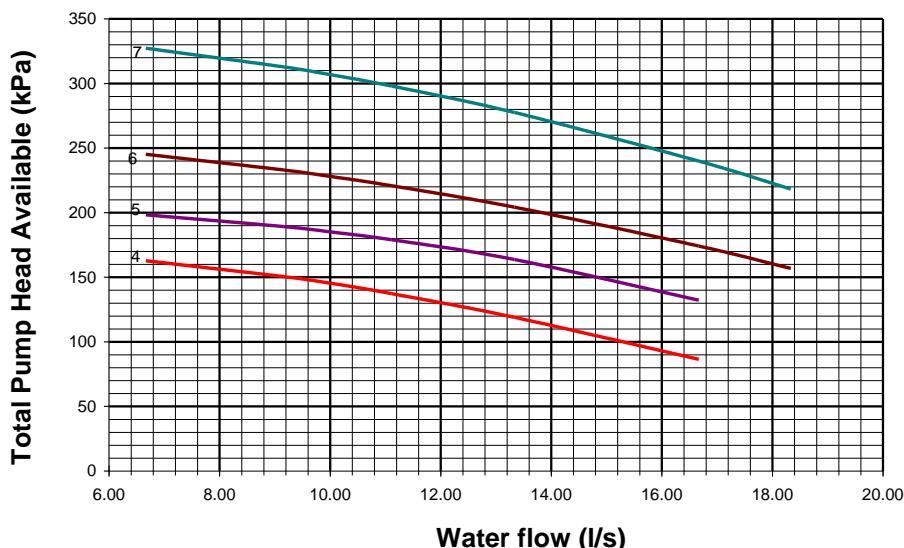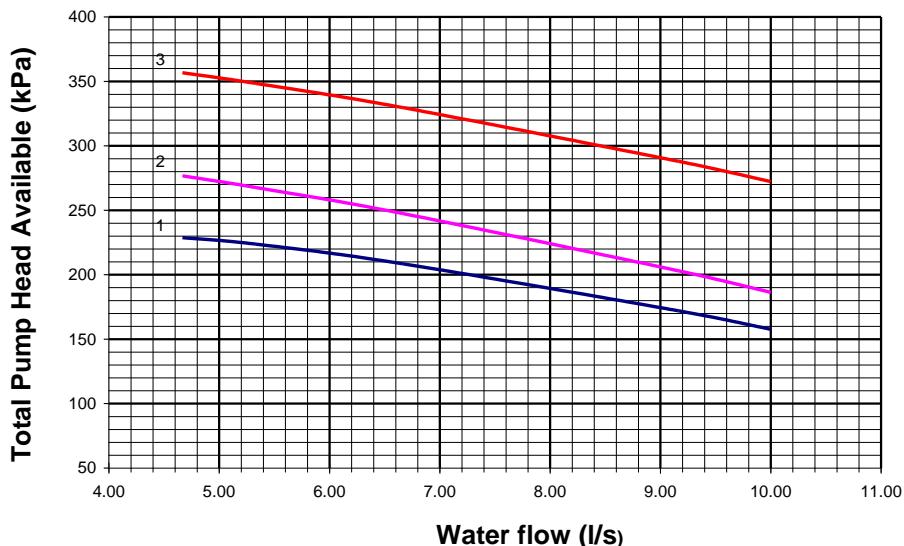

Data based on 20% Ethylene Glycol Solution

Inverter Driven Pumps

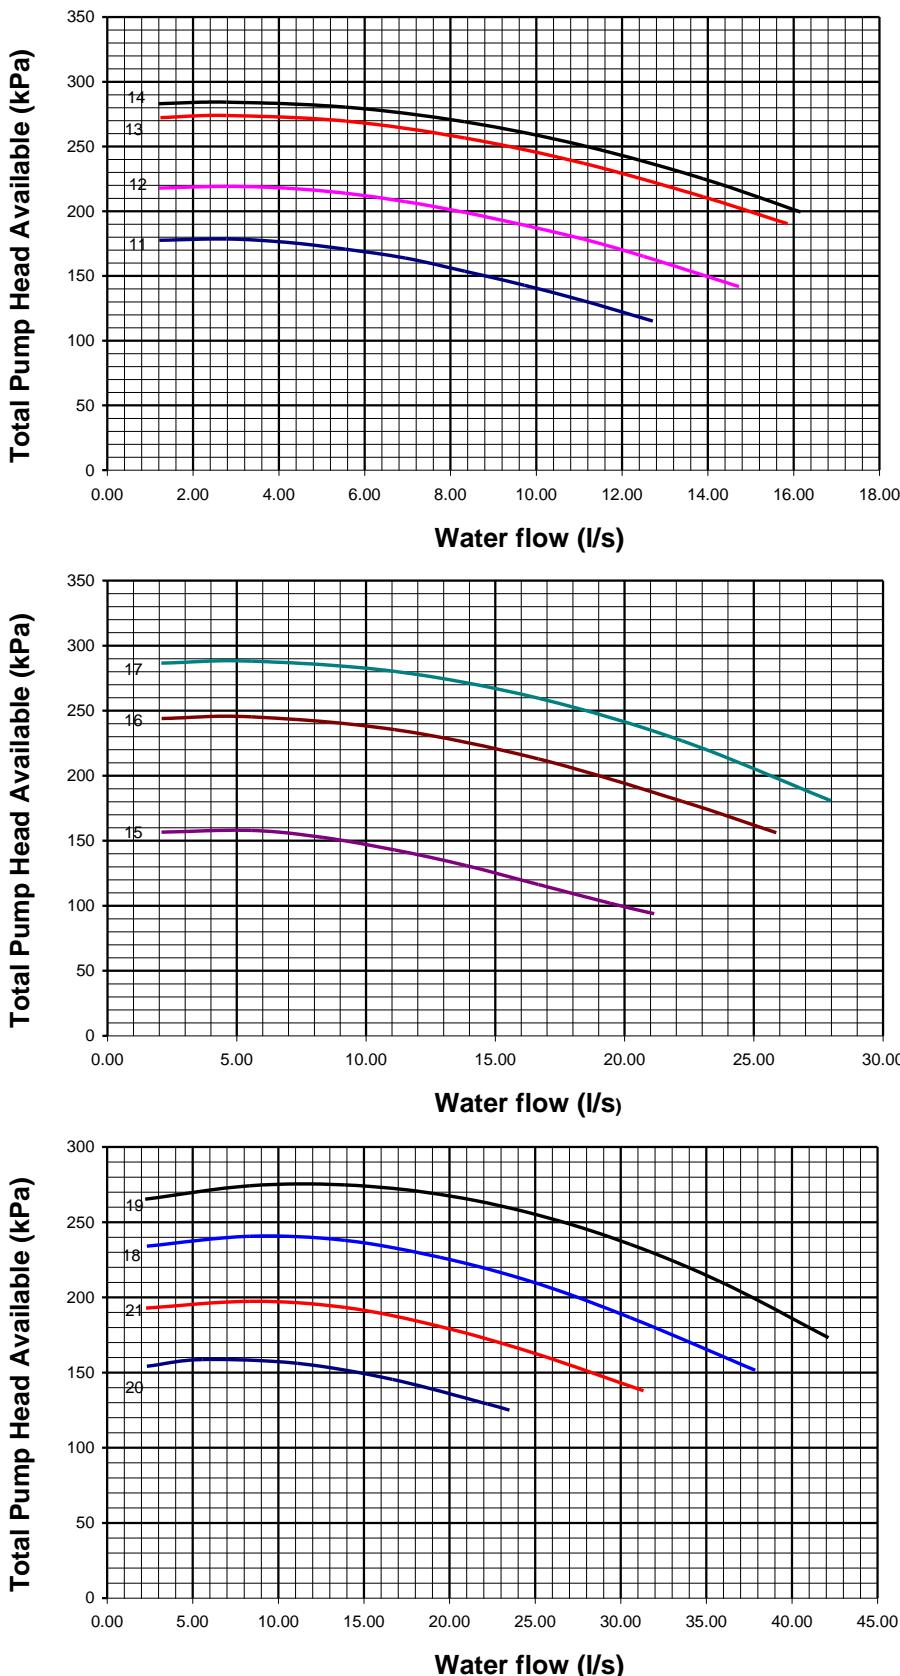


Data based on 20% Ethylene Glycol Solution. Inverters at 50Hz.

Installation Data

Dimensions

IMPORTANT


 The following information is for general guidance; please refer to the certified drawings provided for installation.

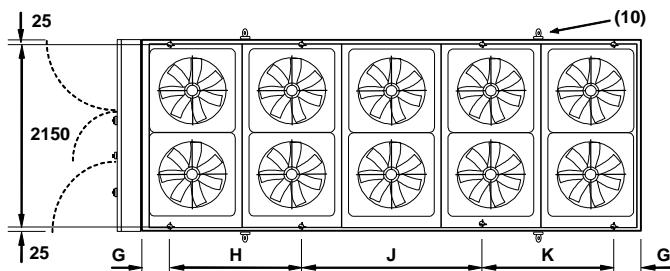
Grooved Water Connections:

Refer to mechanical Data Tables

Evaporator Water Drain/Bleed:
1/2"
20mm Ø Mounting Holes:

4 - 6 Fan Unit	x 4
8 Fan Unit	x 6
10 - 12 Fan Unit	x 8

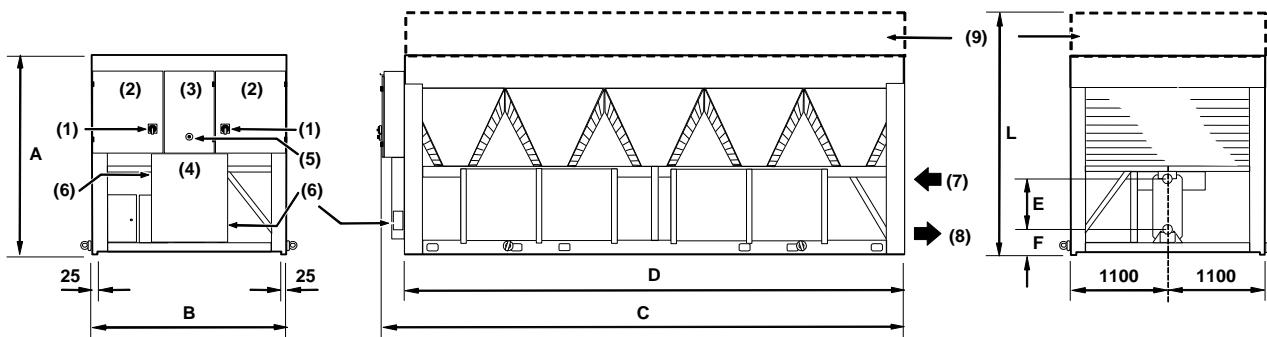


		A	B	C	D	E	F	G	H	J	K	L
4 Fan	mm	2405	2200	2554	2270	550	196	310	1650	N/A	N/A	2905
6 Fan	mm	2415	2200	3690	3407	550	206	712	1982	N/A	N/A	2915
8 Fan	mm	2415	2200	4820	4539	550	206	416	1853	1853	N/A	2915
10 Fan	mm	2415	2200	5956	5672	550	206	311	1500	2050	1500	2915
12 Fan	mm	2415	2200	7090	6805	550	206	595	1782	2050	1782	2915

- (1) Mains Electric Isolator(s).
- (2) Electric Control Panel - Circuit 1 and Circuit 2.
- (3) Microprocessor Control Panel.
- (4) Bus Bar Chamber / Incoming Customer Mains supply.
- (5) Emergency Stop.
- (6) Mains Cable Entry and route to Busbar, unit incoming mains isolation supplied by others.
- (7) Water Connections: Water Inlet
- (8) Water Connections Water Outlet.
- (9) Optional discharge plenum extension
- (10) Lifting Eye Bolts (removable).

Installation Data


Masses, Point Loadings & Centre of Gravity (C of G)

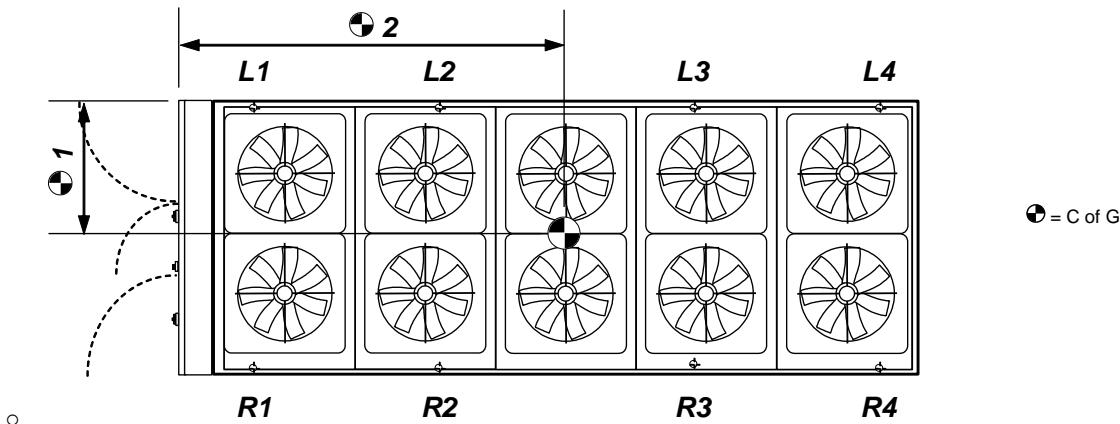

	L1	L2	L3	L4	R1	R2	R3	R4	C of G 1	C of G 2
	P1	P3	P5	P7	P2	P4	P6	P8	mm	mm
DCC011SR-04AK00	340	350			425	440			1220	1145
DCC014SR-04AL00	345	370			460	495			1255	1170
DCC017SR-04AM00	345	380			470	510			1260	1170
DCC021SR-04BS00	430	340			630	500			1305	1035
DCC023SR-04BT00	445	345			660	515			1310	1035
DCC024SR-06BT00	510	515			710	720			1275	1705
DCC011DR-04ACCO	420	280			530	350			1225	970
DCC013DR-04ACDO	420	290			545	380			1240	985
DCC014DR-04ADD0	430	290			575	390			1255	975
DCC015DR-04ADF0	435	295			585	395			1260	975
DCC016DR-04AJJ0	445	305			650	450			1300	985
DCC018DR-04BJK0	460	310			665	450			1300	975
DCC019DR-04AFK0	445	310			630	440			1280	990
DCC020DR-06AFK0	580	410			775	550			1255	1535
DCC021DR-04AKK0	460	310			670	455			1300	975
DCC022DR-06AKK0	590	415			815	570			1270	1530
DCC024DR-04BKL0	475	345			720	520			1320	1000
DCC025DR-06BKL0	605	450			860	640			1285	1560
DCC027DR-04BLLO	495	340			785	540			1340	985
DCC028DR-06BLLO	625	450			925	665			1305	1545
DCC030DR-06BLMO	635	460			940	680			1310	1545
DCC031DR-08BLMO	490	440	395		585	735	515		1275	2110
DCC032DR-06BMM0	640	460			955	685			1315	1540
DCC033DR-08BMM0	490	440	395		605	740	505		1280	2105
DCC036DR-06BMS0	645	515			1000	800			1335	1595
DCC038DR-10BMS0	435	415	395	375	560	555	550	595	1280	2705
DCC039DR-06BSS0	690	495			1125	805			1355	1535
DCC042DR-10BSS0	445	420	400	375	630	620	580	555	1300	2665
DCC043DR-08BST0	545	485	430		730	885	600		1320	2095
DCC045DR-10BST0	460	435	410	385	615	605	595	635	1300	2655
DCC046DR-08BTTO	545	490	430		740	900	610		1325	2090
DCC048DR-10BTTO	465	435	410	385	665	650	605	580	1305	2650
DCC051DR-08BVV0	545	490	430		735	895	605		1325	2085

Installation Data

Masses, Point Loadings & Centre of Gravity (C of G)

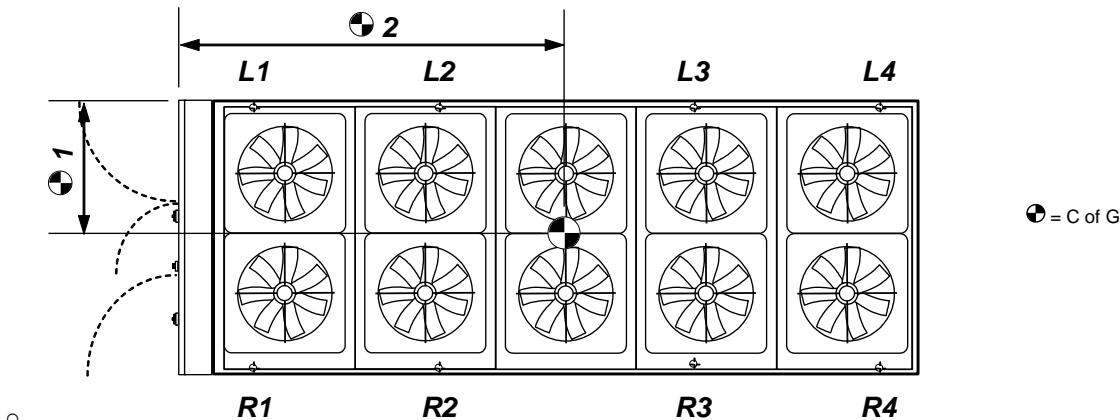


	L1	L2	L3	L4	R1	R2	R3	R4	C of G 1	C of G 2
	P1	P3	P5	P7	P2	P4	P6	P8	mm	mm
DCC011SX-04AK00	375	330			500	435			1250	1080
DCC014SX-04AL00	375	350			530	495			1285	1110
DCC017SX-04AM00	380	360			540	510			1290	1110
DCC021SX-06BS00	495	530			715	765			1295	1740
DCC023SX-04BT00	445	360			705	570			1340	1050
DCC024SX-06BT00	505	540			735	790			1300	1740
DCC011DX-04ACCO	425	290			585	400			1270	980
DCC013DX-04ACDO	425	305			605	430			1285	995
DCC014DX-04ADDO	435	305			635	440			1300	985
DCC015DX-04ADF0	440	305			640	445			1300	985
DCC016DX-04AJJ0	450	320			705	500			1335	995
DCC018DX-04BJK0	465	325			720	500			1335	985
DCC019DX-04AFK0	455	325			685	490			1320	1000
DCC020DX-06AFK0	590	425			850	615			1295	1545
DCC021DX-04AKK0	465	325			725	505			1335	985
DCC022DX-06AKK0	600	430			885	635			1310	1540
DCC024DX-06BKLO	615	470			935	710			1320	1565
DCC025DX-08BKLO	480	440	395		595	755	535		1290	2130
DCC027DX-06BLLO	635	465			995	730			1335	1550
DCC028DX-08BLLO	495	445	395		640	790	540		1305	2110
DCC030DX-06BLMO	645	475			1015	745			1340	1550
DCC031DX-08BLMO	500	450	400		635	800	565		1310	2110
DCC032DX-06BMM0	650	475			1030	750			1345	1550
DCC033DX-08BMM0	500	450	405		660	810	555		1315	2110
DCC036DX-08BMS0	515	470	425		690	875	620		1330	2130
DCC038DX-10BMS0	445	420	405	380	605	600	600	645	1310	2705
DCC039DX-08BSS0	535	480	430		755	925	630		1350	2105
DCC042DX-12BSS0	515	485	465	435	755	715	685	640	1305	3230
DCC043DX-08BST0	555	495	440		780	955	650		1350	2095
DCC045DX-12BST0	525	495	475	445	715	705	700	745	1305	3225
DCC046DX-10BTTO	475	445	420	390	710	695	645	615	1330	2645
DCC048DX-12BTTO	530	500	475	445	770	750	710	680	1310	3215
DCC051DX-10BVV0	475	445	420	390	705	690	640	610	1330	2645

Point loads based upon standard unit configuration

Installation Data

Weights, Point Loadings & Centre of Gravity (C of G) DeltaChill Free Cool

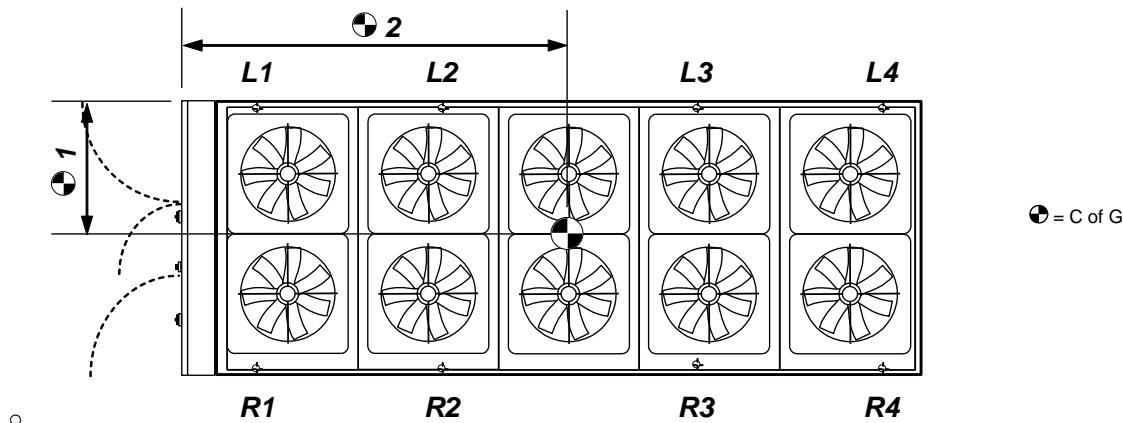

	L1	L2	L3	L4	R1	R2	R3	R4	C of G 1	C of G 2
	P1	P3	P5	P7	P2	P4	P6	P8	mm	mm
DCF014SR-04AL00	390	540			485	670			1220	1270
DCF017SR-04AM00	395	545			500	685			1225	1265
DCF021SR-04BS00	475	515			645	700			1265	1170
DCF025SR-06BT00	595	805			730	990			1210	1850
DCF013DR-04ACD0	470	455			570	555			1205	1125
DCF014DR-04ADD0	480	450			600	565			1220	1110
DCF015DR-04ADFO	485	455			610	575			1225	1110
DCF016DR-04AJJ0	500	465			675	630			1260	1105
DCF018DR-04BJK0	520	475			695	635			1255	1100
DCF020DR-06BFK0	660	645			805	790			1210	1690
DCF023DR-06BKK0	670	645			840	815			1225	1685
DCF026DR-06BKLO	705	725			880	905			1220	1715
DCF029DR-06BLLO	725	720			940	935			1240	1700
DCF032DR-08BLMO	605	605	585		720	735	730		1205	2270
DCF035DR-08BMM0	605	605	585		730	745	735		1210	2265
DCF039DR-10BMS0	555	545	555	550	655	670	675	680	1205	2875
DCF044DR-10BSS0	565	555	555	545	695	710	700	700	1225	2840
DCF014SX-04AL00	425	515			555	675			1245	1215
DCF017SX-04AM00	430	520			570	690			1250	1215
DCF021SX-06BS00	560	760			735	1000			1245	1855
DCF025SX-06BT00	585	830			755	1065			1235	1870
DCF013DX-04ACD0	475	465			625	610			1245	1125
DCF014DX-04ADD0	490	465			655	620			1255	1115
DCF015DX-04ADFO	495	465			665	625			1260	1110
DCF016DX-04AJJ0	510	480			725	685			1290	1110
DCF018DX-04BJK0	525	485			750	690			1285	1100
DCF020DX-06BFK0	670	650			875	855			1245	1690
DCF023DX-06BKK0	680	660			910	880			1255	1685
DCF026DX-08BKLO	590	600	595		720	750	755		1215	2305
DCF029DX-08BLLO	605	610	595		755	780	775		1230	2285
DCF032DX-08BLMO	615	615	595		780	795	785		1235	2265
DCF035DX-08BMM0	620	615	595		790	800	790		1240	2260
DCF039DX-10BMS0	565	555	560	555	700	720	720	725	1235	2865
DCF044DX-12BSS0	660	635	615	590	815	815	785	765	1230	3295

Point loads based upon standard unit configuration

Installation Data

Unit Lifting

- **Employ lifting specialists**
- Local codes and regulations relating to the lifting of this type of equipment should be observed
- Use the appropriate spreader bars/lifting slings (provided by others) with the eye bolts/lugs provided
- Attach individual lifting chains to each of the lifting eye bolts/lifting lugs provided; each individual chain must be capable of lifting the whole unit
- Lifting eye bolt

Number of Condenser Fans	4 Fan	6 Fan	8 fan	10 fan	12 fan
Eyebolt size	M30	M36	M36	M36	M36

IMPORTANT

▼ **Do not use 1 chain between 2 lifting points to avoid load shift.**


Only use lifting points provided.

Chains/slings MUST NOT interfere with the casing or fan assembly to avoid damage.

Lift the unit slowly and evenly.

If the unit is dropped, it should immediately be checked for damage and reported to Airedale.

Lifting Dimensions

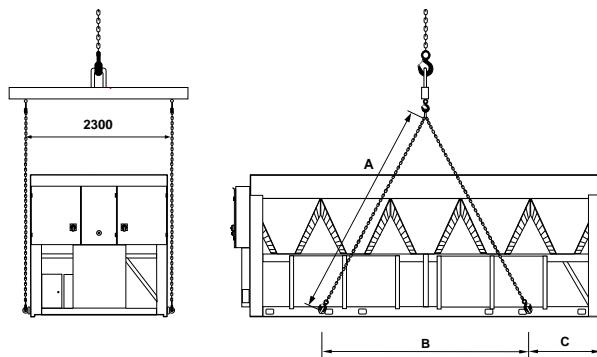

	A	B	C
4 Fan mm	4000	1850	208
6 Fan mm	4000	2186	210
8 Fan mm	4000	3502	518
10 Fan mm	4000	3336	1166
12 Fan mm	5000	4745	1030

Installation Data

Positioning


The installation position should be selected with the following points in mind:

- Position on a stable and even base, levelled to ensure that the compressor operates correctly
- Levelling should be to +/- 5mm
- Where vibration transmission to the building structure is possible, fit spring anti-vibration mounts and flexible water connections
- Observe airflow and maintenance clearances
- Pipework and electrical connections are readily accessible
- Where multiple units are installed, due care should be taken to avoid the discharge air from each unit adversely affecting other units in the vicinity
- Within a side enclosed installation, the fan **MUST** be higher than the enclosing structure
- Increase airflow and maintenance clearances for side-enclosed or multiple unit applications
- Allow free space above the fans to prevent air recirculation
- Ensure that there is a safe access and operating area provided for unit controls.

CAUTION

 Prior to connecting services, ensure that the equipment is installed and completely level.

Airflow & Maintenance Clearances

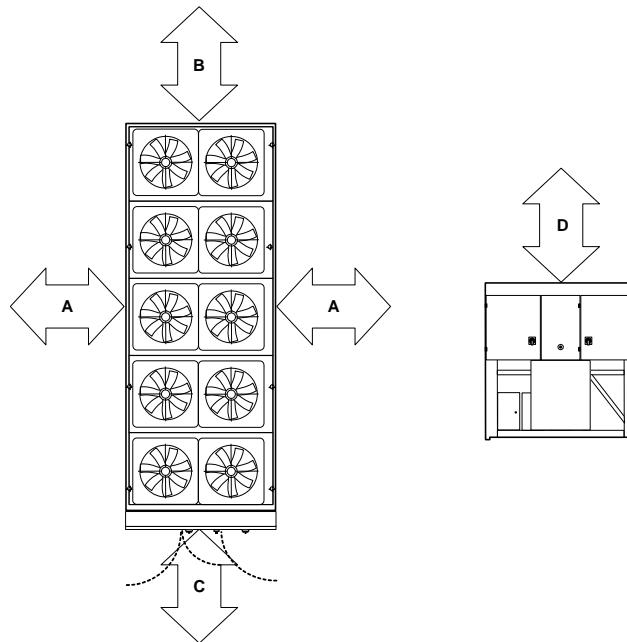

Application	Distance from Overall Base Dimension (mm)			
	A	B	C	D
Free of walls and overhang	1300	1300	1300	1300
Enclosed to A	2600	1300	1300	1300
Unit parallel with A	2600	1300	1300	1300
Enclosed to B	1300	2600	1300	1300
Unit in line with B	1300	1300	1300	1300
Unit in line with C Controls End	1300	1300	2600	1300
Enclosed to C	1300	1300	2600	1300


Installation Data

Anti Vibration Mounting (Optional)

Spring Type

Each mount is coloured to indicate the different loads, refer to instructions supplied for correct allocation.


Dimensions

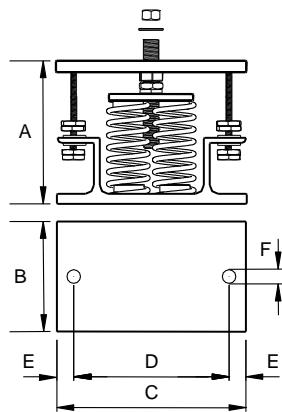

DCC22x Units	(3)	mm	A ⁽¹⁾	B	C	D	E	FØ
			162	130	225	186	20	16

(1) Unloaded dimension

Components



- 1 Locating Screw
- 2 Retaining Nut & Washer
- 3 Levelling Screw
- 4 Levelling Lock Nut
- 5 Retaining Studs
- 6a Upper Retaining Nuts
- 6b Lower Retaining Nuts
- 7 Spring assembly
- 8 Pressure Plate
- 9 Top Plate
- 10 Bolting-down holes

Installation

- 1 Locate and secure mount using bolting down holes (10) in base plate.
- 2 Ensure mounts are located in line with the unit base.
- 3 If applicable, remove compressor enclosure covers to allow access to mount fixing holes in the unit base.
- 4 Lock the upper retaining nuts (6a) to the underside of the top plate (9) before a load is applied.
- 5 Slacken levelling lock nut (4). (the levelling screw will not move if this is not slackened)
- 6 Remove retaining nut and washer (2), lower the unit onto the mounts and replace retaining nut and washer.
- 7 Beginning with the mount with the largest deflection adjust the height of each mount using the levelling screw (3).

CAUTION

Mountings must be adjusted incrementally in turn. Do not fully adjust 1 mount at a time as this may overload and damage springs.


- 7 When all mounts are level, lock each into place using the levelling lock nut (4).
- 8 Lock all retaining nuts (6a and 6b) to the extreme ends of the retaining studs (5).

CAUTION

Do not connect any services until all anti vibration mounts have been fully adjusted.


Pad Type

Components/Installation

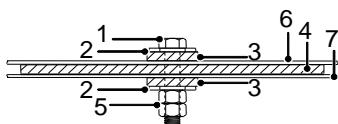


- 1 M16 Bolt (Not Supplied)
- 2 Washer (Not Supplied)
- 3 Fixing Pad 506-063
- 4 A V Pad 506-062
- 5 2 x M16 Nut (Not Supplied)
- 6 Unit Base
- 7 Unit Mounting Plinth

Anti Vibration Mount Allocations No pumps

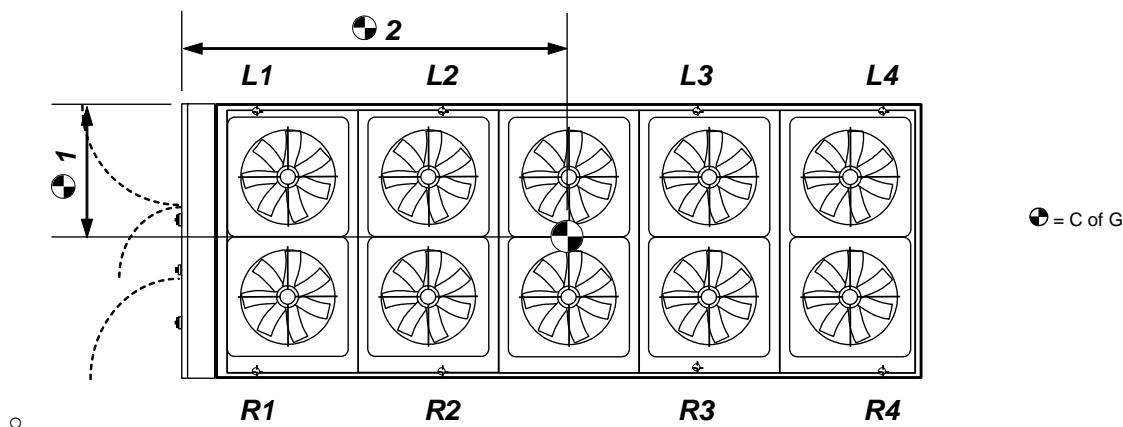


	L1	L2	L3	L4	R1	R2	R3	R4
DCC011SR-04AK00	Red	Red			Red	Red		
DCC014SR-04AL00	Red	Red			Black	Black		
DCC017SR-04AM00	Red	Red			Black	Black		
DCC021SR-04BS00	Red	Red			Orange	Black		
DCC023SR-04BT00	Black	Red			Orange	Black		
DCC024SR-06BT00	Black	Black			Orange	Orange		
DCC011DR-04ACCO	Red	Red			Black	Red		
DCC013DR-04ACD0	Red	Red			Black	Red		
DCC014DR-04ADDO	Red	Red			Black	Red		
DCC015DR-04ADF0	Red	Red			Orange	Red		
DCC016DR-04AJJ0	Black	Red			Orange	Black		
DCC018DR-04BJK0	Black	Red			Orange	Black		
DCC019DR-04AFK0	Black	Red			Orange	Red		
DCC020DR-06AFK0	Black	Red			Plain	Black		
DCC021DR-04AKK0	Black	Red			Orange	Black		
DCC022DR-06AKK0	Orange	Red			Plain	Black		
DCC024DR-04BKLO	Black	Red			Orange	Black		
DCC025DR-06BKLO	Orange	Black			Yellow	Orange		
DCC027DR-04BLL0	Black	Red			Plain	Black		
DCC028DR-06BLL0	Orange	Black			Yellow	Orange		
DCC030DR-06BLMO	Orange	Black			Yellow	Orange		
DCC031DR-08BLMO	Black	Red	Red		Orange	Plain	Black	
DCC032DR-06BMM0	Orange	Black			Yellow	Orange		
DCC033DR-08BMM0	Black	Red	Red		Orange	Plain	Black	
DCC036DR-06BMS0	Orange	Black			Yellow	Plain		
DCC038DR-10BMS0	Red	Red	Red	Red	Black	Black	Black	Orange
DCC039DR-06BSS0	Orange	Black			Yellow	Plain		
DCC042DR-10BSS0	Black	Red	Red	Red	Orange	Orange	Black	Black
DCC043DR-08BST0	Black	Black	Red		Orange	Yellow	Orange	
DCC045DR-10BST0	Black	Red	Red	Red	Orange	Orange	Orange	Orange
DCC046DR-08BTT0	Black	Black	Red		Plain	Yellow	Orange	
DCC048DR-10BTT0	Black	Red	Red	Red	Orange	Orange	Orange	Black

Anti Vibration Mount Allocations No Pumps

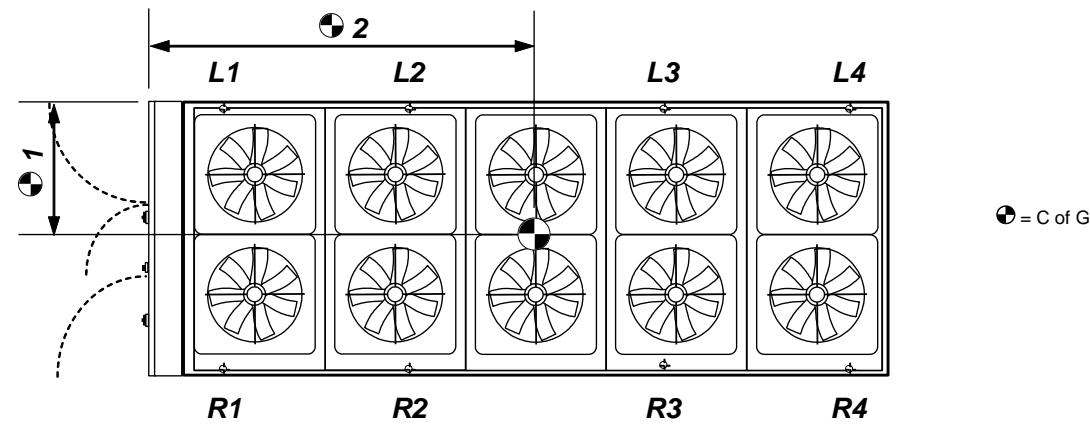


	L1	L2	L3	L4	R1	R2	R3	R4
DCC011SX-04AK00	Red	Red			Black	Red		
DCC014SX-04AL00	Red	Red			Black	Black		
DCC017SX-04AM00	Red	Red			Black	Black		
DCC021SX-06BS00	Black	Black			Orange	Plain		
DCC023SX-04BT00	Black	Red			Orange	Black		
DCC024SX-06BT00	Black	Black			Plain	Plain		
DCC011DX-04ACCO	Red	Red			Orange	Red		
DCC013DX-04ACD0	Red	Red			Orange	Red		
DCC014DX-04ADDO	Red	Red			Orange	Red		
DCC015DX-04ADF0	Red	Red			Orange	Black		
DCC016DX-04AJ00	Black	Red			Orange	Black		
DCC018DX-04BJK0	Black	Red			Orange	Black		
DCC019DX-04AFK0	Black	Red			Orange	Black		
DCC020DX-06AFK0	Orange	Red			Yellow	Orange		
DCC021DX-04AK00	Black	Red			Plain	Black		
DCC022DX-06AKK0	Orange	Red			Yellow	Orange		
DCC024DX-06BK00	Orange	Black			Yellow	Orange		
DCC025DX-08BK00	Black	Red	Red		Orange	Plain	Black	
DCC027DX-06BL00	Orange	Black			Yellow	Plain		
DCC028DX-08BL00	Black	Black	Red		Orange	Plain	Black	
DCC030DX-06BLM0	Orange	Black			Yellow	Plain		
DCC031DX-08BLM0	Black	Black	Red		Orange	Plain	Black	
DCC032DX-06BMM0	Orange	Black			Yellow	Plain		
DCC033DX-08BMM0	Black	Black	Red		Orange	Plain	Black	
DCC036DX-08BMS0	Black	Black	Red	Red	Orange	Orange	Orange	Orange
DCC039DX-08BSS0	Black	Black	Red		Plain	Yellow	Orange	
DCC042DX-12BSS0	Black	Black	Black	Red	Plain	Orange	Orange	Orange
DCC043DX-08BST0	Black	Black	Red		Plain	Yellow	Orange	
DCC045DX-12BST0	Black	Black	Black	Black	Orange	Orange	Orange	Plain
DCC046DX-10BTT0	Black	Black	Red	Red	Orange	Orange	Orange	Orange
DCC048DX-12BTT0	Black	Black	Black	Black	Plain	Plain	Orange	Orange

Anti Vibration Mount Allocations Single Pump

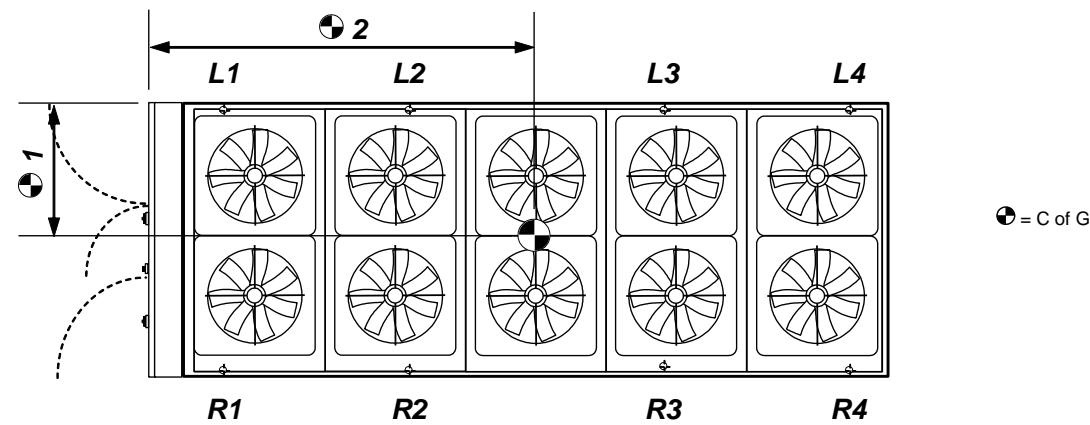


	L1	L2	L3	L4	R1	R2	R3	R4
DCC011SR-04AK00	Red	Red			Red	Red		
DCC014SR-04AL00	Red	Red			Black	Black		
DCC017SR-04AM00	Red	Red			Black	Black		
DCC021SR-04BS00	Red	Red			Orange	Black		
DCC023SR-04BT00	Black	Red			Orange	Black		
DCC024SR-06BT00	Black	Black			Orange	Orange		
DCC011DR-04ACCO	Red	Red			Black	Red		
DCC013DR-04ACD0	Red	Red			Black	Red		
DCC014DR-04ADDO	Red	Red			Black	Red		
DCC015DR-04ADF0	Red	Red			Orange	Red		
DCC016DR-04AJJ0	Black	Red			Orange	Black		
DCC018DR-04BJK0	Black	Red			Orange	Black		
DCC019DR-04AFK0	Black	Red			Orange	Red		
DCC020DR-06AFK0	Black	Red			Plain	Black		
DCC021DR-04AKKO	Black	Red			Orange	Black		
DCC022DR-06AKKO	Orange	Red			Plain	Black		
DCC024DR-04BKLO	Black	Red			Orange	Black		
DCC025DR-06BKLO	Orange	Black			Yellow	Orange		
DCC027DR-04BLL0	Black	Red			Plain	Black		
DCC028DR-06BLL0	Orange	Black			Yellow	Orange		
DCC030DR-06BLMO	Orange	Black			Yellow	Orange		
DCC031DR-08BLMO	Black	Red	Red		Orange	Plain	Black	
DCC032DR-06BMM0	Orange	Black			Yellow	Orange		
DCC033DR-08BMM0	Black	Red	Red		Orange	Plain	Black	
DCC036DR-06BMS0	Orange	Black			Yellow	Plain		
DCC038DR-10BMS0	Red	Red	Red	Red	Black	Black	Black	Orange
DCC039DR-06BSS0	Orange	Black			Yellow	Plain		
DCC042DR-10BSS0	Black	Red	Red	Red	Orange	Orange	Black	Black
DCC043DR-08BST0	Black	Black	Red		Orange	Yellow	Orange	
DCC045DR-10BST0	Black	Red	Red	Red	Orange	Orange	Orange	Orange
DCC046DR-08BTTO	Black	Black	Red		Plain	Yellow	Orange	
DCC048DR-10BTTO	Black	Red	Red	Red	Orange	Orange	Orange	Black

Anti Vibration Mount Allocations Single Pump

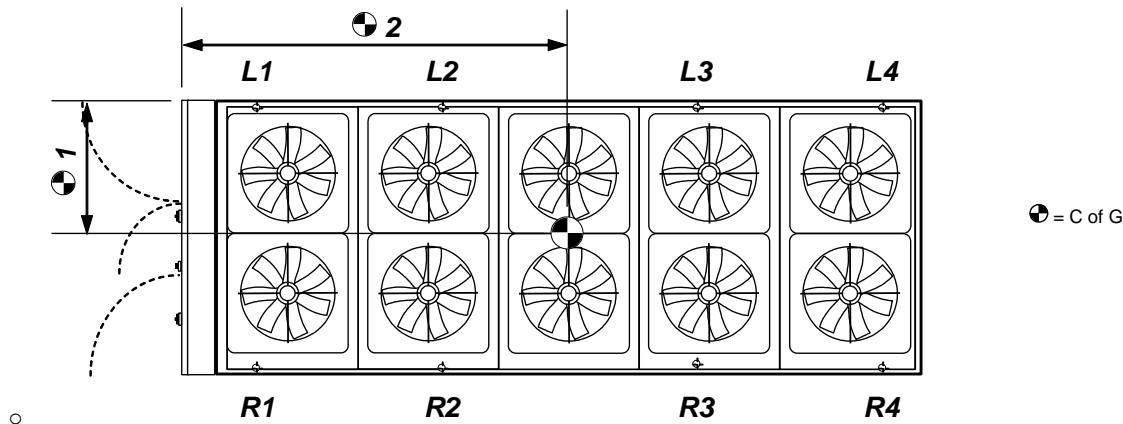


	L1	L2	L3	L4	R1	R2	R3	R4
DCC011SX-04AK00	Red	Red			Black	Red		
DCC014SX-04AL00	Red	Red			Black	Black		
DCC017SX-04AM00	Red	Red			Black	Black		
DCC021SX-06BS00	Black	Black			Orange	Plain		
DCC023SX-04BT00	Black	Red			Orange	Black		
DCC024SX-06BT00	Black	Black			Plain	Plain		
DCC011DX-04ACCO	Red	Red			Orange	Red		
DCC013DX-04ACDO	Red	Red			Orange	Red		
DCC014DX-04ADDO	Red	Red			Orange	Red		
DCC015DX-04ADF0	Red	Red			Orange	Black		
DCC016DX-04AJJO	Black	Red			Orange	Black		
DCC018DX-04BJKO	Black	Red			Orange	Black		
DCC019DX-04AFK0	Black	Red			Orange	Black		
DCC020DX-06AFK0	Orange	Red			Yellow	Orange		
DCC021DX-04AKK0	Black	Red			Plain	Black		
DCC022DX-06AKK0	Orange	Red			Yellow	Orange		
DCC024DX-06BKL0	Orange	Black			Yellow	Orange		
DCC025DX-08BKL0	Black	Red	Red		Orange	Plain	Black	
DCC027DX-06BL00	Orange	Black			Yellow	Plain		
DCC028DX-08BL00	Black	Black	Red		Orange	Plain	Black	
DCC030DX-06BLMO	Orange	Black			Yellow	Plain		
DCC031DX-08BLMO	Black	Black	Red		Orange	Plain	Black	
DCC032DX-06BMM0	Orange	Black			Yellow	Plain		
DCC033DX-08BMM0	Black	Black	Red		Orange	Plain	Black	
DCC036DX-08BMS0	Black	Black	Red		Orange	Yellow	Orange	
DCC038DX-10BMS0	Black	Red	Red	Red	Orange	Orange	Orange	Orange
DCC039DX-08BSS0	Black	Black	Red		Plain	Yellow	Orange	
DCC042DX-12BSS0	Black	Black	Black	Red	Plain	Orange	Orange	Orange
DCC043DX-08BST0	Black	Black	Red		Plain	Yellow	Orange	
DCC045DX-12BST0	Black	Black	Black	Black	Orange	Orange	Orange	Plain
DCC046DX-10BTT0	Black	Black	Red	Red	Orange	Orange	Orange	Orange
DCC048DX-12BTT0	Black	Black	Black	Black	Plain	Plain	Orange	Orange

Anti Vibration Mount Allocations Run / Standby Pump

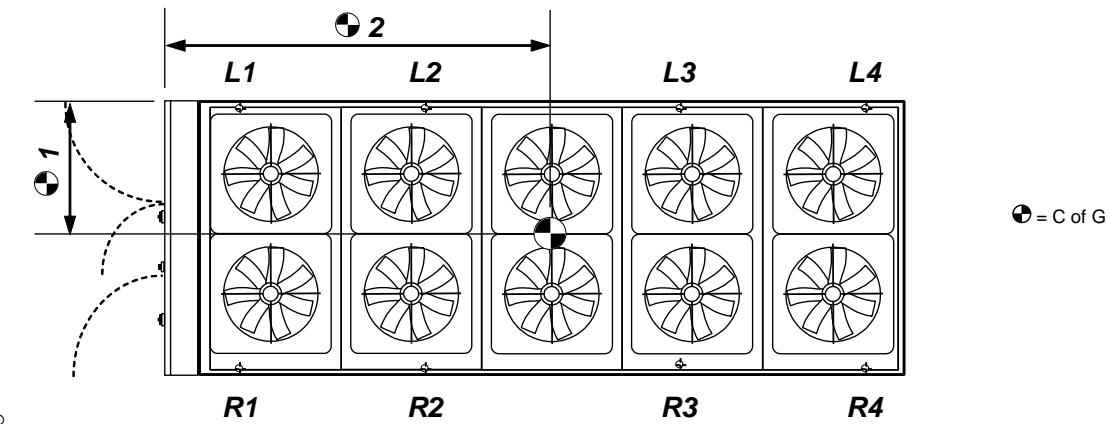


	L1	L2	L3	L4	R1	R2	R3	R4
DCC011SR-04AK00	Red	Black			Red	Black		
DCC014SR-04AL00	Red	Black			Black	Orange		
DCC017SR-04AM00	Red	Black			Black	Orange		
DCC021SR-04BS00	Black	Black			Orange	Orange		
DCC023SR-04BT00	Black	Black			Orange	Orange		
DCC024SR-06BT00	Orange	Orange			Orange	Yellow		
DCC011DR-04ACCO	Black	Red			Black	Black		
DCC013DR-04ACD0	Black	Black			Black	Black		
DCC014DR-04ADD0	Black	Black			Black	Black		
DCC015DR-04ADFO	Black	Black			Black	Black		
DCC016DR-04AJJ0	Black	Black			Orange	Black		
DCC018DR-04BJK0	Black	Black			Orange	Black		
DCC019DR-04AFK0	Black	Black			Orange	Black		
DCC020DR-06AFK0	Orange	Black			Plain	Orange		
DCC021DR-04AKK0	Black	Black			Orange	Orange		
DCC022DR-06AKKO	Orange	Orange			Plain	Orange		
DCC024DR-04BKL0	Black	Black			Orange	Orange		
DCC025DR-06BKL0	Orange	Orange			Yellow	Plain		
DCC027DR-04BLL0	Orange	Black			Plain	Orange		
DCC028DR-06BLL0	Orange	Orange			Yellow	Plain		
DCC030DR-06BLMO	Orange	Orange			Yellow	Yellow		
DCC031DR-08BLMO	Black	Black	Black		Orange	Plain	Orange	
DCC032DR-06BMM0	Plain	Orange			Yellow	Yellow		
DCC033DR-08BMM0	Black	Black	Black		Orange	Plain	Black	
DCC036DR-06BMS0	Plain	Orange			Yellow	Yellow		
DCC038DR-10BMS0	Black	Black	Black	Black	Black	Black	Orange	Orange
DCC039DR-06BSS0	Plain	Orange			Yellow	Yellow		
DCC042DR-10BSS0	Black	Black	Black	Black	Orange	Orange	Orange	Orange
DCC043DR-08BST0	Orange	Orange	Black		Plain	Yellow	Orange	
DCC045DR-10BST0	Black	Black	Black	Black	Orange	Orange	Orange	Orange
DCC046DR-08BTTO	Orange	Orange	Black		Plain	Yellow	Orange	
DCC048DR-10BTTO	Black	Black	Black	Black	Orange	Orange	Orange	Orange

Anti Vibration Mount Allocations Run / Standby Pump continued

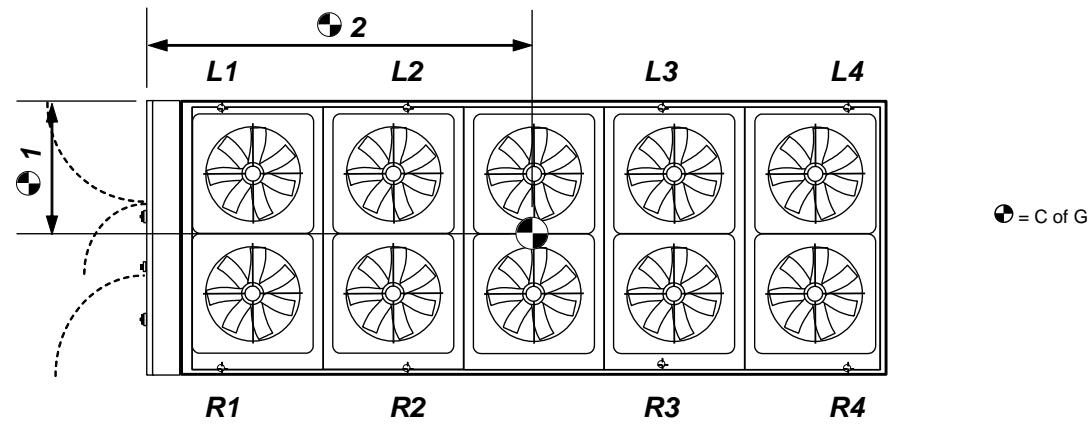


	L1	L2	L3	L4	R1	R2	R3	R4
DCC011SX-04AK00	Black	Black			Black	Black		
DCC014SX-04AL00	Black	Black			Black	Orange		
DCC017SX-04AM00	Black	Black			Black	Orange		
DCC021SX-06BS00	Black	Orange			Orange	Yellow		
DCC023SX-04BT00	Black	Black			Orange	Orange		
DCC024SX-06BT00	Black	Plain			Orange	Yellow		
DCC011DX-04ACCO	Black	Black			Black	Black		
DCC013DX-04ACD0	Black	Black			Orange	Black		
DCC014DX-04ADDO	Black	Black			Orange	Black		
DCC015DX-04ADF0	Black	Black			Orange	Black		
DCC016DX-04AJJ0	Black	Black			Orange	Orange		
DCC018DX-04BJK0	Black	Black			Orange	Orange		
DCC019DX-04AFK0	Black	Black			Orange	Orange		
DCC020DX-06AFK0	Orange	Orange			Plain	Plain		
DCC021DX-04AKKO	Black	Black			Orange	Orange		
DCC022DX-06AKKO	Orange	Orange			Yellow	Plain		
DCC024DX-06BKL0	Orange	Orange			Yellow	Yellow		
DCC025DX-08BKL0	Black	Black	Black		Orange	Plain	Orange	
DCC027DX-06BL00	Orange	Orange			Yellow	Yellow		
DCC028DX-08BL00	Black	Black	Black		Orange	Yellow	Orange	
DCC030DX-06BLM0	Plain	Orange			Yellow	Yellow		
DCC031DX-08BLM0	Black	Black	Black		Orange	Yellow	Orange	
DCC032DX-06BMM0	Plain	Orange			Yellow	Yellow		
DCC033DX-08BMM0	Black	Black	Black		Orange	Yellow	Orange	
DCC036DX-08BMS0	Orange	Orange	Black		Orange	Yellow	Orange	
DCC038DX-10BMS0	Black	Black	Black	Black	Orange	Orange	Orange	Orange
DCC039DX-08BSS0	Orange	Orange	Black		Plain	Yellow	Orange	
DCC042DX-12BSS0	Black	Black	Black	Black	Plain	Plain	Plain	Orange
DCC043DX-08BST0	Orange	Orange	Black		Plain	Yellow	Plain	
DCC045DX-12BST0	Black	Black	Black	Black	Orange	Plain	Plain	Plain
DCC046DX-10BT00	Black	Black	Black	Black	Orange	Orange	Plain	Orange
DCC048DX-12BT00	Black	Black	Black	Black	Plain	Plain	Plain	Orange

Freecool Anti Vibration Mount Allocations No pumps

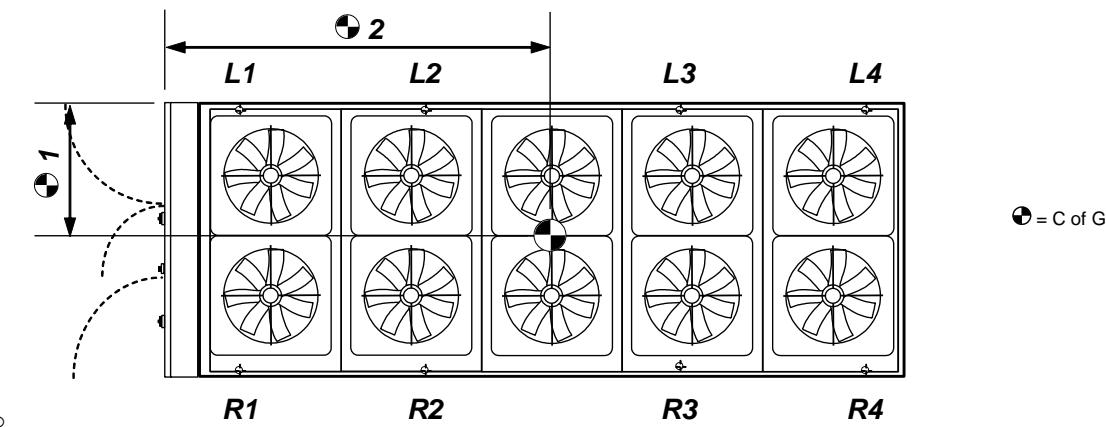


	L1	L2	L3	L4	R1	R2	R3	R4
DCF014SR-04AL00	Red	Black			Black	Orange		
DCF017SR-04AM00	Red	Black			Black	Orange		
DCF021SR-04BS00	Black	Black			Orange	Orange		
DCF025SR-06BT00	Orange	Plain			Plain	Yellow		
DCF013DR-04ACD0	Black	Black			Black	Black		
DCF014DR-04ADD0	Black	Black			Orange	Black		
DCF015DR-04ADF0	Black	Black			Orange	Black		
DCF016DR-04AJJ0	Black	Black			Orange	Orange		
DCF018DR-04BJK0	Black	Black			Orange	Orange		
DCF020DR-06BFK0	Orange	Orange			Plain	Plain		
DCF023DR-06BKK0	Orange	Orange			Yellow	Plain		
DCF026DR-06BKLO	Orange	Orange			Yellow	Yellow		
DCF029DR-06BLLO	Orange	Orange			Yellow	Yellow		
DCF032DR-08BLMO	Orange	Orange	Orange		Orange	Plain	Plain	
DCF035DR-08BMM0	Orange	Orange	Orange		Plain	Plain	Plain	
DCF039DR-10BMS0	Black	Black	Black	Black	Orange	Orange	Orange	Orange
DCF044DR-10BSS0	Black	Black	Black	Black	Orange	Orange	Orange	Orange
DCF014SX-04AL00	Red	Black			Black	Orange		
DCF017SX-04AM00	Red	Black			Black	Orange		
DCF021SX-06BS00	Black	Plain			Plain	Yellow		
DCF025SX-06BT00	Orange	Yellow			Plain	Yellow		
DCF013DX-04ACD0	Black	Black			Orange	Orange		
DCF014DX-04ADD0	Black	Black			Orange	Orange		
DCF015DX-04ADF0	Black	Black			Orange	Orange		
DCF016DX-04AJJ0	Black	Black			Orange	Orange		
DCF018DX-04BJK0	Black	Black			Plain	Orange		
DCF020DX-06BFK0	Orange	Orange			Yellow	Yellow		
DCF023DX-06BKK0	Orange	Orange			Yellow	Yellow		
DCF026DX-08BKLO	Orange	Orange	Orange		Orange	Plain	Plain	
DCF029DX-08BLLO	Orange	Orange	Orange		Plain	Plain	Plain	
DCF032DX-08BLMO	Orange	Orange	Orange		Plain	Plain	Plain	
DCF035DX-08BMM0	Orange	Orange	Orange		Plain	Plain	Plain	
DCF039DX-10BMS0	Black	Black	Black	Black	Orange	Orange	Orange	Orange
DCF044DX-12BSS0	Orange	Orange	Orange	Orange	Plain	Plain	Plain	Plain

Freecool Anti Vibration Mount Allocations Single Pump

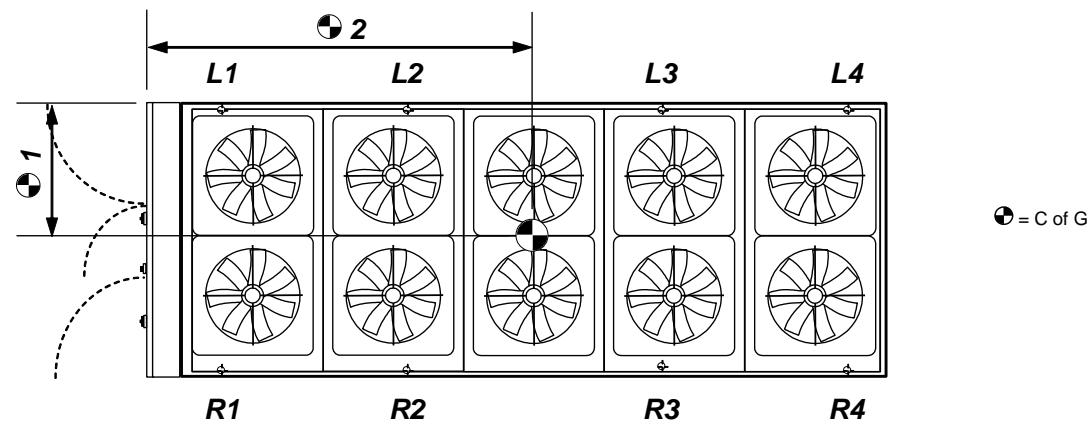

	L1	L2	L3	L4	R1	R2	R3	R4
DCF014SR-04AL00	Red	Orange			Black	Plain		
DCF017SR-04AM00	Red	Orange			Black	Plain		
DCF021SR-04BS00	Black	Orange			Orange	Plain		
DCF025SR-06BT00	Orange	Yellow			Orange	Yellow		
DCF013DR-04ACD0	Black	Black			Black	Orange		
DCF014DR-04ADD0	Black	Black			Orange	Orange		
DCF015DR-04ADF0	Black	Black			Orange	Orange		
DCF016DR-04AJJ0	Black	Black			Orange	Orange		
DCF018DR-04BJK0	Black	Black			Orange	Orange		
DCF020DR-06BFK0	Orange	Plain			Plain	Yellow		
DCF023DR-06BKK0	Orange	Plain			Plain	Yellow		
DCF026DR-06BKLO	Plain	Yellow			Yellow	Yellow		
DCF029DR-06BLLO	Plain	Yellow			Yellow	Yellow		
DCF032DR-08BLMO	Orange	Orange	Orange		Orange	Plain	Plain	
DCF035DR-08BMM0	Orange	Orange	Orange		Plain	Plain	Plain	
DCF039DR-10BMS0	Black	Orange	Orange	Orange	Orange	Orange	Plain	Orange
DCF044DR-10BSS0	Orange	Orange	Orange	Orange	Orange	Plain	Plain	Orange
DCF014SX-04AL00	Black	Orange			Black	Plain		
DCF017SX-04AM00	Black	Orange			Black	Plain		
DCF021SX-06BS00	Orange	Yellow			Orange	Yellow		
DCF025SX-06BT00	Orange	Yellow			Plain	Yellow		
DCF013DX-04ACD0	Black	Black			Orange	Orange		
DCF014DX-04ADD0	Black	Black			Orange	Orange		
DCF015DX-04ADF0	Black	Black			Orange	Orange		
DCF016DX-04AJJ0	Black	Black			Orange	Plain		
DCF018DX-04BJK0	Black	Orange			Plain	Plain		
DCF020DX-06BFK0	Orange	Plain			Yellow	Yellow		
DCF023DX-06BKK0	Orange	Plain			Yellow	Yellow		
DCF026DX-08BKLO	Orange	Orange	Orange		Orange	Plain	Plain	
DCF029DX-08BLLO	Orange	Orange	Orange		Plain	Plain	Plain	
DCF032DX-08BLMO	Orange	Orange	Orange		Plain	Plain	Yellow	
DCF035DX-08BMM0	Orange	Orange	Orange		Plain	Plain	Yellow	
DCF039DX-10BMS0	Orange	Orange	Orange	Orange	Orange	Plain	Plain	Plain
DCF044DX-12BSS0	Orange	Orange	Orange	Orange	Plain	Yellow	Yellow	Plain

Freecool Anti Vibration Mount Allocations Run / Standby Pump

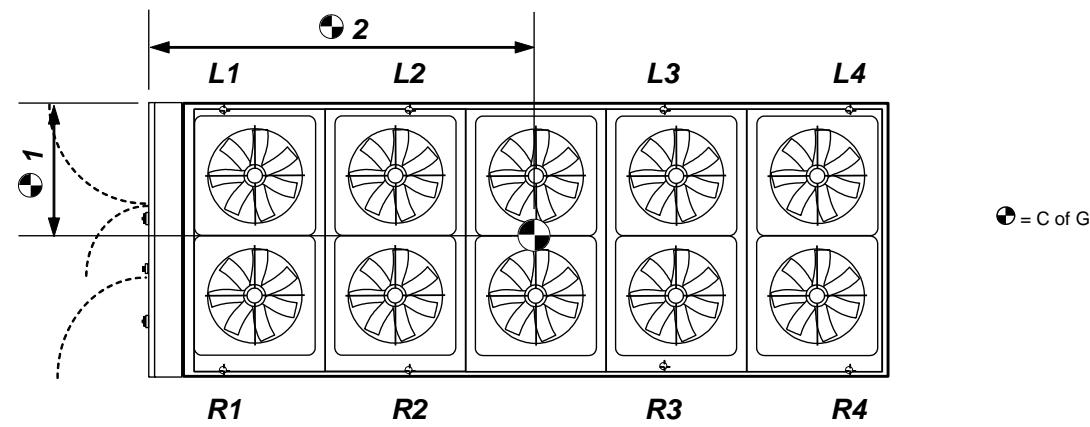

	L1	L2	L3	L4	R1	R2	R3	R4
DCF014SR-04AL00	Black	Plain			Black	Plain		
DCF017SR-04AM00	Black	Plain			Black	Plain		
DCF021SR-04BS00	Black	Orange			Orange	Plain		
DCF025SR-06BT00	Orange	Yellow			Orange	Yellow		
DCF013DR-04ACD0	Black	Orange			Black	Orange		
DCF014DR-04ADD0	Black	Orange			Orange	Orange		
DCF015DR-04ADF0	Black	Orange			Orange	Orange		
DCF016DR-04AJJ0	Black	Orange			Orange	Plain		
DCF018DR-04BJK0	Orange	Orange			Orange	Plain		
DCF020DR-06BFK0	Orange	Yellow			Plain	Yellow		
DCF023DR-06BKK0	Plain	Yellow			Plain	Yellow		
DCF026DR-06BKLO	Plain	Yellow			Yellow	Yellow		
DCF029DR-06BLLO	Plain	Yellow			Yellow	Yellow		
DCF032DR-08BLMO	Orange	Plain	Orange		Plain	Plain	Plain	
DCF035DR-08BMM0	Orange	Plain	Orange		Plain	Plain	Plain	
DCF039DR-10BMS0	Orange	Orange	Orange	Orange	Orange	Orange	Plain	Plain
DCF044DR-10BSS0	Orange	Orange	Orange	Orange	Orange	Plain	Plain	Plain
DCF014SX-04AL00	Black	Orange			Black	Plain		
DCF017SX-04AM00	Black	Orange			Black	Plain		
DCF021SX-06BS00	Orange	Yellow			Orange	Yellow		
DCF025SX-06BT00	Orange	Yellow			Plain	Yellow		
DCF013DX-04ACD0	Black	Orange			Orange	Plain		
DCF014DX-04ADD0	Black	Orange			Orange	Plain		
DCF015DX-04ADF0	Black	Orange			Orange	Plain		
DCF016DX-04AJJ0	Black	Orange			Orange	Plain		
DCF018DX-04BJK0	Orange	Orange			Plain	Plain		
DCF020DX-06BFK0	Plain	Yellow			Yellow	Yellow		
DCF023DX-06BKK0	Plain	Yellow			Yellow	Yellow		
DCF026DX-08BKLO	Orange	Plain	Orange		Plain	Plain	Yellow	
DCF029DX-08BLLO	Orange	Plain	Orange		Plain	Plain	Yellow	
DCF032DX-08BLMO	Orange	Plain	Orange		Plain	Yellow	Yellow	
DCF035DX-08BMM0	Orange	Plain	Orange		Plain	Yellow	Yellow	
DCF039DX-10BMS0	Orange	Orange	Orange	Orange	Orange	Plain	Yellow	Plain
DCF044DX-12BSS0	Orange	Orange	Plain	Orange	Plain	Yellow	Yellow	Plain

Installation Data

Water System

Chilled water pipe work and ancillary components must be installed in accordance with:


- National and Local Water supply company standards
- The manufacturer's instructions are followed when fitting ancillary components
- The system liquid is treated to prevent corrosion and algae forming
- In ambient of 0°C and below, where static water can be expected, or when water supply temperatures of +5°C or below is required, the necessary concentration of Glycol or use of an electrical trace heater must be included
- The schematic is referred to as a guide to ancillary recommendations

CAUTION



The unit water connections are NOT designed to support external pipe work, pipework MUST be supported separately.

Grooved & Clamped Type Connection

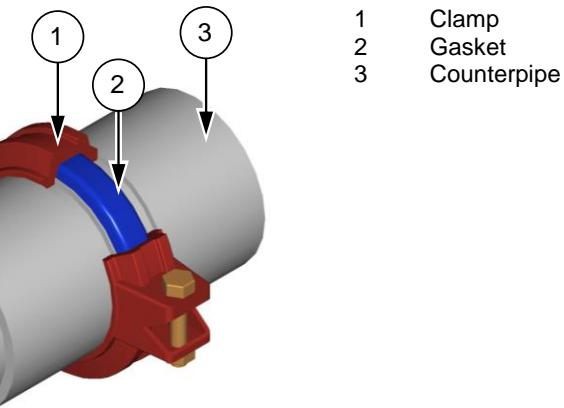

Standard Recommended Installation

General



The following diagram illustrates the minimum component installation requirements. A wide range of optional extras are available to suit various applications.

CAUTION



The following installation recommendations should be adhered to. Failure to do this may invalidate the chiller warranty.

The water flow commissioning valve set is not shown in the diagram, as the valve can be fitted elsewhere within the chilled water circuit.

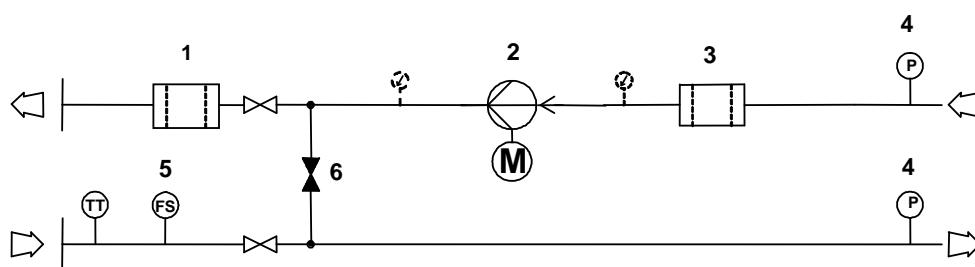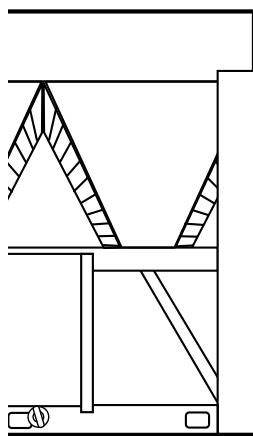

CAUTION



Full design water flow MUST be maintained at all times. Variable water volume is NOT recommended and will invalidate warranty.

CAUTION



The correct operation of the flow proving device is critical if the Chiller warranty is to be valid.

CAUTION



Following components are fitted within the Chiller unit as standard:

- Temperature Sensors
- Drain Point
- Auto Air Vent

Installation Data


Water Systems and Recommended Flow Schemes

Component Recommended Requirements	The recommended requirements to allow commissioning to be carried out correctly are:
	<ul style="list-style-type: none">• The inclusion of Binder Points adjacent to the flow and return connections, to allow temperature and pressure readings• A flow switch or equivalent, fitted adjacent to the water outlet side of the Chiller• A 20 mesh strainer fitted prior to the evaporator inlet• A water-flow commissioning valve set fitted to the system• In multiple Chiller installations, 1 commissioning valve set is required per chiller• Air vents are to be installed at all high points and where air is likely to be trapped at intermediate points• Drain points are to be installed at all low points in the system and in particular adjacent to the unit for maintenance to be carried out• Isolating valves should be installed adjacent to all major items of equipment for ease of maintenance• Balancing valves can be installed if required to aid correct system balancing• All chilled water pipe work must be insulated and vapour sealed to avoid condensation• If several units are installed in parallel adjacent to each other, reverse return should be applied to avoid unnecessary balancing valves

Pump Statement	When installing circulating water pumps or equipment containing them, the following rules should be applied: <ul style="list-style-type: none">• Ensure the system is filled with water then vented and the pump primed with water before running the pump, this is required because the pumped liquid cools the pump bearings and mechanical seal faces.• To avoid cavitation the NPSH (Net Positive Suction Head) incorporating a safety margin of 0.5m head must be available at the pump inlet during operation
----------------	--

Interlocks & Protection	Always electrically interlock the operation of the chiller with the pump controls and water flow switch. These safety devices prevent the chiller operating with low water flow which can cause serious damage.
-------------------------	---

CAUTION	<p>Failure to install both safety devices will invalidate the chiller warranty.</p> <p>Do not rely solely on the BMS to protect the chiller against low flow conditions.</p> <p>An evaporator pump interlock or flow switch MUST be directly wired to the Chiller in addition to the flow proving device, refer to <i>Interconnecting Wiring</i>.</p>
---------	--

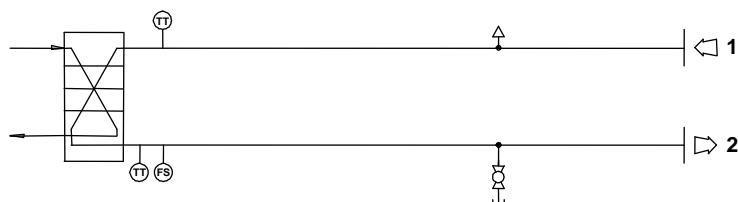Flow Schemes	Key: 1 Water In 2 Water Out
Basic Supplied Water Schematic (Includes Flow Proving Device)	

Installation Data

Optional Flow Schemes

Key: 1 Water In
2 Water Out


Filter Only Scheme -

Comprises:

Standard Circuit plus:

Optional Extras:

- 20 Mesh Water Filter

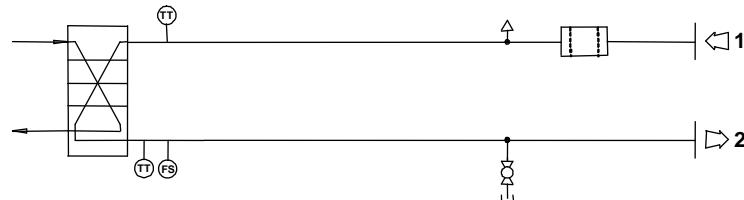


Filter - Flushing Bypass

Scheme - Comprises:

Standard Circuit plus:

Optional Extras:

- 20 Mesh Water Filter
- Flushing Bypass Circuit

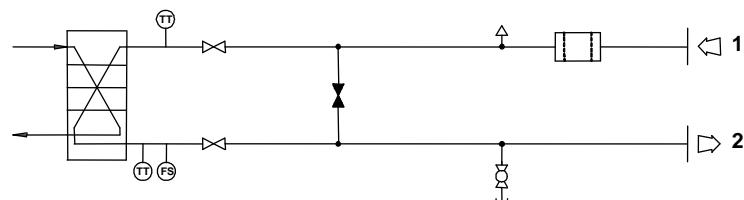


Single Head Pump Scheme

- Comprises:

Standard Circuit plus:

Optional Extras:

- 20 Mesh Water Filter (supplied loose)
- Flushing Bypass Circuit
- Single Head Pump

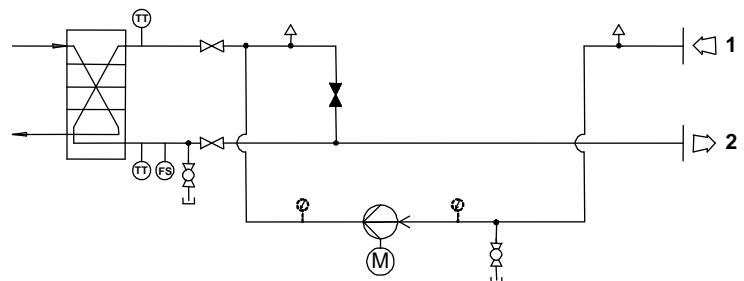


Single Head Run/Standby Pump Scheme -

Comprises:

Standard Circuit plus:


Optional Extras:

- 20 Mesh Water Filter (supplied loose)
- Flushing Bypass Circuit
- Single Head Run/Standby Pump

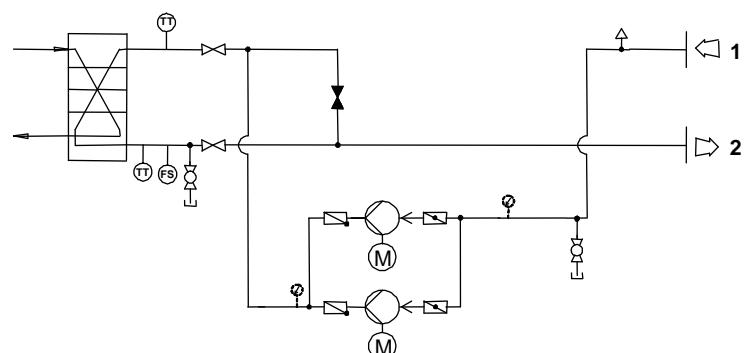

Standard Free Cool Circuit Incorporating

- Double Regulating Valve
- Mixing Valve
- 20 Mesh Water Filter (supplied loose)

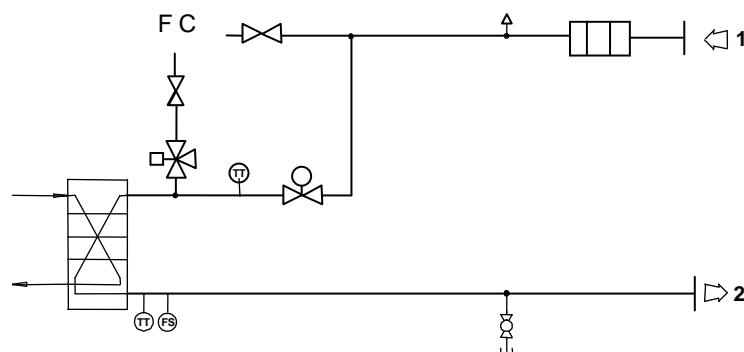

Installation Data

Electrical

IMPORTANT



Please refer to the electrical wiring diagrams provided for installation.

ALL work MUST be carried out by technically trained competent personnel.

The equipment contains live electrical and moving parts, ISOLATE prior to maintenance or repair work.

The unit isolators DO NOT isolate the incoming mains supply, but isolate the individual electrical panels. Isolate REMOTELY the mains incoming supply to the BUSBAR chamber prior to maintenance or repair work.

General

- As standard the equipment is designed for 400V, 3 phase, 3 wire 50Hz and a separate permanent 230V, 1 phase, 50Hz supply, to all relevant IEE regulations, British standards and IEC requirements
- The control voltage to the interlocks is 24V, always size the low voltage interlock and protection cabling for a maximum voltage drop of 2V
- Avoid large voltage drops on cable runs, particularly low voltage wiring

CAUTION



The Emergency Stop MUST NOT be used to stop the Chiller other than in the event of an emergency.

A fused and isolated electrical supply of the appropriate phase, frequency and voltage should be installed.

Wires should be capable of carrying the maximum load current under non-fault conditions at the stipulated voltage.

A separately fused, locally isolated, permanent single phase and neutral supply **MUST BE FITTED** for the compressor oil heater, evaporator trace heating and control circuits, **FAILURE to do so will INVALIDATE WARRANTY.**

To reduce down time, if possible support the above supply with a UPS.

Ensure correct phase rotation.

Installation Data

Interconnecting Wiring


DCC22 / DCF22	L1	○	←		Mains incoming supply 400V/3PH/50Hz
	L2	○	←		
	L3	○	←		
	PE	○	←		
	L4	○	←		Separate Permanent Supply 230V/1PH/50Hz
	N1	○	←		
	PE	○	←		
	L4	○	→		External Trace Heating Connections
	N1	○	→		240V/500W max
	502	○	→		Unit Remote On/Off 24VAC
	505	○	←		
	502	○	→	(1)	Evaporator Water Flow Switch 24VAC
	504	○	←		
	500	○	→		Remote Setpoint Adjust (0-10VDC)
	825	○	←		
	502	○	→	(1)	Remote Pump Interlock 24VAC
	515	○	←		
	502	○	→		Setback Setpoint Temperature switch
	516	○	←		
	573	○	←		Volt Free Common Alarm
	574	○	→		Volt Free Alarm N/O
	575	○	→		Volt Free Alarm N/C
	576	○	←		Critical Alarm
	577	○	→		Volt Free Common Alarm
	578	○	→		Volt Free Alarm N/O
	RX-/Tx-	○	↔		Volt Free Alarm N/C
	RX+/Tx+	○	↔	IN	AIRELan Network Connections In
	GND	○	↔		
	RX-/Tx-	○	↔		OUT
	RX+/Tx+	○	↔		AIRELan Network Connections
	GND	○	↔		

CAUTION



(1) MUST be directly wired to the chiller to validate warranty.

The plugged termination ensures that the connections are made simultaneously. Failure to attach the cables this way may cause damage to the controller.

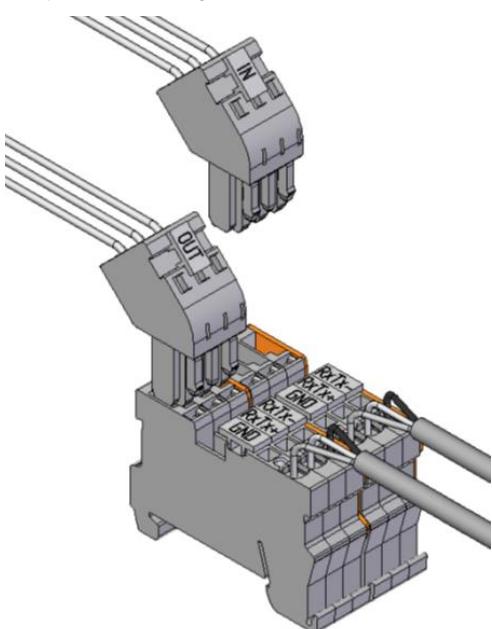

Controls


Use of Display Keypad Buttons




	1. ALARM	When more than one alarm is active the ALARM button will illuminate red. Pressing the ALARM button once will indicate information regarding any active alarms. Pressing the ALARM button twice will reset any active alarms.
	2. PRG	Pressing the PRG button will select the main navigation menu.
	3. ESC	Pressing the ESC button will return the user to the main display screen showing unit status.
	4. UP	Pressing the UP button can either: Scroll through the various display screens, providing the cursor is in the top left position. Increase the value of a set point adjustment.
	5. ENTER	Pressing the ENTER button will confirm any set point adjustments and move the cursor to the next available set point.
	6. DOWN	Pressing the DOWN button can either: Scroll through the various display screens, providing the cursor is in the top left position. Decrease the value of a set point adjustment.

Enabling the Unit

To turn the unit on press the key to enter the program menu. Using the and keys select the Unit On/Off option and press :

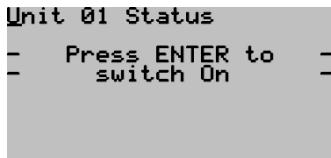

When is pressed the above screen will be shown. To turn the unit on simply press the key again and the screen will change:

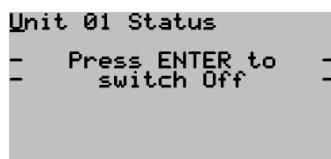

One the screen has changed to the above press the key which will return back to the main screen.

Unit Alarm Interrogation

Alarm Menu Display

Alarm Status	→	Comp1 Status	Alarm Active	H004	← Alarm Number
Time	→	08:10		09/02/10	← Date
Unit Demand	→	Dmd:	000.0%	Amb: 035.1%	← Ambient
Return Temp	→	Ret:	015.5%	Sup: 015.0%	Supply Temp

Alarm Log

The alarm page offers a log of the last 150 alarm messages in a scrolling log, pressing the alarm button will enter the alarm page. Consequently the most recent alarm has the lowest log number (001) and will be displayed upon entering the alarm page. As another alarm occurs, the alarm number increases until 150 alarms have occurred. From this point on, alarm 001 moves to 002 and any new alarm will reside in position 001. As new alarms are generated and cleared, the highest number logs (150) in the scroll will be lost.

Viewing the Alarm Log

By using the arrow keys, the last 150 alarms generated can be reviewed in chronological order. The display provides the alarm type information and the time and date of each alarm occurrence.

Alarm Detection

When the controller detects an alarm an output is generated to the relevant alarm relay which in turn illuminates the  button. To see which alarm has accrued press the  button and the most recent alarm will be displayed. If the alarm light is on, the alarm page can be interrogated to identify which alarm is active.


Resetting the Alarm

The auto reset alarms will automatically reset once the conditions are within the set parameters. To clear a manual alarm press the  button twice and the red LED will disappear.

Erasing the Alarm Log

The alarm history log can be erased by selecting Erase Alarm Log in Manufacturer Parameters.

Pump Control Panel

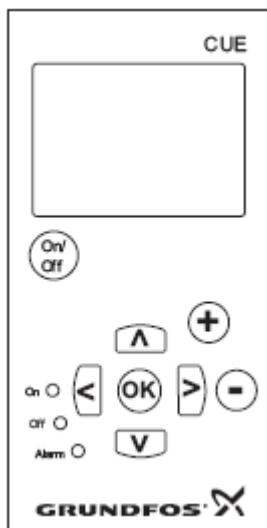

Start-Up Guide

Use the start-up guide for the general setting of the CUE including the setting of the correct direction of rotation. The start-up guide will be started the first time when the CUE is connected to supply voltage. It can be restarted in menu GENERAL. Please note that in this case all previous settings will be erased.

Editing buttons

Button	Function
	Makes the pump ready for operation/starts and stops the pump.
	Saves changed values, resets alarms and expands the value field.
	Changes values in the value field.

Navigating buttons

Button	Function
	Navigates from one menu to another. When the menu is changed, the display shown will always be the top display of the new menu.
	Navigates up and down in the individual menu.

Indicator lights

The operating condition of the pump is indicated by the indicator lights on the front of the control panel. See fig. 49.

The table shows the function of the indicator lights.

Indicator light	Function
On (green)	The pump is running or has been stopped by a stop function. If flashing, the pump has been stopped by the user (CUE menu), external start/stop or bus.
Off (orange)	The pump has been stopped with the on/off button.
Alarm (red)	Indicates an alarm or a warning.

Commissioning Procedure

General

To be read in conjunction with the commissioning sheets provided.

CAUTION

Please ensure all documents have been completed correctly and return to Airedale Technical Support immediately to validate warranty.

Pre Commissioning Checklist**CAUTION**

ALL work MUST be carried out by Technically Trained competent personnel.

The equipment contains live electrical and moving parts, **ISOLATE** prior to maintenance or repair work.

All pipework is complete and insulated where necessary.

Refrigerant standing pressure

The refrigerant charge is to be checked to ensure correct refrigerant type. This is done by measuring the liquid line standing pressure and temperature. This can then be compared to refrigerant data tables or Comparator.

Standing pressures can only be measured in the liquid state.

The standing pressure of a system can identify if non condensable are present in the system.

IMPORTANT

Due to the boiling point of R410A refrigerant it is highly recommended that suitable Personal protective equipment (PPE) is used.

Mains Power

Mains power supply connected to chiller and electrically tested.
(The recommended mains fuse supply is indicated on the serial plate).

Permanent supply

Each chiller also requires a 16 Amp single phase permanent supply (L4) as shown on the electrical wiring diagrams. Permanent power supply connected to chiller and electrically tested.

Pump Interlock

24Vac interlock cable for flow switch and/or pumps are sized correctly in order to eliminate voltage drops. **If the pump interlock is not wired back to the chiller then the visit will be aborted and the unit left isolated.**

Flow Switch

A "paddle type" flow switch is fitted, wired to the chiller control panel and tested. This should be fitted on the **outlet** of the evaporator & before isolation valves.

Chiller water flow rate is correct with all air removed. The required flow rates can be obtained from SERVICE at AIREDALE. An Airedale technician may request water-balancing data prior to commencement of commissioning. To include condenser water flow rates where applicable

Glycol type

Please advise Glycol type and content

Adequate heat load

Adequate heat load is available in order to maintain the required water temperatures during commissioning.

Binder points

Binder points should be fitted to both the flow and return pipework adjacent to the chiller evaporator.

Water strainer

A water strainer must be fitted to the **inlet** side of the chiller evaporator. Failure to do so may result in severe damage and will void the AIREDALE warranty.

Crankcase heater

The power supply to the compressor crankcase heaters must be switched on at least 24 hours prior to AIREDALE technicians' attendance. **Please ensure the relevant internal MCB (MCB 3) is switched on and proven.**

Commissioning Procedure

Electrical connections	Ensure all electrical connections are tight and correctly terminated.
External fuses/ MCB's	Check that the correct electrical supply rating is available to the unit
Electrical continuity	Before electrical power is applied to the unit. Electrical continuity checks must be carried out on the 3 phase power.
Phase rotation	Check that the electrical phase rotation is correct. Components in the unit may malfunction with incorrect phase rotation.
Electrical earthing	Check that the unit is correctly earthed.
Remote on/off	To ensure that the unit does not start whilst doing the pre-commissioning checks the remote on/off should be in the <u>OFF</u> state.
Voltage	<p>Measure the voltage at the following points and record on the commissioning sheet</p> <ul style="list-style-type: none">• Voltage at busbar• Dedicated power supply• Voltage at permanent supply• Control voltage at transformer (min 22.5V, max 25V) <p>The voltage measurements should be carried out with the unit MCB's turned off.</p>

Commissioning Procedure

Waterside	
General water pipework	Ensure that the system water pipework is clean from debris. If a flush and bypass circuit is included ensure that the system is flushed prior to water entering the unit.
Water filter fitted	Ensure that the water filter is fitted and clean.
Water flow rate	Check that the design water flow rate is available to the unit. If not available do not turn unit on.
Waterside pressure drop	Measure the waterside pressure drop of the unit ensuring that the pump (if fitted) is operating.
Glycol strength	Check and record the glycol type and strength. Low levels of glycol can cause freeze up problems when operating at low temperatures or during the unit off state during cold ambient conditions. Glycol concentration is measured by use of a Refractometer.
Differential pressure sensor	Ensure that the differential pressure sensor operates satisfactory; the best way to do this is to reduce the flow to the Chiller. <ul style="list-style-type: none">• From pressure curves determine the design flow rate / pressure drop• Make sure that any effects of glycol in the system are taken into account (Flowrate and pressure drop).• Input into the controller the reduced pressure drop (kPa) value (Normally 80% of design flow rate) Once this value is programmed into the controller the water flowrate can be reduced to verify that the low flow alarm is activated.
Pump interlock	Ensure that the tubes connected to the sensor are insulated.
Controls	
Controller	Check that the pump interlock is fitted and functioning correctly. Record on the commissioning sheet the controller serial numbers details. <ul style="list-style-type: none">• Controller type• Address• Serial number• Bios• Boot• Strategy reference
Controller settings	The following controller settings are to be recorded on the commissioning sheet. <ul style="list-style-type: none">• Head pressure differential (bar)• Minimum suction pressure (bar)• Supply water set point (Summer/ Day) (°C)• Supply water set point (Winter/ Night) (°C)• Minimum supply water temperature (°C)

Commissioning Procedure

Refrigeration Compressor

Record on the commissioning sheet compressor details

- Type
- Serial numbers
- Overload settings

Condenser fans

Record on commissioning sheets condenser fan details

- Type
- Size (kW)
- Serial number
- Controller type
- Running currents

The condenser fans can be operated manually through the controller ensuring correct operation before the refrigeration circuit is energised.

- Check rotation

Operating conditions

Record the following operating conditions of the unit at stable conditions.

- Suction pressure (bar)
- Liquid pressure (Bar)
- Discharge pressure (Bar)
- Suction temperature (°C)
- Liquid temperature (°C)
- Discharge temperature (°C)
- Superheat (°C)
- Sub cooling (°C)
- Water return temperature (°C)
- Water supply temperature (°C)

Liquid line sight glass

Record the status of the liquid line sight glass

- Clear/ flashing
- Wet/dry

The sight glass is used to indicate



- the condition of the refrigerant in the system
- lack of sub-cooling
- refrigerant deficiency
- Moisture content of the refrigerant

The colour of the sight glass depends on the moisture content of the refrigerant. The recommended moisture levels of a system should be between 30 and 75ppm.

An indication of green/dry are to be considered as perfect conditions meaning full protection by the filter drier against effects from moisture.

If the green colour starts to fade, the colour change from green to yellow has begun and the indicator should therefore be watched carefully. If the colour changes to yellow it is a clear signal that the capacity of the filter drier is exceeded and should be replaced as soon as possible.

**Compressor oil level
(Full load)**

Check the compressor oil level at full load. (record oil level)

**HP/ LP Safety
Pressure Switch
Settings**

- Check operating of HP/LP cut-out,

Settings

- LP cut-out – (Auto reset for 3 times when the Low Pressure is detected over a period of 1 hour)
- Has a 2 minute delay on start-up (similar to a Low ambient kit)
- Low pressure cut-out – 0.5 +/- 0.2 Barg
- HP switch – (manual reset): High pressure switch – 40.25 bar +/- 1 Barg
- HP limiting function 40 barg / 2 barg differential (this reduces the number of compressors operating i.e. 3 comp, 2 comp and down to 1 comp).

Low supply water trip

To check operation of the low temperature trip the following procedure can be carried out.

With the unit running increase the low temperature limit to the actual supply water temperature.

This will trip the unit in a safe manner without risk of freezing the evaporator

Return the low temperature limit to correct value after test (this will allow the unit to operate correctly).

EC Fan interrogation

• The EC fans can be interrogated by connecting a hardware interface kit to the fan and PC. The kit comprises of a USB to RS232 9-pin "D-type" adapter. This should be installed on the PC with the software supplied with the kit. The "COM" port of the USB to RS232 adapter should be assigned to a free COM port between COM 1 and COM 4 via the system device manager.

Connect the RS232 to RS485 interface converter to the USB port of your PC via the USB to RS232 serial interface lead and connect the RS485 output to the Fan.

Tx + = RS A

Tx - = RS B

The switch on the RS232 to RS485 should be set to RS485.

IMPORTANT 
Return completed commissioning sheets back to Airedale to validate warranty

Operational Maintenance checks

Owners Responsibility

To ensure that the chiller can be maintained correctly the following requirements are required.

- Maintain a safe working environment around the chiller, free from obstructions and debris.
- The unit shall follow the following maintenance regime as a minimum.



The equipment contains live electrical and moving parts, ISOLATE prior to maintenance or repair work.

Ensure Lock off procedures are carried out accordingly.

If inverter driven pumps are used ensured at least 5 minutes is allowed for them to discharge any electrical charge.

Item	Task	Frequency		
		3 Mths	12 Mths	60 Mths
Unit Inspection				
General Inspections	Check for visible mechanical damage to unit.	●		
	Visually inspect the unit for general wear and tear, treat metalwork.	●		
	Rust should be inhibited, primed and touched up with matching paint.			
	Check for excess vibration from other rotating equipment.	●		
	Clean Micro Channel condenser coils. Do not steam clean use detergent and stiff bristled brush. For heavy dirt, use either a high pressure water with a broad spray pattern or a non-acidic cleaner (Ph <10.5). Take care not to damage fins. Steam cleaning can cause dangerously high pressures in the system and is not recommended.			
Electrical Inspection	Check main power supply voltages		●	
	Check electrical terminals are tight.		●	
	Check for signs of hot spots/ discolouration on power cables.		●	
	Check amperages are as per design.	●		

Service tools / Test Equipment

- Voltmeter
- Screwdrivers/ Allen keys

Safety Equipment

- Safety Glasses/ Goggles

Item	Task	Frequency		
		3 Mths	12 Mths	60 Mths
Refrigeration	Compare the following and compare results with commissioning records.			
	Suction, Liquid and Discharge pressures.	●		
	Refrigeration system temperatures, Suction, Liquid and Discharge. Record superheat and sub cooling temperatures.	●		
	Check each circuit sight glass for dryness and bubbles for indication of leaks.	●		
	Remember to re-cap the Schrader connections!			
	Head pressure control is maintained.	●		
	Record details on F-Gas record.	●		
	Check compressor oil level	●		

Service tools / Test Equipment

- Refrigerant Manifold gauges
- Spanners
- Voltmeter

Safety Equipment

- Safety Glasses/ Goggles
- Gloves
- Overalls

Item	Task	Frequency		
		3 Mths	12 Mths	60 Mths
Waterside	Check pressure drop of water strainer. If excessive clean the strainer.		●	
	Visually inspect pipe and pipework insulation. Pipework clamps are secure.		●	
	Inspect for water leakage	●		
	Check pressure drop of evaporator. Clean evaporator if excessive.	●		
	Check condition of Water/ Glycol solution to ensure that the system is protected against corrosion, scale and microbiological fouling, ensuring maximum heat transfer efficiency.	●		
	Care must be taken in selecting cleaning solutions.			
	Only approved chemicals must be used.			
System	Check the following against the commissioning records.			
	Record operating conditions.			
	Water on/off temperatures	●		
	Water pressure drop	●		

Service tools / Test Equipment

- Spanners
- Manometer
- Thermometer

Safety Equipment

- Safety glasses/ goggles
- Gloves
- Overalls

Item	Task	Frequency		
		3 Mths	12 Mths	60 Mths
Controls	Change controller battery	●		
	The controller will keep the strategy for a short period of time with no battery.			

Service tools / Test Equipment

- Small terminal Screwdriver

Safety equipment

- Electrostatic Wristband

pLAN Termination



The equipment contains live electrical and moving parts, ISOLATE prior to maintenance or repair work.




ALL work MUST be carried out by technically trained competent personnel.


Airedale International Air Conditioning Ltd

Leeds Road, Rawdon, Leeds. LS19 6JY England
Tel: + 44 (0) 113 239 1000
Fax: + 44 (0) 113 250 7219
E-mail: enquiries@airedale.com
Website: wwwairedale.com


1. Disconnect power to the control circuit before wiring the pLAN connection.

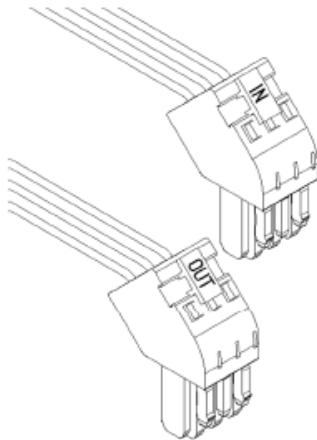

2. Remove the plugs from the bag and wire the pLAN connections to them. Check the correct orientation of the connections against the terminal labels and wiring diagram. Ensure the other end of the pLAN cable is also correctly terminated.

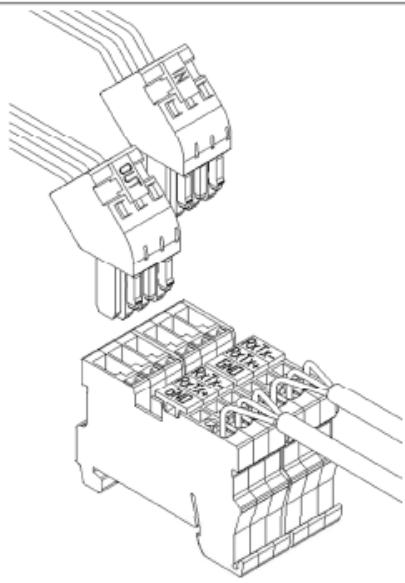

3. Check wiring to ensure no shorts or incorrect connections before connecting to the unit. Failure to do so may cause serious damage to electrical components.

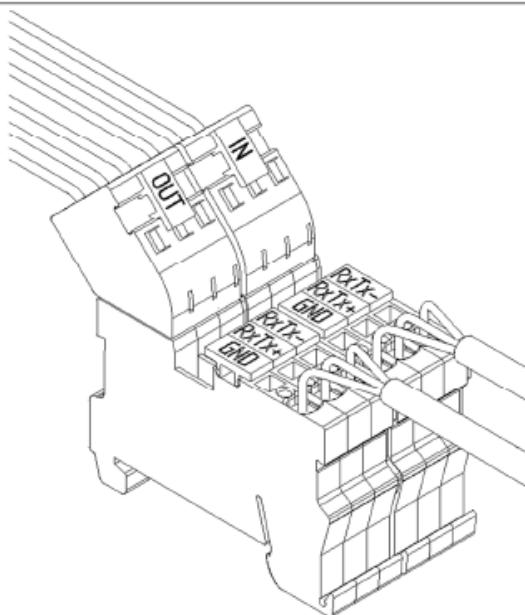

4. Plug the pLAN connectors into the terminals. The control circuit power can then be reconnected.

Maintenance Advice

Microchannel Condenser Coil Cleaning	Clean Micro Channel condenser coils. Do not steam clean use detergent and stiff bristled brush. For heavy dirt, use either a high pressure water with a broad spray pattern or a non-acidic cleaner (pH <10.5).
---	---

Troubleshooting

FAULT	POSSIBLE CAUSE	REMEDY/ACTION
General		
Unit Will Not Start	No power. Wired incorrectly.	Check power supply to the controller. Check wire connections in accordance with wiring diagram.
	Loose wires. Remote on/off	Check all wires, connections, terminals etc. Check that the remote on/off is at the on position.
Refrigeration		
Compressor not operating	No power to compressor. Low pressure cut-out operated (large or complete loss of refrigerant charge).	Check isolator, fuses, MCBS, contactor and control circuit wiring. Recover refrigerant, repair, evacuate and recharge system.
	Compressor showing fault on controller	Determine fault, refer to alarm codes for further information.
Head Pressure too high/HP cut-out operated	Condenser coil clogged or dirty. Overcharge of refrigerant. Normally troublesome in warm weather. Air or other non-condensable gas in system.	Clean condenser. Remove excess refrigerant from system using correct refrigerant handling techniques. Evacuate system and re-charge with new refrigerant.
	Head pressure controller faulty. Fan not operating or operating inefficiently.	Check EC fan control module - if faulty - replace. Check motor - if faulty - replace.
Head pressure too low	Fan operating too fast in low ambient conditions.	Check EC fan control module - if faulty - replace.

Troubleshooting

FAULT	POSSIBLE CAUSE	REMEDY / ACTION
Suction Pressure too low	Flash gas (bubbles in sight glass) at liquid line. Clogged filter drier (pressure / temperature drop across it).	Investigate for refrigerant leaks, repair and re-charge system. Replace drier cores
Condenser		
Condenser fan not operating -Power supply failure. power on	Wiring to motors.	Check power supply at circuit breaker. Check voltage at motor terminals.
	Motor / fan assembly jammed.	Isolate unit and check free rotation of motor/fan assembly. If faulty - replace.
	Motor internal overheat protector tripped.	Carry out continuity check at terminals "TK" in motor terminal box. If tripped and motor hot - check to see if the motor bearings have seized/ fan difficult to turn. If tripped and motor cold - replace motor.
	Faulty motor windings/capacitor.	Motor humming would indicate fault in motor or capacitor. Check windings for continuity and if OK replace capacitor.
	Minimum speed set too low.	Adjust head pressure controller to suit.
Condenser fan runs too fast	High ambient condition or excessive re-circulation of air around condenser coil. Minimum set speed setting incorrect. Incorrect pressure sensor setting. Faulty EC fan Faulty pressure sensor.	Check installation against design. Adjust as necessary. Adjust via microprocessor. Replace fan Replace sensor.
Condenser fans runs only slowly	Incorrect pressure setting. Faulty EC fan. Faulty Pressure sensor. Motor/capacitor faulty. Motor wired incorrectly.	Adjust via microprocessor. Replace fan. Replace sensor. Replace. Check against wiring diagram - correct as required.

Troubleshooting

FAULT	POSSIBLE CAUSE	REMEDY / ACTION
Waterside		
Pump not operating	No power to pump Inverter tripped and does not auto reset (the microprocessor will try and auto reset 3 times)	Check isolator, fuses, MCBs, contactor and control circuit wiring. Reset inverter drive via microprocessor
No water flow	Strainer blocked	Clean strainer
Pump noisy	Air in water system Pump cavitations	Purge air from water system Ensure there is 0.5m NPSH suction head to avoid cavitations.
Unit not operating due to water pressure sensor low limit alarm.	Low flow alarm operating	Check that the low flow pressure variable is set correctly. If too high the unit may have nuisance trips.
Low temp limit alarm	Partial blockage in evaporator causing low flow. The water flow is reduced however the differential pressure switch still remains healthy as the pressure would increase. No heat load on system	Ensure that the water strainer and evaporator are clean. Ensure there is design cooling load.
Water/ Glycol freezing up (crystallizes)	Insufficient glycol/water concentration for operating temperatures.	Check glycol concentration and add accordingly.

Unit Alarms

Code	Description	Auto Reset (Yes/No)	Unit Disabled (Yes/No)	Component Disabled (Yes/No)	Cause	Action
AL001	Power Meter MB Offline	Yes	Yes	Yes	Communication to the Power Meter has been lost	Check: Wiring / Modbus card / Power Meter
AL002	EVD1 pLAN Offline	Yes	No	Yes	Communication to the EVD Driver has been lost	Check: Wiring / pLan Connection / Address
AL003	EVD2 pLAN Offline					
AL004	Cond. Pressure1 Fault	Yes	No	Yes	The Sensor has gone out of its operating range	Check: Wiring / Sensor
AL005	Cond. Pressure2 Fault		No			
AL006	Evap.Dif.Press. Fault		Yes			
AL007	Return Temp. Fault		Yes			
AL008	Supply Temp. Fault		Yes			
AL009	Temp. Setpoint Fault		No			
AL010	Cond.Air On Temp Fault		No			
AL011	Clock Alarm	Yes	No	Yes	The internal clock has malfunctioned	Replace Battery
AL012	Emergency Stop	Yes	Yes	Yes	The emergency stop button has been pressed	Release the emergency stop button
AL013	Phase Failure	Yes	Yes	Yes	The 3 phase power supply crossed / loss (wait 30s with a power meter on power up)	Check 3 phase connection
AL014	Evaporator Flow Alarm	Yes	Yes	Yes	No water flow has been detected	Check: pumps are running / flow sensor
AL015	Low Pressure 1 Switch	Yes	No	Yes	The pressure in the system is below 0.5 bar	Check: Refrigerant charge / EEV operation
AL016	Low Pressure 2 Switch					
AL017	Cct1 Comp1 Status Al.					
AL018	Cct1 Comp2 Status Al.					
AL019	Cct1 Comp3 Status Al.					
AL020	Cct2 Comp1 Status Al.					
AL021	Cct2 Comp2 Status Al.					
AL022	Cct2 Comp3 Status Al.					
AL023	Pump1 Status Alarm		Yes	Yes	Contactor has been switched on but has failed to operate	Check: High Pressure Switch / contactor. / Wiring.
AL024	Pump2 Status Alarm					
AL025	Low Supply Temperature	Yes	Yes	Yes	The supply water temperature is too low	Check: Flow Rate / Unit TD
AL026	High Cond. Pressure 1	Yes	No	Yes	The condensing pressure is higher than 40.0Bar	Check: Condenser / Condenser Fans
AL027	High Cond. Pressure 2					
AL028	pCOe Module Offline	Yes	No	Yes	Communication to the pCOe expansion module has been lost	Check: Communications link / Wiring
AL029	S1 Probe Fault EVD1		No	Yes	The Evaporator pressure probe is out of range	Check: Pressure probe / Wiring

Code	Description	Auto Reset (Yes/No)	Unit Disabled (Yes/No)	Component Disabled (Yes/No)	Cause	Action
AL030	EEPROM Fault EVD1		No	Yes	There has been mismatch with between data in the EVD and the controller	Reset the alarm / Replace EVD if necessary
AL031	EEV Motor Fault EVD1		No	Yes	The stepper motor has malfunctioned	Check: Motor / Wiring
AL032	MOP Alarm EVD1		No	Yes	The Evaporating temperature has exceeded the MOP limit	The valve will close to reduce operating pressure
AL033	LOP Alarm EVD1		No	Yes	The Evaporating temperature has exceeded the LOP limit	The Valve will open to increase operating pressure
AL034	Low Superheat EVD1		No	Yes	The superheat in circuit 1 is low	Check: EEV Settings
AL035	S2 Probe Fault EVD1		No	Yes	The Evaporator Temperature probe is out of range	Check: Temperature probe / Wiring
AL036	High Superheat EVD1		No	Yes	The superheat in circuit 1 is high	Check: EEV Settings
AL037	S1 Probe Fault EVD2		No	Yes	The Evaporator pressure probe is out of range	Check: Pressure probe / Wiring
AL038	EEPROM Fault EVD2		No	Yes	There has been mismatch with between data in the EVD and the controller	Reset the alarm / Replace EVD if necessary
AL039	EEV Motor Fault EVD2		No	Yes	The stepper motor has malfunctioned	Check: Motor / Wiring
AL040	MOP Alarm EVD2		No	Yes	The Evaporating temperature has exceeded the MOP limit	The valve will close to reduce operating pressure
AL041	LOP Alarm EVD2		No	Yes	The Evaporating temperature has exceeded the LOP limit	The Valve will open to increase operating pressure
AL042	Low Superheat EVD2		No	Yes	The superheat in circuit 2 is low	Check: EEV Settings
AL043	S2 Probe Fault EVD2		No	Yes	The Evaporator Temperature probe is out of range	Check: Temperature probe / Wiring
AL044	High Superheat EVD2		No	Yes	The superheat in circuit 2 is high	Check: EEV Settings
AL045	Leak Detector 1 Fault	Yes	No	Yes	The output from the leak detector is out of range	Check: Leak detector / Wiring
AL046	Leak Detector 2 Fault					
AL047	Possible Leak Circ.1	Yes	No	No	The reading from the leak detector is above the threshold	Check: Pipe work around the leak detector
AL048	Possible Leak Circ.2					
AL049	Cct1 Hours Limit Comp1	Yes	No	No	The hours run for the compressor has exceeded the threshold	If component is functioning correctly perform maintenance and reset hours
AL050	Cct1 Hours Limit Comp2					
AL051	Cct1 Hours Limit Comp3					
AL052	Cct2 Hours Limit Comp1					
AL053	Cct2 Hours Limit Comp2					
AL054	Cct2 Hours Limit Comp3					

Code	Description	Auto Reset (Yes/No)	Unit Disabled (Yes/No)	Component Disabled (Yes/No)	Cause	Action
AL055	Hours Limit Pump 1	Yes	No	No	The hours run for the pump has exceeded the threshold	If component is functioning correctly perform maintenance and reset hours
AL056	Hours Limit Pump 2					
AL057	CW Valve Feedback	Yes	Yes	Yes	Valve Failed to open	Check: Valve operation / Wiring
AL058	Low Suction Pressure 1	Yes	No	Yes	The suction pressure has exceeded the low limit during operation	Check: Evaporator flow rate / Unit TD / Refrigerant charge
AL059	Low Suction Pressure 2					
AL060	pLAN Network Alarm	Yes	No	No	Chiller controller has lost communication with sequence controller	Check: Wiring / pLan Connection / Address
AL061	Oil Pre-Heat Delay	Yes	Yes	Yes	Follows a controller power restart and indicates time delay before compressors restart	No action necessary
AL062	Cct1 Diff. Pressure	Yes	No	Yes	The compressor differential pressure limits have been exceeded	Check: Evaporator flow rate / Unit TD / Refrigerant charge
AL063	Cct2 Diff. Pressure					
AL064	Possible Leak Unit	Yes	No	No	The reading from the leak detector is above the threshold	Check: Pipe work around the leak detector
AL065	Evap.Inlet Temp. Fault	Yes	Yes	Yes	The Sensor has gone out of its operating range	Check: Wiring / Sensor
AL066	Circuit 1 Disabled After Pumpdown	No	No	Yes	The circuit has been pumped down following a possible refrigerant leak or manual pumpdown request and disabled	Investigate reason for pumpdown and reset
AL067	Circuit 2 Disabled After Pumpdown					

Pump Warning and Alarm List

Code and display text	Status		
	Warning	Alarm	Locked Alarm
			Operating Mode
			Re-setting
1 Too high leakage current		●	Stop Man.
2 Mains Phase Failure		●	Stop Auto
3 External fault		●	Stop Man.
16 Other Fault		●	Stop Auto
		●	Stop Man.
30 Replace Motor bearing	●		- Man. ³⁾
32 Overvoltage	●		- Auto
	●		Stop Auto
40 Undervoltage	●		- Auto
	●		Stop Auto
48 Overload		●	Stop Auto
		●	Stop Man.
49 Overload		●	Stop Auto
55 Overload	●		- Auto
			Stop Auto
57 Dry Running	●		Stop Auto
64 Too high CUE temperature	●		Stop Auto
70 Too High Motor temperature	●		Stop Auto
77 Communication fault, Duty / standby	●		- Auto
89 Sensor 1 outside range		●	1) Auto
91 Temperature sensor 1 outside range	●		- Auto
93 Sensor 2 outside range	●		- Auto
96 Setpoint signal Outside range	●		1) Auto
148 Too high bearing temperature	●		Auto
	●		Stop Auto
149 Too high bearing temperature	●		Auto
	●		Auto
155 Inrush fault	●		Auto
175 Temperature sensor 2 outside range	●		- Auto
240 Relubricate motor bearings	●		- Man. ³⁾
241 Motor phase failure	●		- Auto
	●		Stop Auto
242 AMA did not succeed ²⁾	●		- Man.

1) in case of an alarm, the CUE will change the operating mode depending on the pump type

2) AMA, Automatic Motor Adaption

3) Warning is reset in display 3.20

Warning

The CUE will continue the operation as long as the warning is active. The warning remains active until the cause no longer exists. Some warnings may switch to alarm condition if the warning has been present for a period.

Alarm

In case of an alarm, the CUE will stop the pump or change the operating mode depending on the alarm type and pump type. Pump operation will be resumed when the cause of the alarm has been remedied and the alarm has been reset.

Resetting an alarm manually

- Press OK in the alarm display
- Press On/ Off twice
- Activate a digital input DI 2 – DI 4 set to “Alarm reset” or the digital input DI (start/ stop)

If it is not possible to reset an alarm, the reason may be that the fault has not been remedied, or that the alarm has been locked.

Locked alarm

In case of a locked alarm, the CUE will stop the pump and become locked. Pump operation cannot be resumed until the cause of the locked alarm has been remedied and the alarm has been reset.

Resetting a locked alarm

- Switch off the power supply to the CUE for approx 30 seconds
- Switch on the power supply, and press the OK in the alarm display to reset the alarm.



Head Office:

Airedale International Air Conditioning Ltd
Leeds Road
Rawdon
Leeds LS19 6JY
United Kingdom

Tel: +44 (0) 113 239 1000
Fax: +44 (0) 113 250 7219

e-mail: enquiries@airedale.com
website: wwwairedale.com

A  MODINE Company

PART NO: (TM E)	ISSUE
V1.0.0	10/2010
V1.2.0	01/2011
V1.3.0	04/2011
V1.4.0	06/2011
V1.5.0	06/2011
V1.6.0	10/2011
V1.7.0	04/2012
V1.8.0	09/2012
V1.9.0	12/2013
V1.10.0	10/2014
V1.11.0	04/2015
V1.12.0	11/2015
V1.13.0	01/2016
V1.14.0	04/2016